

5126

**FINAL**

**HEALTH AND SAFETY PLAN**

**OPERABLE UNIT NO. 10  
(SITE 35 - CAMP GEIGER AREA FUEL FARM)**

**MARINE CORPS BASE  
CAMP LEJEUNE, NORTH CAROLINA**

**CONTRACT TASK ORDER 0160**

*Prepared For:*

**DEPARTMENT OF THE NAVY  
ATLANTIC DIVISION  
NAVAL FACILITIES  
ENGINEERING COMMAND  
*Norfolk, Virginia***

*Under:*

**LANTDIV CLEAN Program  
Contract N62470-89-D-4814**

*Prepared by:*

**BAKER ENVIRONMENTAL, INC.  
*Coraopolis, Pennsylvania***

**DECEMBER 1993**

## EXECUTIVE SUMMARY

Several potential chemical and physical hazards are associated with the tasks of this project at Site 35. The chemicals that could be associated with this site are based upon site background information and include volatile organic compounds (VOCs), petroleum hydrocarbons, and metals. Some physical hazards associated with this project are from the use of heavy equipment (drill rig) and temperature stress. The environmental hazards include the various degrees of dangerous flora and fauna. Section 3.0 describes these hazards.

Air monitoring requirements consists of using a HNu with an 11.7 electron volt (eV) bulb and the availability of an oxygen/lower explosive meter, radiation meter, and Dräger tubes. Section 5.0 describes the air monitoring requirements including frequency, action levels, operation, and documentation.

Various levels will be required for the different site tasks. The protection levels will range between Level D and Modified Level D with potential for upgrades based on air monitoring results.

# TABLE OF CONTENTS

	<u>Page</u>
<b>EXECUTIVE SUMMARY</b>	
<b>1.0 INTRODUCTION</b> .....	<b>1-1</b>
1.1 Policy .....	1-1
1.2 References .....	1-1
1.3 Pre-Entry Requirements .....	1-2
<b>2.0 PROJECT PERSONNEL AND RESPONSIBILITIES</b> .....	<b>2-1</b>
<b>3.0 SITE CHARACTERIZATION</b> .....	<b>3-1</b>
3.1 Site 35 - Camp Geiger Area Fuel Farm .....	3-1
3.1.1 Site Description .....	3-1
3.1.2 Site History .....	3-1
3.2 Site Work Plans .....	3-2
3.3 Hazard Evaluation .....	3-3
3.3.1 Task-Specific Hazards .....	3-3
3.3.2 Chemical Hazards .....	3-5
3.3.3 Physical Hazards .....	3-5
3.3.4 Radiation Hazards .....	3-9
3.3.5 Environmental Hazards .....	3-9
<b>4.0 SITE CONTROL</b> .....	<b>4-1</b>
4.1 Site Access .....	4-1
4.2 Site Conditions .....	4-1
4.3 Work Zones .....	4-1
4.4 "Buddy System" .....	4-3
4.5 Safe Work Practices .....	4-3
4.5.1 Heavy Equipment .....	4-3
4.5.2 Drilling Operations .....	4-4
4.6 Sanitation/Site Precautions .....	4-4
<b>5.0 ENVIRONMENTAL MONITORING</b> .....	<b>5-1</b>
5.1 Personal Monitoring .....	5-1
5.2 Point Source Monitoring .....	5-2
5.3 Perimeter Monitoring .....	5-3
5.4 Equipment Maintenance and Calibration .....	5-3
5.5 Monitoring Documentation .....	5-3
<b>6.0 PERSONAL PROTECTIVE EQUIPMENT</b> .....	<b>6-1</b>
6.1 Personal Protective Equipment Selection .....	6-1
6.2 Site-Specific Levels of Protection .....	6-1
6.3 Respiratory Protection .....	6-2
6.4 Care and Cleaning of Personal Protective Equipment .....	6-3

**TABLE OF CONTENTS**  
**(Continued)**

	<u>Page</u>
<b>7.0 DECONTAMINATION PROCEDURES .....</b>	<b>7-1</b>
7.1 Personnel Decontamination .....	7-1
7.2 Equipment Decontamination .....	7-2
7.3 Waste Handling Procedures .....	7-2
<b>8.0 EMERGENCY PROCEDURES .....</b>	<b>8-1</b>
8.1 Pre-Emergency Planning .....	8-1
8.2 Emergency Coordinator .....	8-1
8.3 Communications .....	8-2
8.4 Assembly Area .....	8-3
8.5 Emergency Hospital Route .....	8-4
8.6 Emergency Medical Treatment .....	8-4
8.7 Emergency Decontamination Procedures .....	8-9
8.8 Personal Protection and First-Aid Equipment .....	8-9
8.9 Notification .....	8-10
8.10 Hazard Assessment .....	8-11
8.11 Security .....	8-11
8.12 Emergency Alerting .....	8-12
8.13 Training .....	8-14
8.14 Spill Containment Procedures .....	8-14
<b>9.0 TRAINING REQUIREMENTS .....</b>	<b>9-1</b>
9.1 General .....	9-1
9.2 Site-Specific Requirements .....	9-2
<b>10.0 MEDICAL SURVEILLANCE REQUIREMENTS .....</b>	<b>10-1</b>
<b>11.0 HEALTH AND SAFETY PLAN APPROVAL .....</b>	<b>11-1</b>
<b>12.0 DECLARATION OF HEALTH AND SAFETY PLAN REVIEW .....</b>	<b>12-1</b>

## LIST OF TABLES

<u>Number</u>		<u>Page</u>
3-1	Toxicological Properties of Chemicals .....	3-6
10-1	Medical Surveillance Testing Parameters .....	10-2

## LIST OF FIGURES

<u>Number</u>		<u>Page</u>
4-1	General Contaminant Reduction Zone Layout .....	4-2
8-1	Hospital Route .....	8-5

## LIST OF APPENDICES

- A Baker Environmental, Inc. (Baker)  
Safety Standard Operating Procedures (SOPs)
- B Material Safety Data Sheets
- C Emergency Procedures for Exposure to  
Hazardous Materials/Waste

## 1.0 INTRODUCTION

### 1.1 Policy

It is the policy of Baker Environmental, Inc. (Baker) that all on-site hazardous waste management activities be performed in conformance with a Site-Specific Health and Safety Plan (HASP). The HASP is written based on the anticipated hazards and expected work conditions and applies to activities performed by both Baker and subcontractor personnel. The HASP may be modified/updated with the approval of the Project Health and Safety Officer (PHSO) and Project Manager. Proper notification will be given to the Navy Engineer-in-Charge (EIC) when such changes to the plan are implemented.

The HASP is based on an outline developed by the U.S. Coast Guard (U.S.C.G.) for responding to hazardous chemical releases (U.S.C.G. Pollution Response COMDTINST-ML6456-30) and by National Institute for Occupational Safety and Health (NIOSH), Occupational Safety and Health Administration (OSHA), USCG, and Environmental Protection Agency's (EPA's) recommended health and safety procedures (Occupational Safety and Health Guidance Manual for Hazardous Waste Site Activities). This plan, at a minimum, meets the requirements under OSHA Standard 29 CFR 1910.120 (Hazardous Waste Operations and Emergency Response). This plan has been designed as a Site-Specific HASP for field investigation and sampling activities at Marine Corps Base (MCB), Camp Lejeune, Jacksonville, North Carolina, for Site 35, Camp Geiger.

### 1.2 References

The following publications have been referenced in the development and implementation of this HASP.

- American Conference of Governmental Industrial Hygienists (ACGIH), Threshold Limit Values for Chemical Substances and Physical Agents and Biological Exposure Indices for 1991-1992.
- The Center for Labor Education and Research, Lori P. Andrews, P.E., Editor. Worker Protection During Hazardous Waste Remediation, Van Nostrand Reinhold, New York, New York. 1990.

- Lewis, Richard J., Sr. Hazardous Chemicals Desk Reference, 3rd Edition, Van Nostrand Reinhold, New York, New York. 1991.
- NIOSH/OSHA/USCG/EPA. Occupational Safety and Health Guidance Manual for Hazardous Waste Site Activities. October 1985.
- U.S.C.G. Policy for Response to Hazardous Chemical Releases. USCG Pollution Response COMDTINST-M16465.30.
- U.S. Department of Health and Human Services, Public Health Service, Centers for Disease Control, NIOSH. NIOSH Pocket Guide to Chemical Hazards. June 1990.
- U.S.EPA, Office of Emergency and Remedial Response, Emergency Response Division. Standard Operating Safety Guides. June 1992.

### 1.3 Pre-Entry Requirements

During the site mobilization and prior to the investigation activities, the SHSO will:

- Perform a reconnaissance of the anticipated work areas as identified in the Work Plan.
- Establish or confirm emergency points of contact and procedures.
- Review any other issues deemed necessary to address site safety and health.

The SHSO will then meet with site personnel (as identified in Section 2.0) to discuss:

- Data obtained from the previous site reconnaissance
- Provisions outlined in this HASP
- Appropriate safety and health related procedures/protocols.

## **2.0 PROJECT PERSONNEL AND RESPONSIBILITIES**

The following personnel are designated to carry out the stated job functions for both on- and off-site activities. (Note: One person may carry out more than one job function, and personnel identified are subject to change.). The responsibilities that correspond with each job function are outlined below.

**PROJECT MANAGER: Mr. Daniel L. Bonk, P.E.**

The project manager is responsible for assuring that all activities are conducted in accordance with the HASP. The Project Manager has the authority to suspend field activities if employees are in danger of injury or exposure to harmful agents or conditions. In addition, the Project Manager is responsible for:

- Assisting the Project Health and Safety Officer in Site-Specific HASP development for all phases of the project.
- Designating a Site Health and Safety Officer and other site personnel who will assure compliance with the HASP.
- Reviewing and approving the information presented in this HASP.

**PROJECT HEALTH AND SAFETY OFFICER (PHSO): Mr. Ronald Krivan, CSP**

The Project Health and Safety Officer is responsible for general development and monitoring of compliance with the HASP. The PHSO will be the primary contact for inquiries as to the contents of the HASP. The PHSO will be consulted before changes to the HASP can be approved or implemented. The PHSO's responsibilities will include:

- Coordinating the development, evaluation, and approval of the HASP.
- Developing amendments to the HASP when applicable.
- Resolving issues that arise in the field with respect to interpretation or implementation of the HASP.

- Monitoring the field program through a regular review of field health and safety records, on-site activity audits, or a combination of both.
- Determining that all on-site personnel have received the required training and medical surveillance prior to entry onto the site.

**SITE MANAGER: (To Be Named Prior To On-site Activities)**

---

The Site Manager is responsible for assuring that all day-to-day activities are conducted in accordance with the HASP. The Site Manager has the immediate authority to suspend field activities if employees are subjected to a situation that can be immediately dangerous to life or health. The Site Manager's responsibilities include:

- Assuring that the appropriate health and safety equipment and PPE is available and that it is properly maintained.
- Coordinating overall site access and security measures.
- Controlling site access to hazardous areas, including the documentation of personnel arriving/departing (by name, company, and time).
- Approving all on site activities.
- Coordinating site safety and health issues with the SHSO.
- Assisting the SHSO in coordinating emergency procedures with the Naval Activity, emergency medical responders, etc., during site mobilization activities.
- Coordinating activities with Baker and subcontractor personnel.

**SITE HEALTH AND SAFETY OFFICER: (To Be Named Prior To On-site Activities)**

---

The SHSO is responsible for the implementation of the HASP. These responsibilities include:

- Coordinating and documenting the pre-entry briefing and periodic (weekly) briefings.

- Assuring that monitoring equipment is properly calibrated and properly used.
- Managing health and safety equipment, including instruments, respirators, PPE, etc., that is used in field activities.
- Arranging emergency response provisions in cooperation with Naval Activity Requirements, emergency medical care, etc., during site mobilization activities.
- Monitoring conditions during field activities to assure compliance with the HASP and evaluate if more stringent procedures or a higher level of PPE should be implemented, and informing the PHSO and Project Manager.
- Documenting relevant health and safety events, site monitoring information, accident investigation and reporting, safety inspections, and site conditions.
- Overseeing the decontamination of personnel and equipment.
- Determining safe boundary procedures for activities requiring Level C or higher protection levels.
- Acting as the Emergency Coordinator and assuring the availability of a communication network and deployment of the HASP and emergency equipment to field teams.
- Implementing the Baker Hazard Communication Program.
- Auditing the subcontractor training and medical surveillance records to verify compliance.
- Suspending field activities because of unsafe conditions that can threaten life or health.

**FIELD TEAM LEADER:** (To be Named Prior to On-Site Activities) \_\_\_\_\_

The Field Team Leader is responsible for:

- Implementing safety procedures relevant to the tasks under his/her direction.
- Determining safe boundary procedures for activities requiring Level D or D+ protection levels.
- Assuring that PPE is properly maintained.
- Complying with the conditions as outlined under Field Team Members.

**FIELD TEAM MEMBERS:** (To Be Named Prior To Site Activities)

_____	_____	_____
_____	_____	_____
_____	_____	_____

The Field Team Members are responsible for:

- Becoming familiar with the HASP.
- Complying with the contents of the HASP.
- Attending training sessions to review the HASP, and staying informed of additional safety and health information.
- Being alert to identified and unidentified hazards.
- Reporting unidentified hazards to the SHSO and Site Manager.
- Offering suggestions, ideas, or recommendations that may improve or enhance site safety.
- Conducting site activities in an orderly and appropriate manner.



### **3.0 SITE CHARACTERIZATION**

This section is divided into subsections. These subsections describe the site background, work tasks, and a hazard evaluation for Site 35 at MCB Camp Lejeune.

#### **3.1 Site 35 - Camp Geiger Area Fuel Farm**

##### **3.1.1 Site Description**

Camp Geiger is located at the extreme northeast corner of MCB Camp Lejeune, Onslow County. The main entrance to Camp Geiger is off of U.S. Route 17, approximately 3.5 miles southeast of the City of Jacksonville, North Carolina. Site 35, the Camp Geiger Area Fuel Farm refers primarily to five, 15,000-gallon aboveground storage tanks (ASTs), a pump house, and a fuel unloading pad situated within Camp Geiger just north of the intersection of Fourth and "G" Streets. Previous environmental investigations at the site identified underground fuel distribution piping that connect the ASTs to existing and former USTs and expanded the area referred to as Site 35. According to Law (1992), the Site 35 study area is bounded on the west by D Street, on the north by Second Street, on the east by Brinson Creek, and on the south by Building No. TC-474.

The ASTs at Site 35 are used to dispense gasoline, diesel and kerosene to government vehicles and to supply USTs in use at Camp Geiger and the nearby New River Marine Corps Air Station. The ASTs are supplied by commercial carrier trucks which deliver product to fill ports located on the fuel unloading pad at the southern end of the facility. Six, short-run (120 feet maximum), underground fuel lines are currently utilized to distribute the product to the ASTs.

##### **3.1.2 Site History**

Construction of Camp Geiger was completed in 1945, four years after construction of Camp Lejeune MCB was initiated. Available drawings date the Fuel Farm back to at least July 1941. Originally, the ASTs were used for the storage of No. 6 fuel oil, but, were later converted (date unknown) for storage of other petroleum products including unleaded gasoline, diesel fuel, and kerosene. The ASTs currently in use at the site are the original tanks.

Formerly, the ASTs at Site 35 supplied a gasoline filling station which was located on the northeast corner of the intersection of "F" and Fourth Streets. A leak in the underground line from the Fuel Farm to the dispensing island was reportedly responsible for the loss of roughly 30 gallons per day of gasoline over an unspecified period (Law, 1992). The leaking line was subsequently sealed and replaced.

Reports of a Mogas release in an underground near one of the ASTs date back to 1957-58 (ESE, 1990). Apparently, the leak occurred as the result of damage to a dispensing pump. At that time the Camp Lejeune Fire Department estimated that thousands of gallons of fuel were released although records of the incident have since been destroyed. The fuel migrated to the east and northeast into Brinson Creek. Interceptor trenches were excavated and the captured fuel was ignited and burned as was the product which discharged into Brinson Creek.

Another abandoned underground distribution line extended from the ASTs to the Mess Hall, formerly located adjacent to "D" Street, between Third and Fourth Streets. The underground line dispensed No. 6 Fuel Oil to a UST which fueled the Mess Hall boiler. The Mess Hall is believed to have been demolished in the 1960s.

### **3.2 Site Work Plans**

The Work Plan (detailing the tasks to be performed at each site), the Sampling and Analysis Plan (SAP), and Quality Assurance Project Plan (QAPP) are bound as separate documents. The work tasks to be accomplished at each of the sites include:

- Survey
- Soil borings
- Well installation
- Well purging and sampling
- Surface water and sediment sampling
- Benthic macroinvertebrate sampling

The following section details physical hazard and potential chemical risks associated with the work tasks.

### 3.3 Hazard Evaluation

#### 3.3.1 Task-Specific Hazards

Hazards at the site may be associated with several job tasks as detailed in the site work plan.

Listed below are summaries for the hazards associated with each of the site tasks.

#### Land Surveying

##### *Chemical*

- Ingestion of contaminated material from hand to mouth contact.

##### *Physical/Environmental*

- Slips/trips/falls - sloped, uneven terrain; crawling over and under obstacles.
- Contact with insects and vegetation.
- Interaction with native and potentially hostile animal life.

#### Soil Boring-Sampling

##### *Chemical*

- Potentially-contaminated mud, etc., in eyes or on skin.
- Skin contact potentially with contaminated soil.
- Ingestion of contaminated soils from hand to mouth contact.
- Inhalation of volatile contaminants or volatile fraction of semivolatile contaminants.

##### *Physical/Environmental*

- Heavy equipment operation hazards.
- Lifting hazards (muscle strain).
- Contact with insects and vegetation.
- Contact with underground utilities.
- Interaction with native and potentially hostile animal life.
- Heavy objects landing on foot/toe or head.
- Strips/trips/falls from sloped, uneven terrain.

## Monitoring Well Installation

### *Chemical*

- Potentially-contaminated mud, etc. in eyes and on skin.
- Contact with potentially contaminated material.
- Ingestion of hazardous materials from hand to mouth contact.
- Inhalation of volatile contaminants or volatile fraction of semivolatile contaminants.

### *Physical/Environmental*

- Heavy equipment operation hazards.
- Slips/trips/falls - sloped, uneven terrain; crawling over and under obstacles.
- Contact with insects and vegetation.
- Overhead hazards from drill rig operations.
- Interaction with native and potentially hostile animal life.
- Contact with underground utility lines.
- Lifting hazards (muscle strain).

## Monitoring Well Development

### *Chemical*

- Potentially-contaminated water, etc., in eyes and on skin.
- Ingestion of hazardous materials from hand to mouth contact.
- Inhalation of volatile contaminants or volatile fraction of semivolatile contaminants.

### *Physical/Environmental*

- Elevated noise levels from equipment operation.
- Slips/trips/falls - sloped, uneven terrain.
- Skin irritation from contact with insects and vegetation.
- Interaction with native and potentially hostile animal life.

## Groundwater Sampling

### *Chemical*

- Skin contact with potentially contaminated water.
- Eye contact from splashing water.
- Ingestion of hazardous materials from hand to mouth contact.
- Inhalation of volatile contaminants or volatile fraction of semivolatile contaminants emitting from the well opening.

### *Physical/Environmental*

- Contact with insects and vegetation.
- Lifting hazards (muscle strain, etc.) while bailing well.
- Cuts from using knives to cut bailer rope.
- Slips/trips/falls - sloped, uneven terrain.
- Interaction with native and potentially hostile animal life.

## Sediment/Surface Water Sampling and Benthic Macroinvertebrate Sampling

### *Chemical*

- Potential for contaminated material to be splashed onto body or in eyes.
- Ingestion of contaminated material from hand to mouth contact.
- Inhalation of volatile constituents within the sediments or surface water.
- Absorption of constituents through the skin.

### *Physical/Environmental*

- Sampling operations that occur from boats. These operations must comply with Baker's Safety SOP for Safe Boat Operations. (Appendix A)
- Slips/trips/falls - sloped, uneven terrain; crawling over and under obstacles.
- Contact with insects and vegetation.
- Interaction with native and potentially hostile animal life.

### **3.3.2 Chemical Hazards**

Exposure to hazardous chemicals can occur through various pathways into the body. These pathways include:

- Inhalation of vapors and/or particulates.
- Ingestion of contaminated particulates from hand-to-mouth contact.
- Dermal and eye contact from direct, unprotected contact.
- Absorption through the eye from exposure to concentrations in the air.

Table 3-1 identifies the toxicological properties of the chemicals identified through the background and history of Site 35. Symptoms caused from an exposure to these chemicals can be located on the respective Material Safety Data Sheets (MSDS) located in Appendix B. Procedures to follow in the event of a chemical exposure, are included as Appendix C.

### **3.3.3 Physical Hazards**

#### **3.3.3.1 Underground/Overhead Utilities**

An underground utility clearance must be obtained before any intrusive activities are performed at Site 35. This clearance must come from the base representative for this project and the North Carolina Utilities Locating Company, Inc. (ULOCO). If underground utilities

TABLE 3-1

**TOXICOLOGICAL PROPERTIES OF CHEMICALS  
SITE 35**

CHEMICAL COMPOUND <sup>(1)</sup>	HAZARD RATING <sup>(2)</sup> H F R	Volatility <sup>(3)</sup>	Skin Absorption <sup>(4)</sup>	Carcinogen <sup>(5)</sup>	TWA <sup>(6)</sup>	STEL <sup>(7)</sup>	Ceiling <sup>(8)</sup>	IDLH <sup>(9)</sup>	IP <sup>(10)</sup>
<b>VOLATILES:</b>									
Benzene	2 3 0	75	No	Yes	1 ppm	5 ppm	-	3,000 ppm	9.25
Diesel Fuel	0 2 0	<1	No	Yes	5 mg/m <sup>3</sup> (mist)	10 mg/m <sup>3</sup> (mist)	-	-	<11.7
Ethylbenzene	2 3 0	10	No	No	100 ppm	125 ppm	-	-	8.86
Fuel Oil No. 6	0 2 0	0.2 mm @ 21° C	No	Yes	-	-	-	-	<11.7
Gasoline	1 4 0	Not Listed	No	Yes	300 ppm	500 pm	-	-	<11.7
Kerosene	0 2 0	5	No	Yes	-	-	-	-	<11.7
Toluene	2 3 0	22	No	No	100 ppm	150 ppm	-	2,000 ppm	8.82
Trichloroethylene	2 2 0	58	No	Yes	50 ppm	200 ppm	-	1,000 ppm	9.45
Xylene	2 3 0	7-9	No	No	100 ppm	150 ppm	-	1,000 ppm	8.56
<b>METALS:</b>									
Lead	NA	NA	No	Yes	0.05 mg/m <sup>3</sup>	-	-	700 mg/m <sup>3</sup>	NA

- Notes: (1) Chemical compound of potential concern obtained from previous investigation.  
(2) Hazard Rating - based upon Health (H), Fire (F), or Reactivity (R) hazard from NFPA 704 Standard Rating System (0 = no hazard, 4 = high hazard)  
(3) Volatility Rating - based upon vapor pressure in mm Hg at 68° F, 20° C  
(4) Skin Absorption - "Yes" indicates potential exposure through skin and mucous membranes, either by airborne or, more particularly, by direct contact - ACGIH 1991-1992  
(5) Carcinogen - "Yes" indicates a compound is a confirmed or suspect human carcinogen by the IARC, NIOSH, NTP, EPA or ACGIH  
(6) TWA - Time Weighted Average from the 1991-1992 TLV - Threshold Limit Value of the ACGIH or OSHA Permissible Exposure Limits (PEL), whichever is lower  
(7) Short Term Exposure Limit - "STEL" denotes a 15 minute time weighted average which may not be exceeded - ACGIH 1990-1991  
(8) Ceiling Limit - denotes the ceiling concentration that cannot be exceeded at any time - ACGIH 1990-1991  
(9) IDLH - Immediately Dangerous to Life and Health  
(10) Ionization Potential - expressed in electron volts (eV) from the NIOSH Pocket Guide To Chemical Hazards

are identified in these areas the ground above the utility lines are to be physically marked, such as, with spray paint or flags. Baker personnel are to notify the base representative at least three days prior to soil intrusive activities to acquire a utility clearance and at least two weekdays for ULOCO. A minimum of a 24 inch tolerance zone must be used for underground utilities.

The generally accepted uniform color code for underground utilities is as follows:

- Red - Electric power lines, cables, conduit and lighting cables
- Yellow - Gas, oil, steam, petroleum, or gaseous materials
- Orange - Communication, alarm or signal lines, cables or conduit
- Blue - Water, irrigation, and slurry lines
- Green - Sewers and drain lines
- White - Proposed excavation

Energized overhead electric lines may present a risk of electrocution. OSHA standards require that equipment maintain certain distances from power lines. For lines 0 to 50 kilovolts (kV), the minimum distance is 10 feet. Lines carrying over 50 kV require that equipment maintain 10 feet, plus an additional 0.4 inch for each 1 kV over 50.

#### 3.3.3.2 Heavy Equipment

One of the primary physical hazards on the site is associated with the use of heavy equipment. The heavy equipment includes the use of a drill rig.

General hazards associated with the drill rig include moving parts, such as, the auger and cathead. Personnel must remain clear of moving parts and must avoid loose fitting clothing that can become entangled in the moving parts. Personnel working near a drill rig must be aware of the location and operation of the emergency shut off devices. Personnel are to stand clear of the drill rig immediately prior to starting the engine.

Noise from the operation of the heavy equipment will limit verbal warning abilities. Hand signals will be prearranged between operators and personnel working in and around heavy equipment. Backup alarms must operate properly on the heavy equipment. Only operators trained, qualified, and authorized will be permitted to operate the heavy equipment.

The subcontracting drilling company's representative is to provide any other cautions that need to be observed when working around this equipment during the HASP briefing.

#### 3.3.3.3 Thermal Stress

Provisions for monitoring of heat stress and/or cold stress are outlined in Appendix A - Baker Safety SOPs.

#### 3.3.3.4 Explosion and Fire

In general, the following items present potential physical hazards and will be monitored closely:

- Explosion and fire resulting from:
  - ▶ Heavy equipment malfunction
  - ▶ Penetration into underground utility/service lines (gas, electric, fuel)
  - ▶ Ignition of trapped flammable vapors
  - ▶ Vehicular accidents

Provisions for monitoring for potential fire/explosive conditions will include the use of an oxygen/combustible gas meter (as indicated in Section 5.2) and the performance of utility checks prior to conducting intrusive activities. An ABC rated, minimum 20 lb. fire extinguisher will be maintained in the area. As additional concerns are identified, provisions for making changes to the HASP will be presented by the SHSO, as needed.

#### 3.3.3.6 Noise

Elevated noise levels are typically produced during drilling and other heavy equipment operations; therefore, hearing protection devices will be available.

#### 3.3.3.7 Confined Space Entry

Confined space entry is not anticipated for this project. A confined space entry procedure will be required if there is a potential for employees to fall into a "confined space," or where a rescue operation involving a confined space may occur, according to OSHA Standard 1910.146, Permit-Required Confined Spaces.

Before any operation is to be performed in a confined space, the PHSO must be contacted.

### **3.3.4 Radiation Hazards**

Although the potential for exposure to radiological wastes or radioisotopes at Site 35 are not anticipated, a radiation survey meter will be available for use during site activities (Section 5.2 identifies the monitoring criteria).

### **3.3.5 Environmental Hazards**

#### **Hazardous Flora**

Incidence of contact by individuals to poisonous/thorny plants is high; therefore, bare skin should be covered (i.e., long pants and shirt, steel toe boots, leather or cotton gloves, safety glasses, and head protection) as much as practical when working in forested areas. Personnel should avoid entering an area in the direct path of known poisonous flora (i.e., poison ivy/oak), a secondary route should be selected. Care should also be taken when walking in such areas as uneven terrain or vines may present a tripping hazard.

While attempting to cut into dense underbrush, hazards exist from the sharp machete, gas-powered weed cutter, etc. (Note: Hearing protection, steel toe boots, gloves, and safety glasses are required when using weed cutters). Care should be taken when using such devices. All rashes and other injuries will be reported to the SHSO as soon as they are known.

#### **Hazardous Fauna**

All animal life must be treated with respect. Without proper training, personnel may not be able to differentiate between dangerous and nondangerous varieties. Working in wet or swampy areas unprotected is not permitted. Contact with surface water will be kept to a minimum.

Mosquitoes and gnats pose a nuisance and physical hazard to field personnel; as a nuisance, they distract workers, leading to accidents. Perfumes and scented deodorants should be avoided. Donning light colored clothing is preferable, as mosquitoes are not attracted to lighter colors. The use of Avon's "Skin So Soft" is encouraged as an insect repellent.

There is a potential to come in contact with other dangerous insects. These include fire ants, chiggers, bees, wasps, hornets, mites, fleas, spiders, and ticks.\* All personnel should perform "checks" on each other periodically and at the end of the work shift. All insect bites must be reported to the SHSO.

Poisonous snakes such as the rattlesnake, copperhead, and cottonmouth (water moccasin), all known as pit vipers, are common to the United States. Snakes, as a general rule, typically do not attack people but will bite when provoked, angered, or accidentally injured (as when stepped on). When encountering a snake(s), avoid quick/jerky motions, loud noises, and retreat slowly; do not provoke the snake(s). If bitten, follow procedures outlined in Section 8.6, Emergency Medical Treatment.

\* *Site personnel have been provided with a copy of Baker's policy (per our medical consultant) regarding the signs and symptoms of exposure for Lyme Disease.*

## **4.0 SITE CONTROL**

The following subsections define measures and procedures for maintaining site control. Site control is an essential component in the implementation of the Site Health and Safety Program.

### **4.1 Site Access**

- The Site Manager is designated to coordinate overall access and security on site. Perimeters for activities to be conducted at Site 35 will be established according to the site boundary procedures identified in Section 4.3, local conditions, and Navy Activity requirements.
- Personnel will not be permitted within the Work Zone (Exclusion Zone) or Contamination Reduction Zone without proper authorization from the SHSO.
- All personnel arriving or departing the site will be documented in the field log.
- All activities on site must be cleared through the Site Manager and documented in the Field Log.

### **4.2 Site Conditions**

- The prevailing wind conditions are to be determined daily.
- An on-site Command Post will be established. This location will be in the Support Zone and oriented upwind from the Work Zone.

### **4.3 Work Zones**

Refer to Figure 4-1 for a general description of how the work zones will be arranged at the site. Exact location of the demarcated zones will be field determined during site mobilization.

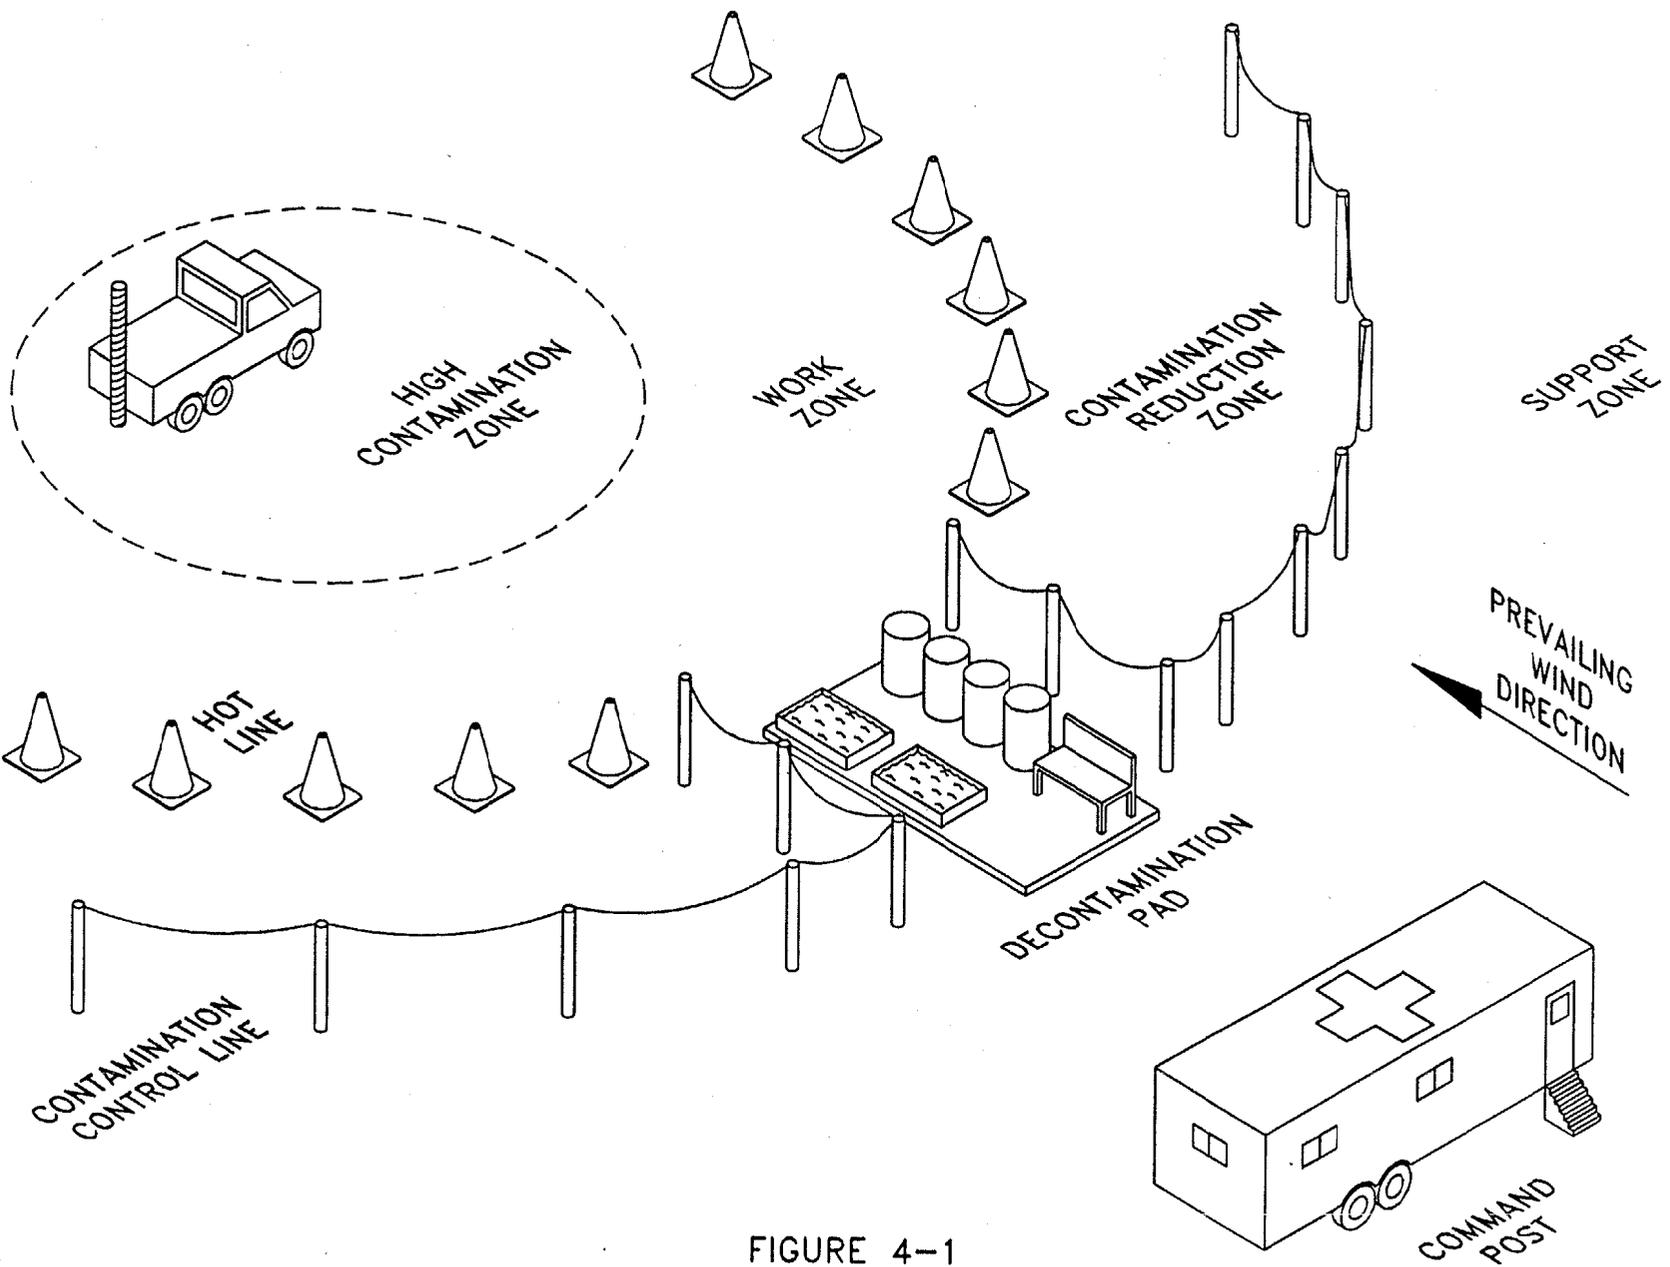


FIGURE 4-1  
 SCHEMATIC DIAGRAM  
 GENERAL CONTAMINATION  
 REDUCTION ZONE LAYOUT

## **Level C Activities**

Although Level C protection level is not anticipated, boundaries between the Work Zone, the Contamination Reduction Zone (CRZ), and the Support Zone (Clean Zone) will be established if protection levels upgrade to Level C . These boundaries will be defined as follows:

- Work Zone - A radius of at least 25 feet (barring obstruction) from site investigative activities.
- Hotline - The boundary between the Work Zone and CRZ.
- CRZ - The area between the Work Zone and the Support Zone (located upwind of the site investigative activities).
- Contamination Control Line - The boundary between the CRZ and the Support Zone.
- Support Zone - The outermost area next to the CRZ and upwind of the site investigative activities.

These boundaries will be demarcated using:

- Colored boundary tape, cones, or equivalent for the Hotline.
- Colored boundary tape, cones, or equivalent for the Decontamination Corridor of the CRZ.
- Colored boundary tape and barriers for the Contamination Control Line including posted signs and/or barricades indicating "Work Area"/"Authorized Personnel Only", or equivalent.

## **Level D and D+ Activities**

### **Populated Areas**

Work Zones for activities conducted under Level D or D+ protection levels will be established in such a manner as to preclude unauthorized personnel from entering the investigative area.

A boundary will be established around the Work Zone to separate it from the Clean Zone using available materials. Such materials may include the Baker Field Vehicle, natural boundaries (buildings, structures, fences), or signs/placards, boundary tape, cones, barricades, etc.

#### Unpopulated/Secluded Areas

In unpopulated or secluded areas, the aforementioned materials may not be used due to the exclusive nature of the site, the short duration of the activity, and the low risk to outside populations. The SHSO and/or Field Team Leader is responsible for making this determination.

#### **4.4 “Buddy System”**

All site activities that involve hazards and/or the potential for contact with hazardous materials will be performed by a work team of no fewer than two people (Buddy System). For potential “high-hazard” activities, a third person located in the Support Zone will serve as an observer or rescue person.

#### **4.5 Safe Work Practices**

Routine safe work practices may consist of:

- Setting up barriers to exclude unauthorized personnel from contaminated areas.
- Minimizing the number of personnel and equipment at the site (s).
- Establishing work zones within the site.
- Establishing control points with regular access to and egress from work zones.
- Conducting operations in a manner to reduce exposure of personnel and equipment.
- Implementing appropriate decontamination procedures.
- Conducting sampling activities from an upwind location.

##### **4.5.1 Heavy Equipment**

The following safe work practices will be adhered to during heavy equipment operations.

- Hard hats will be worn at when working in a work zone with heavy equipment.
- Heavy equipment requiring an operator will not be permitted to run unattended.

- Heavy equipment will not be operated in a manner that will endanger persons or property nor will the safe operating speeds or loads be exceeded.
- Heavy equipment will be shut down and positive means taken to prevent its operation while repairs or fueling are being performed.
- Personnel, other than the operator, should not ride on equipment.
- A "spotter" will be used to help direct the heavy equipment operator.
- Personnel are to remain in the field of vision of the operator and remain clear of moving parts.
- Hand signals will be prearranged between operator and personnel working around the heavy equipment.
- Backup alarms must operate properly on the heavy equipment.
- The heavy equipment subcontractor is responsible for safe operation of the equipment, proper safety equipment and to follow all required local, state and federal regulations for health and safety.

#### **4.5.2 Drilling Operations**

The following safe work practices will be adhered to during drilling operations.

- The subcontracting drilling company's supervisor is to provide other cautions to be observed when working around the drill rig during the HASP briefing.
- Hand signals will be prearranged between operator and personnel working around the drill rig.
- Personnel are to remain in the field of vision of the operator and remain clear of moving parts where protective clothing can be entangled, i.e., Tyvek caught in the auger.
- Utility clearances must be secured prior to digging (see Section 3.3.3.1).
- Personnel working near a drill rig are to be aware of the location and operation of the emergency shut off devices.
- The drill rig boom is to remain a minimum of 10 feet from power lines (see Section 3.3.3.1).
- The drilling subcontractor is responsible for safe operation of equipment, proper safety equipment and to follow all required local, state and federal regulations for health and safety.

#### **4.6 Sanitation/Site Precautions**

Provisions for sanitation procedures and site precautions to be followed on site can be found in Appendix A - Baker Safety SOPs.

## 5.0 ENVIRONMENTAL MONITORING

Air monitoring will be conducted at the personal breathing zones, point source, and around the site perimeter as necessary. Monitoring instrumentation to be available on site include a HNu Photo ionization detector (PID) with an 11.7 eV bulb, oxygen/combustible gas meter, and radiation survey meter.

### 5.1 Personal Monitoring

The following personal monitoring will be in effect on site:

Personal monitoring will be accomplished using real time environmental monitoring instrumentation directed at the breathing zone of work party personnel. Breathing Zone (BZ) monitoring will be performed each time a reading is taken at the point source. The guidelines below identify the protection levels required according to the concentration measured in the BZ.

#### PID<sup>(1)</sup>

- Background to 1 mu above background in the breathing, can remain in Level D
- >1 mu to 5 mu above background in the breathing zone for up to 5 continuous minutes = Level C or Stop Work and evaluate conditions with Dräger Tubes
- >5 mu for up to 5 continuous minutes in the breathing zone = Stop Work and Consult PHSO

(1) PID with 11.7 eV ultraviolet lamp.

Dräger Tubes<sup>(1)</sup> (used to determine if Level C or D+ protection levels are adequate for highly volatile constituents when a PID response meets the level identified above).

- Below limits of detection (BLD) to one-half of the TWA<sup>(2)</sup> = Level D
- One-half of the TWA or greater = Level C
- >5 times the TWA Stop Work and consult PHSO

(1) Dräger Tubes to be used include: Benzene (67 28561)

(2) Refer to Table 1, Section 3.0, for explanation.

## 5.2 Point Source Monitoring

Point source monitoring is defined by this HASP as monitoring performed at the source of the sampling/investigative activity. Instrumentation to be available will include a PID, oxygen/combustible gas meter, and radiation survey meter. The oxygen/combustible gas meter and radiation survey meter will be used at the discretion of the SHSO or Site Manager. The action levels for the oxygen/combustible gas meter and radiation meter are identified below.

### Oxygen/Combustible Gas Meter\*

#### Combustible Gas Meter

- <10% of the Lower Explosive Limit (LEL) = continue working
- >10% of the LEL\* = Stop Work immediately and consult SHSO

#### Oxygen Meter

- 19.5% to 22% = continue working
- <19.5% or >22% = Stop Work immediately and consult SHSO

\*Used to evaluate physical safety in conjunction with the PID and/or Dräger Tubes.

### Radiation Survey Meter - Ludlum Model 3-98 Survey Meter with Model 44-2 Gamma Scintillator Tube (external probe)

- Background = Continue work
- 2 times the background = Leave work area and consult PHSO

### GM Pancake Probe (internal probe)

- Background = Continue work
- >2 times the background = Leave work area and consult PHSO

As work progresses, the scope of monitoring may be extended based on monitoring results, odor detection, changing work conditions, and signs or symptoms of exposure. Any or all of these conditions will be immediately investigated and acted upon by the SHSO.

### 5.3 Perimeter Monitoring

Perimeter monitoring (defined as monitoring performed at borders beyond the Support Zone and often at the “fence line”) for each site will be performed as follows:

- The PID will be used periodically to scan the perimeter as a means of documenting any volatile releases that may extend past the work zone when volatile concentrations exceed 50 mu at the point source or 10 mu at the work area breathing zone.
- The Dräger Colorimetric Tubes will be used periodically to measure any potential releases when concentrations exceeding the TWA are detected at the breathing zone.
- The Radiation Survey Meter will be used to determine a safe distance from the source (i.e., when levels return to background), if a radiation level exceeding 2 times the background is established.

### 5.4 Equipment Maintenance and Calibration

Baker’s procedures for the return of equipment to inventory and for maintenance of the equipment will be followed in order to assure that the optimum level of operation is maintained for the item. Equipment calibration will be conducted according to the manufacturer’s recommendations and calibration information entered into the equipment calibration log sheet. The log sheets will be maintained on site for the duration of the project with copies to be given to the Equipment Manager once the equipment has been returned to the office. Procedures for equipment maintenance and calibration can be found in the operating manual provided by the manufacturer (included with each piece of equipment), or in Baker’s Standard Operating Procedures for Administrative, Field, and Technical Activities Manual.

### 5.5 Monitoring Documentation

As environmental monitoring is performed, documentation of the results will be entered into the Field Log Book of the SHSO or other personnel performing the monitoring. Documentation is to include the date, time, instrument results, general area of the site, and specific location, such as, point source, breathing zone, or area. The log sheets will be placed in

a binder and remain on site till the end of the field activities, whereby the log sheets will become part of the permanent file.

## 6.0 PERSONAL PROTECTIVE EQUIPMENT

### 6.1 Personal Protective Equipment Selection

The required personal protective equipment available for the various levels of protection, is listed below.

Item No.	Personal Protective Equipment
1	Chemical-Resistant Clothing (Polyethylene-coated Tyvek®)
2	Chemical-Resistant Clothing (Saranex®)
3	Uncoated Tyvek®/Kleenguard® Coveralls
4	Normal Work Clothes or Coveralls
5	Air-Line Respirator (ALR) with 5-minute escape pack
6	Self-Contained Breathing Apparatus (SCBA) for rescue
7	NIOSH 5-minute Escape Pack (on standby)
8	Full-face Cartridge Respirator
9	Half-face Cartridge Respirator
10	Full-face Cartridge Respirator (on standby)
11	Half-face Cartridge Respirator (on standby)
12	Chemical-Resistant Gloves (Nitrile inner)
13	Chemical-Resistant Gloves (Latex inner)
14	Chemical-Resistant Gloves (Rubber/Neoprene outer)
15	Chemical-Resistant Gloves (Nitrile outer)
16	Work Gloves (outer)
17	Chemical-Resistant Overboots (with steel toe and shank)
18	Chemical-Resistant Overboots (w/o steel toe)
19	Steel Toe Boots
20	Safety Glasses
21	Safety Goggles
22	Face Shield
23	Hard Hat
24	Hearing Protection <sup>(1)</sup>

(1) At the discretion of the SHSO.

**6.2 Site-Specific Levels of Protection**

Based on an evaluation of potential hazards the levels of protection and corresponding personal protective equipment have been designated for the following tasks. Upgrading or downgrading the level of protection will be based on real time monitoring and working conditions. Changes in level of protection will be the responsibility of the SHSO.

Note: No single combination of protective equipment and clothing is capable of protection against all hazards. PPE should be used in conjunction with safe work practices, decontamination, and good personal hygiene.

Site	Job Task	Level of Protection				Personal Protective Equipment (Item No.)
		C	D+	D	Other	
35	Sediment/Surface Water Sampling and Benthic Sampling		X			15, 19, 20
	Land Surveying			X		4
	Monitoring Well Installation			X		16, 19, 20, 23, 24 <sup>(1)</sup>
	Monitoring Well Development		X			15, 19, 20
	Groundwater Sampling		X			15, 19, 20
	Soil Boring - Sampling		X			15, 19, 20, 23, 24 <sup>(1)</sup>

**EXCEPT IN EMERGENCY SITUATIONS, CHANGES TO THE SPECIFIED LEVELS OF PROTECTION SHALL ONLY BE MADE WITH THE APPROVAL OF THE SITE HEALTH AND SAFETY OFFICER AND THE SITE MANAGER, IN CONSULTATION WITH THE PROJECT HEALTH AND SAFETY OFFICER AND PROJECT MANAGER.**

(1) At the discretion of the SHSO

**6.3 Respiratory Protection**

Site-specific respiratory protection requirements as outlined below will comply with the procedures in Appendix A - Baker Safety SOPs. The criteria for using these types of respiratory protection have been determined by qualified Baker personnel in compliance with OSHA Standard 29 CFR 1910.134.

## Level C

The "North" or "MSA" full-face/half-face NIOSH-certified negative pressure Air-Purifying Respirator (APR) with an organic vapor/acid gas/HEPA cartridge is the appropriate cartridge for use with the detected hazardous materials and the measured contaminant concentrations. Upgrades/downgrades in this level of respiratory protection will be based on measured "realtime" air contaminant concentrations (see Section 5.2) and the SHSO's observations.

Cartridge changeover will occur when one or more of the following have been observed: exposure duration greater than eight hours for vapor/gas cartridges; breathing resistance; a noticeable odor or taste; eye/throat irritation; and other indicators such as end-of-service life indicators for specialty filter cartridges.

### **6.4 Care and Cleaning of Personnel Protective Equipment**

Provisions for the care and cleaning of personal protective equipment used on site can be found in Appendix A - Baker Safety SOPs. Responsibility for compliance with these provisions lies with the Site Manager and/or Field Team Leader.

## 7.0 DECONTAMINATION PROCEDURES

### 7.1 Personnel Decontamination

Personnel leaving the Work Zone will be thoroughly decontaminated. The following protocol will be used for the decontamination stations according to levels of protection:

Level D	Level D+	Level C
1. Equipment drop	1. Equipment drop	1. Equipment drop
2. Boot and glove gross contamination removal*	2. Outer boot and glove wash	2. Outer boot and glove wash
3. Boot and glove wash*	3. Outer boot and glove rinse	3. Outer boot and glove rinse
4. Boot and glove rinse*	4. Tape Removal	4. Tape Removal
5. Tape Removal*	5. Outer boot and glove removal	5. Outer boot and glove removal
6. Boot removal*	6. Coverall removal/disposal	6. Coverall removal/disposal
7. Glove removal*	7. Inner glove removal/disposal	7. Respirator removal
8. Hand/Face wash	8. Hand/face wash	8. Inner glove removal/disposal
9. Equipment wipe down	9. Equipment cleaning	9. Hand/face wash
		10. Respirator cleaning/sanitizing
		11. Equipment cleaning

\*Optional - depends on degree of contamination and type of PPE used.

The following decontamination equipment is required for Level C protection levels and recommended for Level D+ protection:

- Four small tubs (two sets of wash and rinse water)
- Scrub brush
- Towels\*
- Disposable wipes\*
- Pressurized sprayers for rinsing
- Contaminated clothing disposal bag or drum\*
- Contaminated liquids disposal drum
- Respirator cleaning solution
- Liquinox and water as the decontamination solution

\*Minimum for Level D decontamination.

The decontamination liquids and clothing will be contained and disposed according to policy defined in the Sampling and Analysis Plan (SAP).

## **7.2 Equipment Decontamination**

Pressure steam cleaning of the drill rig augers will be conducted by the subcontractor. A portable steam cleaning unit will be used for this cleaning. Decontamination will be conducted at specific locations established at each site.

## **7.3 Waste Handling Procedures**

The protocols outlined in the SAP for the handling, packaging, storing, and disposing of contaminated materials must be followed to: (1) minimize the risk of off-site exposures that could endanger public health; and (2) limit the potential for liabilities associated with handling, containment, storage, and transportation of contaminated materials. These protocols comply with Baker's SOP on "Handling of Site Investigation Generated Wastes," located in the Standard Operating Procedures for Administrative, Field, and Technical Activities Manual.

## **8.0 EMERGENCY PROCEDURES**

### **8.1 Pre-Emergency Planning**

All applicable Navy/local emergency response contacts (On-Scene Coordinator, Fire Department, Security, Ambulance, Hospital, etc.) at MCB Camp Lejeune will be contacted during site mobilization activities. This notification will be performed by the SHSO and/or Site Manager. The information discussed may include:

- A description of site activities.
- Anticipated site hazards.
- Hazardous chemicals to be used on site.
- Expected length of time on site.
- Specific requirements the emergency response facilities may require.
- Confirmation of emergency phone numbers.

Specific points of contact, where applicable, will be established and added to the HASP. If requested, Material Safety Data Sheets will be provided at this time.

### **8.2 Emergency Coordinator**

The SHSO acting as the Emergency Coordinator is responsible for field implementation of the Emergency Plan. As the Emergency Coordinator, specific duties include:

- Familiarizing all on-site personnel with the emergency procedures and the emergency coordinator's authority.
- Identifying the nearest telephone in the event of an emergency.
- Communicating site emergency procedures and requirements to all Baker and subcontractor personnel.
- Specifying a backup/alternate Emergency Coordinator.
- Controlling activities of subcontractors and contacting the Navy On-Scene Coordinator and other response groups.

- Anticipating, identifying, assessing, and controlling fires, explosions, chemical releases, and other emergency situations to the best of his/her abilities.
- Familiarity with site personnel trained in emergency first aid and CPR.

All on-site personnel, whether involved in emergency response or not, will be notified of their responsibilities by the Emergency Coordinator in an emergency. They will be familiar with the emergency procedures and the Emergency Coordinator's authority.

**8.3 Communications**

Internal communications will rely on direct communication (via verbal or two-way radios) between site personnel. External communications will employ a telephone located in the field trailer and various telephones located throughout the investigation areas.

The "Buddy System" will be in effect at all times; any failure of communication requires an evaluation of whether personnel should discontinue activities.

**Air horns will be used for communication during emergency evacuation of site personnel. One long (3 second) air horn blast is the emergency signal to indicate that all personnel should evacuate the Work Zone.**

Hand signals will be used in case of failure of radio communications or when radio communications are not available:

- |   |   |
|---|---|
| Hand gripping throat .....                          | - Can't breathe<br>(typically Level C/B activities) |
| Grip partner's wrist or both hands around waist ... | - Leave area immediately                            |
| Hands on top of head .....                          | - Need assistance                                   |
| Thumbs up .....                                     | - OK, I am all right, I understand                  |
| Thumbs down .....                                   | - No, I do not understand                           |

Emergency telephone numbers will be placed at strategic locations throughout the site. The list of emergency phone numbers is presented below.

Facility	Phone Number	Contact
Security (Police)	911 or (910) 451-4555	Response Operator
Fire	911	Response Operator
Ambulance (On-Base)	911	Response Operator
Ambulance (Off-Base)	(919) 455-9119	Response Operator
Hospital Emergency Room (On-Base)	911 or (910) 451-4840 (910) 451-4841 (910) 451-4842	Response Operator
Onslow County Hospital (Off-Base)	(910) 577-2240	Response Operator
ULOCO	1-800-632-4949	Response Operator
Hazardous Waste Dispatcher	911	Response Operator
On-Scene Coordinator	911	Fire Chief
Public Works Department (Underground Utilities via EMD Contact)	(910) 451-5874	Mr. Neal Paul
Poison Control Center	1-800-672-1697	Response Operator
National Response Center	1-800-424-8802	Response Operator
CHEMTREC	1-800-424-9300	Response Operator
EMD	(910) 451-5063	Mr. Neal Paul Mr. Tom Morris Mr. Walter Haven
Agency for Toxic Substances and Disease Registry	1-404-639-0615	Response Operator

#### 8.4 Assembly Area

Personnel will be instructed before the start of operations the designated meeting point in the event of an emergency. At this location, emergency needs will be provided, such as:

- Assembly for evacuated personnel
- First aid for injured personnel
- Decontamination material
- Communications.

## **8.5 Emergency Hospital Route**

An emergency hospital route map showing the location of the local hospital, will be posted at strategic locations throughout the site. Personnel will be informed of the location of the map and the directions to the hospital.

Directions to the Onslow County Memorial hospital (317 Western Boulevard) (Refer to Figure 8-1):

1. Take Ocean Highway 17 north to Highway 24 (Lejeune Boulevard).
2. Travel east on Highway 24 to Western Boulevard and turn left.
3. Continue on Western Boulevard to the fifth stop light and hospital will be on the left.
4. Follow directions to the emergency room entrance.

## **8.6 Emergency Medical Treatment**

### **Emergency Services**

The nearest public hospital is Onslow County Memorial Hospital located at 317 Western Boulevard, Jacksonville, NC, phone No.: (99) 577-2240 (on base) and (919) 577-2240 or 911 (off base).


Local ambulance service is available from the Naval Ambulance Service at 911 and the City of Jacksonville at (919) 455-9119. Contact should be made with emergency personnel prior to the start of activities (See Section 8.1).

There will be a minimum of 2 persons on each site that will be trained in emergency first aid and CPR. A copy of Baker's Bloodborne Pathogen Program will be available in the site trailer.

### **Physical Injury**

If an employee working in a contaminated area is physically injured, first aid procedures are to be followed. Depending on the severity of the injury, emergency medical response from

8-5

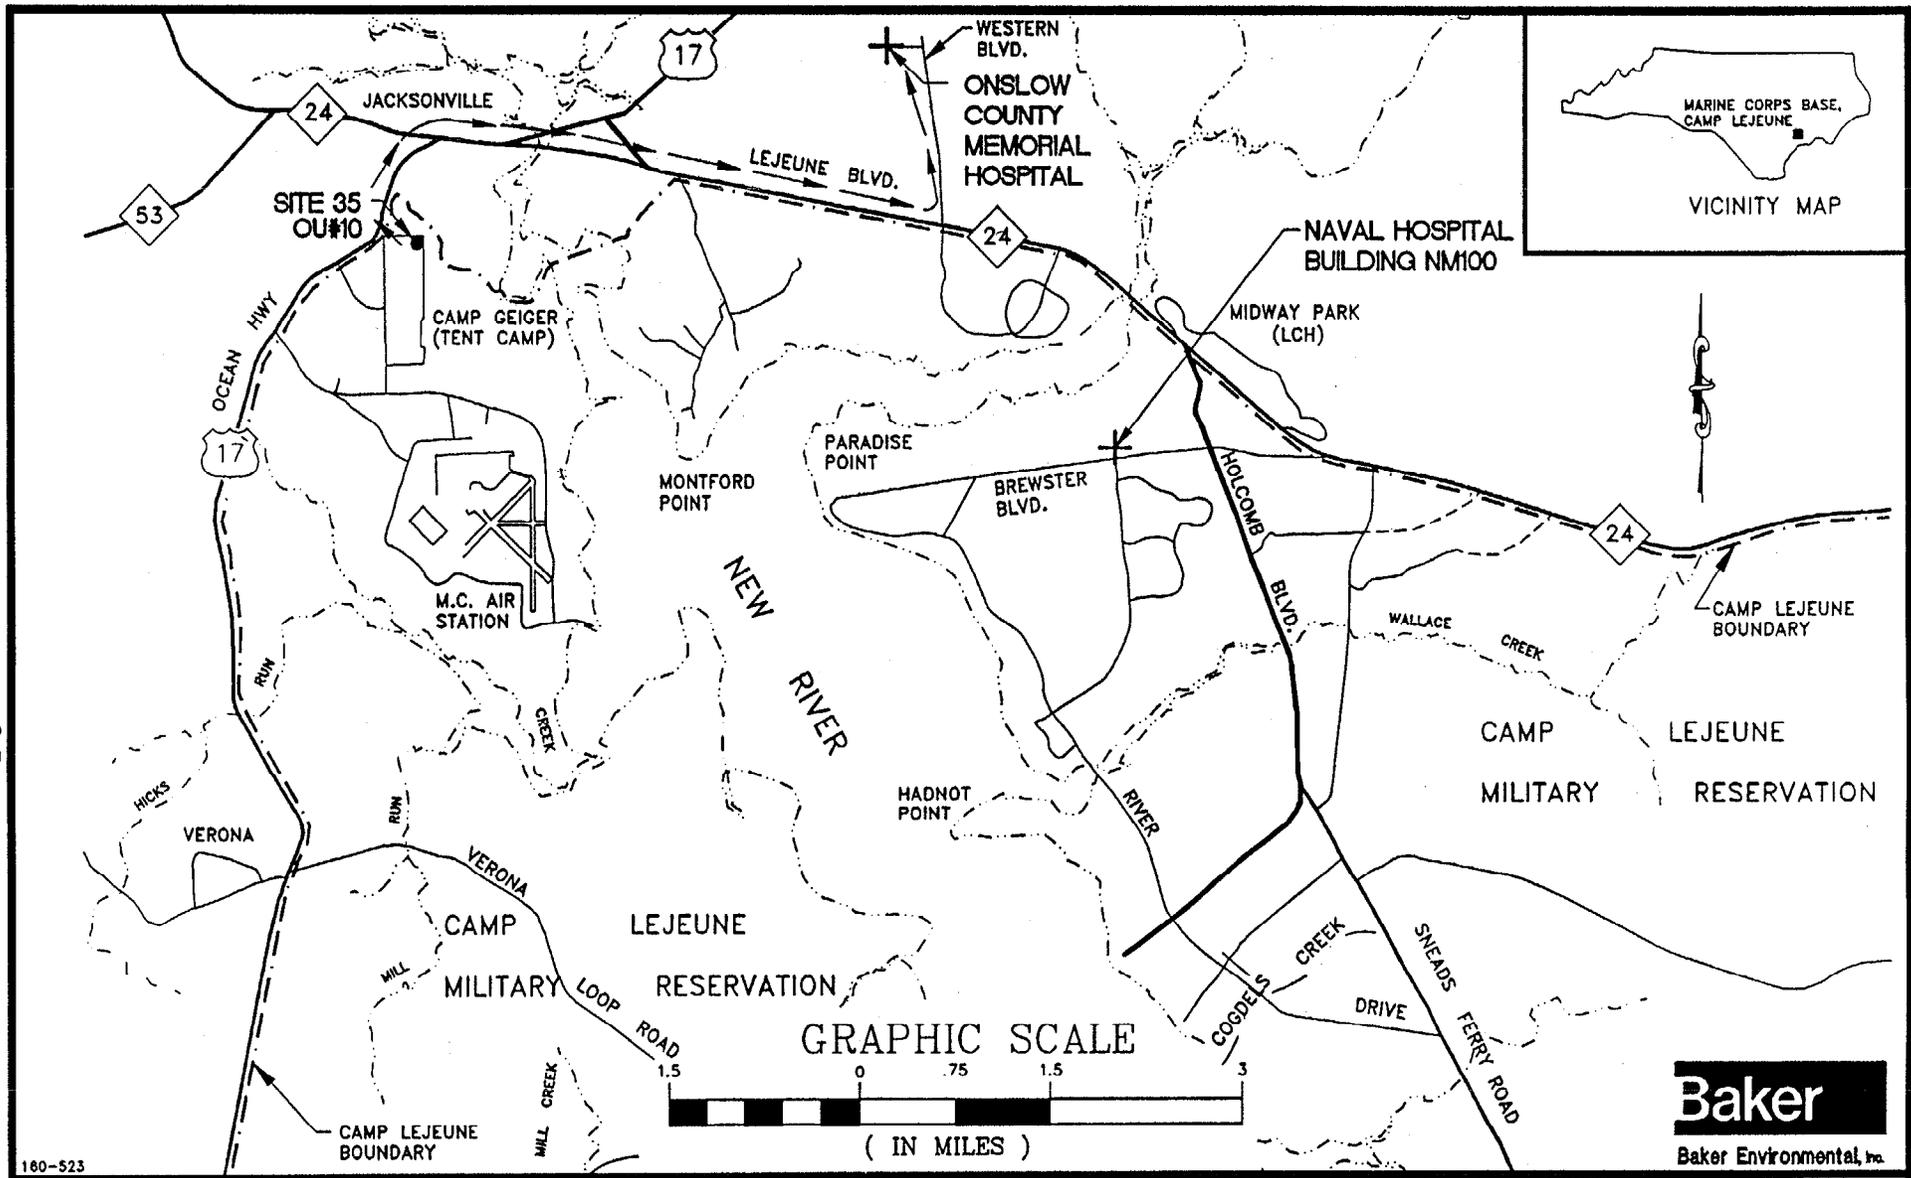

180-523

FIGURE 8-1  
 EMERGENCY HOSPITAL ROUTE  
 SITE 35  
 MARINE CORPS BASE, CAMP LEJEUNE  
 NORTH CAROLINA

Naval personnel may be sought to stabilize victim for transport to public hospitals. If the employee can be moved, he/she will be taken to the edge of the work area and decontaminated, if necessary (refer to Section 8.7). Then, if circumstances permit, administered emergency first aid, and transported to an awaiting ambulance or to a local emergency medical facility.

### **Chemical Injury**

If the injury to a worker is chemical in nature (e.g., direct contact/exposure), the following first aid procedures are to be instituted:

- **Eye Exposure** - If contaminated solid or liquid gets into the eyes, wash the eyes immediately at the emergency eyewash station using large amounts of water and lifting the lower and upper lids occasionally. Obtain medical attention immediately. Contact lenses will not be worn when working.
- **Skin Exposure** - If contaminated solid or liquid gets on the skin, promptly wash the contaminated skin using soap or mild detergent and water. If solids or liquids penetrate through the clothing, remove the clothing immediately and wash the skin using soap or mild detergent and water. Obtain medical attention immediately.
- **Swallowing** - If contaminated solid or liquid has been swallowed immediately contact the Poison Control Center at the Duke University Medical Center, Durham, NC at 1-800-672-1697. Do not make an unconscious person vomit.
- **Breathing** - If a person has difficulty breathing, move the exposed person to fresh air at once. If breathing has stopped, perform artificial respiration. Keep the affected person warm and at rest. Obtain medical attention as soon as possible.

The emergency procedures that are to be followed in the event of a site person or persons being exposed to hazardous materials are contained in Appendix C.

### **Snakebite Injury**

In the event of a snakebite injury, the following procedures will be followed.

Look for signs and symptoms such as the characteristic appearance of two small holes, usually about a half inch apart, with surrounding discoloration, swelling, and pain. Systematic signs (which may or may not occur) including weakness, sweating, faintness, and signs of shock.

Provide treatment as follows:

1. Calm the victim and keep affected area still.
2. Contact ambulance if victim needs transportation to the nearest hospital.
3. Wash the wound.
4. Keep the affected area below the level of the heart if bite is on the arm or leg.
5. Treat for shock.
6. Monitor airway, breathing, and circulation.
7. Obtain physical description of snake, if possible.
8. Transport victim to the nearest medical facility.
9. Provide the emergency medical responder (either the ambulance attendant or the emergency room at the hospital) with all pertinent information such as: how long ago the bite occurred, the type of snake (if known), any known allergic conditions (if known), etc.

Inform the SHSO immediately if a snakebite has occurred. The SHSO will in turn, inform the PHSO, as soon as possible.

If injuries are not serious or life threatening, affected personnel may be transported by other site personnel to the local medical facility, if necessary. Emergency medical response personnel will be contacted in the event of serious or multiple injuries. Medical personnel will be provided with all available information regarding the nature of the incident, chemicals involved, etc.

## **Spider Bite Injury**

There are two spiders commonly found in the United States whose bite can be serious: the black widow spider and the brown recluse spider. These bites may be serious, even life-threatening. Many other spiders will bite, but they do not produce serious complications. The black widow spider measures approximately 1 inch long with its legs extended. It is glossy black in color and has a distinctive yellow-orange marking in the shape of an hourglass on its belly. On its back, however, there is no marking, and unless you happen to turn the spider over, you cannot see this mark. The danger of the black widow spider bite lies in its systemic manifestations. The venom from this spider attacks the nervous system, resulting in severe muscle cramps with boardlike rigidity of the abdominal muscles, tightness in the chest, and difficulty in breathing. Sweating, nausea, and vomiting will also occur.

The emergency treatment for the black widow spider bite is basic life support. sometimes the individual is not even aware of having been bitten, or where. Apply cold to the site of the bite if it can be identified. There is a specific antivenin for this spider bite that must be administered by a physician. It is particularly important to identify the spider, and bring it in, if you can.

The brown recluse spider is a little bit smaller than the black widow spider and is dull brown in color. It has a violin-shaped mark on its back, which can be seen when you are looking at the spider from above. The spider gets its name because it tends to live in dark areas, corners, and old unused buildings. The bite from this animal produces local rather than systemic manifestations. The venom of the brown recluse spider causes severe local tissue damage and can lead to an ulcer and gangrene. The bitten area becomes red, swollen, and tender within a few hours after the bite. A small blister forms, and several days later, this may form a large scab, covering a deep ulcer. Death is rarely reported, but these bites need local surgical treatment, and these patients should be brought to the hospital. Again, if possible, identification of the spider should be carried out.

## **Decontamination**

If on-site decontamination of injured employee(s) is not possible, the Emergency Coordinator will provide polyethylene sheeting (or equivalent) for a stretcher, and ambulance. If necessary, a site employee equipped with appropriate protective equipment and clothing will

accompany the injured employee and will perform decontamination under the supervision of emergency medical personnel.

Instances requiring treatment beyond "first aid" will be handled at appropriate facilities and reported to the Project Manager and PHSO within 24 hours.

### 8.7 Emergency Decontamination Procedures

In the event of a medical emergency, patients are to be adequately decontaminated before transfer, if possible. This is to prevent contamination of the medical transport vehicle and medical facility. Emergency personnel decontamination will include the following, depending on the level of protection.\*

Level D	Level D+	Level C
<ul style="list-style-type: none"> <li>● Equipment drop</li> <li>● Tape, boot, and glove removal</li> <li>● Coverall removal</li> </ul>	<ul style="list-style-type: none"> <li>● Equipment drop</li> <li>● Tape, outer boot, and glove removal</li> <li>● Coverall removal/ disposal</li> <li>● Inner glove removal/ disposal</li> </ul>	<ul style="list-style-type: none"> <li>● Equipment drop</li> <li>● Tape, outer boot, and glove removal</li> <li>● Coverall removal/ disposal</li> <li>● Respirator removal</li> <li>● Inner glove removal/ disposal</li> </ul>

\* If circumstances dictate that contaminated clothing cannot be readily removed, then remove gross contamination and wrap injured personnel with clean garments/blankets, to avoid contaminating other personnel or transporting equipment.

All emergency personnel are to be immediately informed of the injured person's condition and potential contaminants and provided with all pertinent chemical data.

If necessary, one of the site personnel equipped with appropriate PPE may accompany the injured worker and perform decontamination with supervision of medical personnel.

### 8.8 Personal Protection and First Aid Equipment

PPE available for emergency response will include the following:

- Polyvinyl chloride boots
- Saranex® suits
- Tyvek® suits, polyethylene coated and uncoated

- Nitrile gloves (inner and outer)
- Neoprene and Nitrile Gloves (outer)
- Face shields and goggles
- SCBA

PPE, first aid equipment and the first aid kits will be available in the support zone (i.e., Baker Field Vehicle or Baker Site Trailer).

Emergency and first aid equipment can be found at the following locations:

Fire Extinguisher:	<u>Baker Site Trailer and Contractor Field Vehicle</u>
First aid kit:	<u>Baker Site Trailer and Baker Field Vehicle</u>
Emergency eye wash bottle:	<u>Baker Site Trailer and Baker Field Vehicle</u>
Air Horn:	<u>With Personnel</u>
Portable Emergency Eye Wash Station:	<u>Near Area With Greatest Potential for Chemical Splash/Exposure</u>

### 8.9 Notification

If the Emergency Coordinator determines that the site has an uncontrolled situation, such as a spill, fire, or explosion, that could threaten human health or the environment, he/she will report their findings to the Fire Chief (Navy On-Scene Coordinator) and the Base Representative. The notification report will be made from the nearest safe location and will include:

- Description of incident (e.g., release, fire).
- Name and telephone number of individual reporting the emergency..
- Location of incident.
- Name and quantity of material (s) involved.
- The extent of injuries, and number of casualties.
- The possible hazards to human health or the environment and cleanup procedures.
- Assistance that is requested.

## 8.10 Hazard Assessment

The Emergency Coordinator will assess possible hazards to human health or the environment that may result from a chemical release, fire, explosion, or severe weather conditions to the best of his/her abilities, incorporating the following steps, as appropriate.

- Assess the immediate need to protect human health and safety.
- Identify the materials involved in the incident.
- Identify exposure and/or release pathways and the quantities of materials involved.
- Determine the potential effects of the exposure/release and appropriate safety precautions.
- Determine if release of materials meets EPA requirements for reportable quantities for spills under the RCRA or the Comprehensive Environmental Response, Compensation, and Liability Act (CERCLA).
- Inform appropriate personnel as identified in Section 8.9.

This assessment will consider both the direct and indirect effects of the chemical release, fire, explosion, or severe weather conditions (e.g., the effects of any toxic, irritating, or asphyxiating gases that are generated or the effects of any hazardous surface water runoff from water or chemical agents used to control fire and heat-induced explosions).

## 8.11 Security

During activation of the Emergency Plan, the Emergency Coordinator or his/her designated representative will control access to the site and maintain an incident log until the Navy On-Scene Coordinator arrives. The incident log will include:

- Time of entry.
- Expected exit time.
- Use of team or "buddy" system.
- Task being performed.

- Location of task.
- Rescue and response equipment used.
- Protective equipment being used.

#### **8.12 Emergency Alerting**

##### **Personnel Injury in the Work Zone:**

- Initiate a verbal warning or one long airhorn blast and move all site personnel to the decontamination control line (for Level D/D+) or the CRZ (for Level C).
- Send the rescue team into the Work Zone (if required) to remove the injured person to the hotline.
- Have the SHSO and/or Site Manager evaluate the nature of the injury, and assure that the affected person is decontaminated according to Section 8.7.
- If required, contact an ambulance and/or the designated medical facility.

No persons shall reenter the Work Zone until an accident investigation is performed by the SHSO and/or the Site Manager.

##### **Personnel Injury in the Support Zone:**

- The Site Manager and SHSO will assess the nature of the injury; if the cause of the injury or loss of the injured person does not affect the performance of other site personnel, operations may continue.
- If the injury increases the risk to others, a verbal warning or one long airhorn blast shall be sounded and all remaining site personnel will move to the support zone for further instructions.
- Activities on site will stop until the added risk is mitigated.

### **Fire/Explosion:**

- Initiate a verbal warning or one long airhorn blast and move all site personnel to the contamination control line (for Level D/D+) or the CRZ (for Level C).
- Alert the fire and security departments and move all personnel to a safe distance from the involved area for further instructions.
- Activities will stop until the added risk is mitigated.

### **Personal Protective Equipment Failure:**

- If any site worker experiences difficulty, failure or alteration of protective equipment that affects the protection factor, that person and his/her buddy shall immediately cease work activities, leave the Work Zone, and repair or replace the defective equipment.
- Reentry will not be permitted until the equipment has been repaired or replaced.

### **Other Equipment Failure:**

- If any other equipment on site fails to operate properly, the Field Team Leader shall notify the Site Manager and SHSO to determine the effect of this failure on continuing operations on site.
- If the failure affects the safety of site personnel, work with the equipment will cease until the situation is evaluated and appropriate actions taken.

In all situations, when an on-site emergency results in evacuation of the Work Zone, personnel shall not reenter until:

1. The conditions resulting in the emergency have been corrected.
2. The hazards have been reassessed.
3. The HASP has been reviewed and, if appropriate, modified.
4. Site personnel have been briefed on any changes in the HASP.

### 8.13 Training

Site personnel will be informed of the details in the Emergency Plan during initial HASP training. The Emergency Plan will be reviewed/rehearsed by site personnel at least monthly or when elements of the plan change.

### 8.14 Spill Containment Procedures

In the event that a spill of hazardous substances (gasoline, oil, etc.) occurs during the implementation of field activities, spill containment will be utilized to prevent the additional migration of contaminants through the site area. In the event of a spill, measures will be taken to contain the spill and clean it up. For the purpose of this HASP, a spill is defined as a release of a hazardous substance to soils or surface waters. Any release to soils or surface waters equaling or exceeding the reportable quantities under the Comprehensive Environmental Response, Compensation, and Liability Act (CERCLA) (40 CFR 304) or the EPA Clean Water Act (40 CFR 116 and 177) will be reported to the Environmental Management Department who in turn will report it to the appropriate agency within 24 hours.

Specific spill containment procedures will be dependent on the type of materials spilled and the type of environment affected. Potential spill containment procedures may include diking with absorbent material/pads, then removal or containment of the contaminated materials. Spill containment materials will be located within close proximity to the storage area of the hazardous substances in a manner such that the pathway remains accessible and free of obstructions. Spill containment materials available on site will include:

- Absorbent pads
- Vermiculite
- Sheets of polyethylene
- Shovel

## 9.0 TRAINING REQUIREMENTS

### 9.1 General

All Baker employees or other personnel entering the site will need to have received training in compliance with the Occupational Safety and Health Administration (OSHA) Standard 29CFR 1910.120. Baker employees engaged in field activities which potentially expose workers to hazardous substances receive a minimum of 40 hours of instruction off site, and a minimum of three days actual field experience under the direct supervision of a trained, experienced supervisor. These are generally 5-day (40-hour) courses. Key points of the 40-hour training include field demonstrations, respiratory fit testing and training, risk assessment, toxicology, chemical reactivity, use of monitoring equipment, downrange work procedures, site safety procedures, levels of protection, protective clothing, decontamination, and practical field exercises (which include donning, doffing, and working in personal protective ensembles for personal protection Levels A, B, and C).

In addition to the initial 40-hour training program, Baker requires site employees to receive an annual 8-hour refresher training course on the items specified by the 1910.120 standard. The general purpose of the 8-hour refresher is to ensure that personnel retain the knowledge necessary to be adequately protected, and stay current with proper site health and safety procedures.

Baker also requires that personnel involved with on-site employee supervision receive (in addition to 40 hours initial training and three days of supervised field experience) at least eight additional hours of specialized training at the time of job assignment. Training topics include, but are not limited to, the employer's safety and health program and the associated employee training program, personal protective equipment program, spill containment program, and health hazard monitoring procedures and techniques. The 8-hour supervisory training is required to ensure that supervisors have the knowledge necessary to understand and use the various Health and Safety Programs and to implement the elements of the HASP.

## 9.2 Site-Specific Training

Site-specific training, as discussed in Section 1.3, will consist of an initial health and safety briefing on the following information:

- Names of individuals responsible for site health and safety and methods of communicating safety and health concerns.
- Site-specific health and safety hazards.
- Use of PPE.
- Work practices by which employees can minimize risk.
- Safe use of equipment on site.
- Recognition of symptoms and signs of exposure to hazardous materials.
- Site control measures.
- Decontamination procedures.
- Emergency response procedures.

The SHSO will conduct the initial site-specific training prior to the initiation of field activities.

## 10.0 MEDICAL SURVEILLANCE REQUIREMENTS

This Site-Specific HASP will require that project personnel, who may be exposed to materials having potentially adverse and deleterious health effects, have obtained medical clearance from Baker's Board Certified Occupational Health Physician in accordance with 29 CFR 1910.120(f) prior to entry onto the site. Baker's corporate medical surveillance program establishes a medical baseline and monitors for symptoms of overexposure for individuals who participate in Preliminary Assessments, Site Inspections, Remedial Investigations, Feasibility Studies, and construction-phase services at sites covered by the Department of Labor, Occupational Safety and Health Administration (OSHA), Hazardous Waste Operations and Emergency Response Standard, 29 CFR 1910.120. Additionally, the program is intended to determine the individual's capability for performing on-site work, including wearing respiratory protective equipment.

All Baker employees that will be engaged in site activities covered by the 1910.120 standard receive a Group III physical examination by a licensed physician who is provided information on the individuals site activities, and exposure or anticipated exposure levels. This exam is received initially, then once every 12 months thereafter. More frequent medical examinations, consultations, and/or laboratory testing will be provided if the examining physician determines that an increased frequency of examination is required. A complete Group III medical exam includes parameters such as height, weight, vision, temperature, blood pressure, and a complete review of occupational and medical histories. Other tests in a Group III exam include chest x-rays, electrocardiogram, pulmonary function test, urinalysis, and blood tests. Table 10-1 describes the medical surveillance testing parameters performed annually on Baker employees.

Prior to entry onto the site, all personnel, including subcontractors, will be required to provide medical clearance information from their company physician stating that they are physically capable of performing the activities required.

TABLE 10-1

MEDICAL SURVEILLANCE TESTING PARAMETERS\*

Group II - Individuals Occasionally in the Field (10-30 days/year)

- Medical History (Physical Exam)
- Eye Exam
- EKG (baseline and for individuals over 40 years of age)
- Chest X-ray (baseline then every 5 years)
- Spirometry
- CBC with differential
- SMA 12 or 26 (liver enzyme scan)

Group III - Individuals Frequently in the Field (>30 days/year)

- Medical History (Physical Exam)
- Eye Exam
- EKG (baseline then annually for individuals over 40 years of age)
- Audiometry
- Chest X-ray (baseline then every 3 years)
- Spirometry
- CBC with differential
- SMA 12 or 26 (liver enzyme scan)
- Urinalysis (glucose scan)
- Specific Blood and Urine Tests (dependent on field exposure)\*\*

Group III with Asbestos - Individuals frequently in the field whom also work with asbestos

- Group III testing with the Asbestos Medical Questionnaire w/Pulmonary Function Test (FVC<sub>1.0</sub> and FEV<sub>1.0</sub>)

\* The attending physician has the right to reduce or expand the medical monitoring on an annual basis as he/she deems necessary.

\*\* To be performed for individuals identified by the attending physician as being chronically exposed to organic compounds.

**11.0 HEALTH AND SAFETY PLAN APPROVAL**

This HASP has been reviewed by the following personnel for approval of activities at Site 35.

Ronald Krivan, CSP

Name (print)

PHSO

Title (print)

Joseph E. Rozum for Ron Krivan  
Signature

Daniel L. Bonk, P.E.

Name (print)

Project Manager

Title (print)

Daniel L. Bonk  
Signature

Joseph E. Rozum

Name (print)

QA/QC

Title (print)

Joseph E. Rozum  
Signature

**12.0 DECLARATION OF HASP REVIEW**

All site personnel indicated below, have reviewed and are familiar with this Health and Safety Plan for Site 35 at MCB Camp Lejeune, North Carolina.

1.	_____	_____
	(Name-Print)	(Company)
	_____	_____
	(Name-Sign)	(Date)
2.	_____	_____
	(Name-Print)	(Company)
	_____	_____
	(Name-Sign)	(Date)
3.	_____	_____
	(Name-Print)	(Company)
	_____	_____
	(Name-Sign)	(Date)
4.	_____	_____
	(Name-Print)	(Company)
	_____	_____
	(Name-Sign)	(Date)
5.	_____	_____
	(Name-Print)	(Company)
	_____	_____
	(Name-Sign)	(Date)
6.	_____	_____
	(Name-Print)	(Company)
	_____	_____
	(Name-Sign)	(Date)

**Appendix A**  
**Baker Environmental, Inc.**  
**Safety Standard Operating Procedures**

---

---

**APPENDIX A**

**BAKER ENVIRONMENTAL, INC.  
SAFETY STANDARD OPERATING PROCEDURES**

**TABLE OF CONTENTS**

- 1.0 Confined Space Entry Program\***
- 2.0 Respiratory Protection Program**
- 3.0 Care and Cleaning of Personal Protective Equipment**
- 4.0 Sanitation/Site Precautions**
- 5.0 Heat Stress**
- 6.0 Cold Stress**
- 7.0 Safe Boat Operations**

**\*Not Applicable/Not Included**

The Baker logo consists of the word "Baker" in a bold, white, sans-serif font, centered within a solid black rectangular box.The Baker Environmental, Inc. logo consists of the text "Baker Environmental, Inc." in a smaller, white, sans-serif font, centered within a solid black rectangular box that is positioned directly below the "Baker" logo box.

## **2.0 - RESPIRATORY PROTECTION PROGRAM**

### **2.1 INTRODUCTION**

In accordance with OSHA requirements (29 CFR 1910.134), this document represents Baker Environmental, Inc.'s (Baker's) program governing the selection and use of respiratory protection for its employees. It is Baker's policy to provide its employees with the proper protective equipment, training, and medical surveillance necessary to protect individuals from any potential hazards which may be present during the tasks performed throughout the course of each individual's employment. This program specifically describes the procedures which have been established and implemented for the use of respiratory protection equipment. The effectiveness of this program shall be reevaluated on an annual basis and appropriate changes shall be made if deemed necessary.

### **2.2 EMPLOYER RESPONSIBILITY**

Baker shall provide its employees the respiratory protection equipment which is appropriate and suitable for the purpose intended, when such equipment is necessary to protect the health of the employee.

### **2.3 EMPLOYEE RESPONSIBILITY**

The employee shall use the respiratory protection provided in accordance with instructions and training received, and shall report any malfunction of the equipment to a responsible person. The employee shall not wear contact lenses in atmospheres where respiratory protection is required. Corrective lens inserts will be provided, at Baker's expense, for employees who require corrective lenses.

### **2.4 HAZARD ASSESSMENT**

The key elements of a respiratory protection program must start with an assessment of the inhalation and ingestion hazards present in the work area. Because Baker's services involve a variety of environmental and industrial hygiene studies, it is not practical to identify all

possible hazards to which all employees could be exposed within the scope of this document. Therefore, it is essential that a task specific assessment be conducted prior to the initiation of any activities on a given project. This task specific assessment may be part of the site-specific Health and Safety Plan.

After a task-specific assessment is completed and it is determined that airborne exposure concentrations exceed or may exceed the recommended limits, engineering and administrative controls should be implemented, whenever feasible.

If the exposure cannot be reduced, or it is not feasible to reduce the airborne exposure below the recommended limits, respirators will be selected by the Site Health and Safety Officer on the basis of:

- Toxicity
- Maximum Expected Concentration
- Oxygen Levels
- Warning properties of the substance(s) involved
- Sorbent Limitations
- Facepiece Fit
- Mobility Requirements
- Type of Use (routine, escape, or emergency entry)
- Possibility of Ingestion of Toxic Materials
- Respirator Attributes

## 2.5 TRAINING

Each respirator wearer shall be given training, by a qualified individual, which will include explanations and discussions of:

- Opportunity to wear respiratory protection in an uncontaminated environment.
- Respirator Fit Testing (qualitative)
- The respiratory hazard(s) and what may occur if the respirator is not used properly.
- The reasons for selecting a particular type of respirator.
- The function, capabilities, and limitations of the selected respirator.
- The method of donning the respirator and checking its fit and operation.
- The proper wearing of the respirator.

- Respirator maintenance, repair, and cleaning.
- Recognizing and handling emergency situations.

Respirator training will be conducted on an annual basis, at a minimum. Records of the training and fit-testing will be maintained for a minimum of 30 years following termination of employment for each employee.

## 2.6 TYPES OF RESPIRATORS

Baker provides employees with the North Brand half-face (Model 7700) and full-face (Model 7600) air purifying respirators, positive pressure 30-minute Self-Contained Breathing Apparatus (SCBAs) (Model 800), positive pressure supplied airline respirators, with 5-minute escape air cylinders (Model 85500). Only respiratory equipment certified by the appropriate approval agencies (e.g., NIOSH, MSHA) according to Title 30, Part II of the Code of Federal Regulations, will be distributed to Baker employees. As an alternate air purifying respirator, Baker will also keep, on-hand, the MSA ultra twin full-face respirator. All Baker employees who regularly perform tasks requiring respiratory protection will be issued their own half-face or full-face respirator, provided the employee can achieve a proper fit and is medically capable of wearing the equipment.

Because 30-minute SCBAs, positive pressure supplied airline respirators, and 5-minute escape air cylinders are used less frequently, this equipment will be distributed on an as-needed basis.

## 2.7 AIR QUALITY

Compressed and liquid air used for respiration shall be of high purity. Breathing air shall meet at least the requirements of the specification for Grade D breathing air as described in Compressed Gas Association Commodity Specification G-7.1-1966. Breathing air may be supplied to respirators from cylinders or air compressors. Oxygen must never be used with air line respirators.

Air cylinders shall be tested and maintained as prescribed in the Shipping Container Specification Regulations of the Department of Transportation (49 CFR Part 178). Air line couplings shall be incompatible with outlets for other gas systems to prevent inadvertent servicing of air line respirators with nonrespirable gases or oxygen.

Breathing gas containers shall be marked in accordance with American National Standard Method of marking Portable Compressed Gas Containers to Identify the Material Contained, Z48.1-1954; Federal Specification BB-A-1034a, June 21, 1968, Air, Compressed for Breathing Purposes; or Interim Federal Specification GG-B-00675b, April 27, 1965, Breathing Apparatus, Self-Contained.

## **2.8 CLEANING AND MAINTENANCE**

Respirator maintenance will be performed by each trained individual on a regular basis. The maintenance shall be carried out on a schedule which ensures that each respirator wearer is provided with a respirator that is clean and in good operating condition.

Respiratory equipment that is used on an as-needed basis shall be maintained by qualified personnel. This equipment shall be cleaned/sanitized, then rinsed and air-dried, after each use. Inspections shall be conducted before and after each use.

Respiratory equipment that has been issued to an employee shall be cleaned/sanitized then rinsed and air-dried by the wearer on a schedule (specified by OSHA in 29 CFR 1910.134) which ensures that it will be maintained in clean and good operating condition. Inspections shall be conducted on a regular basis during usage and prior to each project requiring the potential usage of the equipment.

All respirators shall be stored in a plastic bag within a cool/dry location, in a manner that will protect them against dust, sunlight, heat, extreme cold, excessive moisture, or damaging chemicals. They shall be stored to prevent distortion of rubber or other elastomer parts.

Parts replacement and repairs shall be performed only by appropriate personnel. Equipment requiring repairs shall be reported to appropriate Baker personnel. Examples of inspection forms are included at the end of this text.

## **2.9 FIT-TESTING**

Each respirator wearer shall be provided with a respirator that can properly form a secure face to mask seal. Each wearer shall be fit-tested prior to issuance of the respirator using either an irritant smoke or odorous vapor, or other suitable test agent (see example of form at end of

text). Retesting shall be performed, at a minimum, on an annual basis or if a different model respirator, other than the model he/she was previously fit-tested for, is to be used by the wearer. Air purifying respirators fit-tested qualitatively will be assigned a protection factor of 10 (APF = 10).

Facial hair, which interferes with the normally effective face to mask seal, is prohibited. Each respirator wearer shall be required to check the seal of the respirator by negative and positive pressure checks prior to entering a harmful atmosphere.

## **2.10 MEDICAL SURVEILLANCE**

Personnel who are or may be assigned to tasks requiring use of respirators shall participate in a medical surveillance program on an annual basis. The medical surveillance program shall include, but may not be limited to, a physical and a pulmonary function test conducted by the company's physician and at the expense of the company. Test parameters included in Baker's medical surveillance program is included as Attachment A in each site-specific Health and Safety Plan.

## **2.11 LIMITATIONS**

Wearing any respirator, alone or in conjunction with other types of protective equipment, will impose some physiological stress on the wearer. Therefore, selection of respiratory protective devices will be based on the breathing resistance, weight of the respirator, the type and amount of protection needed as well as the individual's tolerance of the given device. Additional concerns regarding the limitations of different types of PPE and the monitoring requirements for heat stress/strain will be addressed in the "Heat Stress" SOP.



# RESPIRATOR FIT TEST RECORD



TEST SUBJECT NAME \_\_\_\_\_  
(last) (first) (initial)

DATE \_\_\_\_\_ DEPARTMENT \_\_\_\_\_

SEX (M/F) \_\_\_\_\_ AGE \_\_\_\_\_ SOCIAL SECURITY NUMBER \_\_\_\_\_

RESPIRATOR MEDICAL DATE \_\_\_\_\_ RESPIRATOR TRAINING DATE \_\_\_\_\_

**SPECIAL/UNUSUAL CONDITIONS/CONSIDERATIONS:**

- |  |  |
|--|--|
| <input type="checkbox"/> Claustrophobia<br><input type="checkbox"/> Facial hair<br><input type="checkbox"/> Eyeglasses<br><input type="checkbox"/> Contacts<br><input type="checkbox"/> Other: _____ | <input type="checkbox"/> Scars<br><input type="checkbox"/> Broken or crooked nose<br><input type="checkbox"/> Extreme facial dimensions<br><input type="checkbox"/> Wrinkles |
|--|--|

### RESPIRATOR SELECTION

Manufacturer/Model	Size	Style	
_____	S ___ M ___ L ___	Half ___ Full ___	Pass ___ Fail ___
_____	S ___ M ___ L ___	Half ___ Full ___	Pass ___ Fail ___
_____	S ___ M ___ L ___	Half ___ Full ___	Pass ___ Fail ___

Testing Agent	Qualitative Test	Sensitivity Check
Isoamyl Acetate	Yes: ___ No: ___	Yes: ___ No: ___
Irritant Smoke	Yes: ___ No: ___	Yes: ___ No: ___

### TEST EXERCISES (Check all that apply)

- |                          |                       |
|--------------------------|-----------------------|
| Normal Breathing _____   | Talking _____         |
| Deep Breathing _____     | Running _____         |
| Head, Side to Side _____ | Bending _____         |
| Head, Up and Down _____  | Rainbow Passage _____ |

COMMENTS: \_\_\_\_\_  
 \_\_\_\_\_

Signed: \_\_\_\_\_  
 (Test Subject)

Signed: \_\_\_\_\_  
 (Technician/Instructor)



**FULL-FACE AND HALF-FACE RESPIRATOR  
INSPECTION FORM**

Inspection Date	Type	FACE PIECE					HEADSTRAPS OR HEADBANDS		RESPIRATOR INTERIOR		
		Clean and Sanitized	No Cracks, Tears, or Holes	Proper Shape and Flexibility	Air Purifying Element Holders Operate Correctly	Proper Storage Free From Heat, Dirt, Sunlight, etc.	No Signs of Wear or Tears	Buckles Function Properly	No Foreign Material Under Valve Seat	No Cracks or Tears in Valves or Valve Bodies	Valve Covers and Bodies in Good Condition and Installed Correctly

✓ = OK    X = Not OK

## 3.0 - CARE AND CLEANING OF PERSONAL PROTECTIVE EQUIPMENT

### 3.1 INTRODUCTION

The following procedures cover the care and cleaning of Levels D, C, and B personal protective equipment. Note: These are general procedures that apply to most situations and are not all inclusive. Procedures are subject to change at the direction of the Site Health and Safety Officer (SHSO).

### 3.2 EQUIPMENT CARE

#### 3.2.1 Chemical Resistant Suit (Levels C and B)

- Before donning, inspect suit for holes or tears; check to see that zippers are operable; and look for signs of suit degradation.
- When wearing, avoid contact with contaminated material where possible; be aware of sharp objects that can tear suit; periodically look over suit to check for major rips or tears.
- While decontaminating, remove gross excess of material from suit; remove suit so that material does not contact inner suit; place clothing in properly labeled disposal containers.

#### 3.2.2 Inner/Outer Gloves (Levels D through B)

- Look for rips, tears, or degradation of material. Replace as necessary or at the direction of the SHSO.

#### 3.2.3 Chemically Resistant Boots (Levels C and B)

- Nondisposable boots are to be examined on a daily basis before and after use. Disposable boots should be examined prior to donning and while in use. Dispose of according to site procedures.

#### **3.2.4 Safety Shoes/Boots (Levels D through B)**

- Examine daily for gauges, open seams, etc., anything that would lessen the integrity of the boot. Replace as shoe/boot becomes worn.

#### **3.2.5 Hard Hats (Levels D through B)**

- Should be visually inspected before donning for fit, cracks, and overall condition.

#### **3.2.6 Safety Glasses/Goggles (Levels D and C)**

- Should be visually inspected before donning for cracks, deteriorated parts, and overall condition. Replace as necessary.

#### **3.2.7 Respirators (Levels C and B)**

- Procedures for care of respiratory protective equipment are covered in Baker's SOP for Respiratory Protection.

#### **3.2.8 Hearing Protection (Levels D through B)**

- Disposable - Replace daily, or as material becomes worn or dirty.
- Reusable - Inspect before use, clean regularly, replace parts as necessary.

### **3.3 EQUIPMENT CLEANING**

General procedures for cleaning of equipment are listed below. Site-specific concerns will be addressed by the SHSO prior to and during site activities. Cleaning of respiratory equipment is covered under the "Respiratory Protection Program" SOP.

#### **3.3.1 Gross Physical Removal**

Large amounts of contaminated soil is scraped off with a tongue depressor, or wiped off using a disposable wipe.

### **3.3.2 Physical/Chemical Removal**

The residual contamination will be scrubbed with a soft-bristled, long-handled brush using a nonphosphate detergent solution.

### **3.3.3 Rinsing/Dilution**

The detergent solution and residual contaminants will be rinsed with tap water using a pressurized sprayer.



## 4.0 - SANITATION/SITE PRECAUTIONS

### 4.1 SANITATION

- A supply of clearly marked potable water, tightly closed, and equipped with a tap.
- Single service disposal cups.
- Outlets for non-potable water, clearly marked, for fire fighting, or other purposes. Cross-contamination of the potable supply shall be prevented.
- One toilet facility which is either chemical, recirculating, combustion, or flush, depending on local code requirements.
- A place for food handling meeting all applicable laws, otherwise, suitable alternatives to such facilities will be provided (i.e., nearby restaurants, food wagons, etc.).
- Clean wash water will be available in the decontamination zone and the Baker Site Trailer.

### 4.2 SITE PRECAUTIONS

- Eating, drinking, chewing gum or tobacco, smoking, or any practice that increases the probability of hand-to-mouth transfer and ingestion of material, is prohibited in any area designated as contaminated.
- Smoking will not be allowed in areas where flammable materials are present.
- Hands and face must be thoroughly washed upon leaving the work area.
- Whenever decontamination procedures for outer garments are in effect, the entire body should be thoroughly washed as soon as possible after the protective garment is removed.

- No contaminated work garments are to be worn off site.
- Contact lenses are not permitted to be worn on site.
- No facial hair which interferes with a satisfactory fit of the mask-to-face seal, is allowed on personnel required to wear respirators.
- Contact with contaminated or potentially contaminated surfaces should be avoided. Wherever possible, do not walk through puddles, leachate, discolored surfaces, kneel on ground, lean, sit or place equipment on drums/containers.
- Medicine and alcohol can potentiate the effects from exposure to toxic chemicals. Prescribed drugs should not be taken by personnel where the potential for absorption, inhalation, or ingestion of toxic substances exist unless specifically approved by a qualified physician. Alcoholic beverage intake should be minimized or avoided during after-hour operations.
- Alcoholic beverages are prohibited on site.
- Personal radios, TVs, and tape players are prohibited on site.
- Firearms are prohibited on site.
- All personnel will observe any posted sign, warning, fence, or barrier posted around contaminated areas.

**5.0 - HEAT STRESS****5.0 HEAT STRESS**Monitoring

Provisions for monitoring for heat stress will be determined by the SHSO and performed as outlined below.

Heat stress monitoring is required for personnel wearing semipermeable or impermeable protective outerwear when there is an ambient air temperature greater than 70°F. One or more of the following procedures will be implemented when this condition exists:

1. Increased awareness of heat stress symptoms and buddy monitoring.
2. Fluid intake discipline.
3. Self monitoring of urine output quantities to prevent dehydration.
4. Work-rest intervals.
5. Calculate the Heat Exposure Threshold Limit Value (TLV) for work-rest intervals using the following steps:
  - a. Calculate the WBGT (Wet Bulb Globe Temperature) Index using the Quest® Heat Stress Monitor
  - b. Estimate the work load using the following guidelines:
    - (1) Light work = sitting or standing to control machines, performing light hand or arm work.
    - (2) Moderate work = walking about with moderated lifting and pushing.
    - (3) Heavy work = pick and shovel work.
  - c. Evaluate the calculations against the following Heat Exposure TLVs in °C or °F.

Work - Rest Regimen	Work Load		
	Light	Moderate	Heavy
Continuous work	30.0 (86)	26.7 (80)	25.0 (77)
75% work - 25% rest, each hour	30.6 (87)	28.0 (82)	25.9 (78)
50% work - 50% rest, each hour	31.4 (89)	29.4 (85)	27.9 (82)
25% work - 75% rest, each hour	32.2 (90)	31.1 (88)	30.0 (86)

- \* For unacclimatized workers, the permissible heat exposure TLV should be reduced by 2.5°C.

### Special Considerations

- Clothing - Subtract 2 from the TLV to compensate for the use of semipermeable clothing.
- Acclimatization - After approximately a week, workers should have acclimated themselves to their environment.
- Fitness - Physically fit workers will adjust more readily to a change in environment.
- Medication - Some medications can predispose individuals to heat-induced illnesses.

### Causes and Symptoms

The following heat stress causes and symptoms are provided for buddy monitoring purposes. Site personnel must realize that monitoring the physical condition of fellow personnel in Level B and C protective ensembles will be difficult.

1. *Heat rash* results from continuous exposure to heat or humid air.
2. *Heat cramps* are caused by heavy sweating and inadequate fluid intake. Symptoms include muscle spasms and pain in the hands, feet, and abdomen.
3. *Heat exhaustion* occurs when body organs attempt to keep the body cool, due to inadequate fluid intake and personnel not acclimated to the environment. Symptoms include pale, cool, moist skin; heavy sweating; and dizziness.

4. *Heat stroke* is the most serious form of heat stress. It is a **MEDICAL EMERGENCY**. Symptoms are red, hot, dry skin; lack of perspiration; nausea; dizziness and confusion; strong, rapid pulse rate; and coma.

The need to seek medical attention and the urgency in seeking medical attention depends on the symptoms and the severity of the symptoms displayed by the affected individual. If *heat stroke* is noted or suspected, medical attention must be sought **IMMEDIATELY**. Efforts should be taken to cool the body to prevent serious injury or death. Excessive cooling can cause hypothermia and should be avoided.

#### Prevention

Fluid intake should be increased during rest schedules to prevent dehydration. Drinking cool water is best; however, diluted electrolyte solutions (i.e., Gatorade or equivalent) can be substituted for water. Each individual should monitor their urine output and adjust their fluid intake to ensure that urine output and urine color are close to normal. Additional means for preventing heat-induced illnesses may include providing shelter or cooling devices, such as vests and showers.

**6.0 COLD STRESS**

The potential exists for either frostbite or hypothermia to occur when conducting work activities in an environment where air temperatures may fall below freezing or where wind-chill factors lower air temperatures below freezing. A brief description and exposure symptoms for both hypothermia and frostbite are as follows:

1. *Hypothermia* - a condition in which the body loses heat faster than it is produced. At a body temperature of 95°F, an average man is considered to be hypothermic. Vasodilators, which include alcohol and drugs, allow the body to lose heat faster which can accelerate hypothermia. The five stages of hypothermia include: (1) shivering; (2) apathy; (3) unconsciousness; (4) freezing; and (5) death.
2. *Frostbite* - a condition in which there is a freezing or partial freezing of some part of the body. Individuals previously exposed to frostbite are more susceptible to contracting it again. Vasoconstrictors, which include tobacco products, constrict blood vessels, and can accelerate frostbite. The three stages of frostbite include: (1) frostnip - the beginnings of frostbite whereby the skin begins to turn white; (2) superficial - similar to frostnip except the skin begins to turn numb; and (3) deep - the affected area is frozen to the bone, cold, numb, and very hard.

The need to seek medical attention and the urgency in seeking medical attention depends on the symptoms and the severity of the symptoms displayed by the affected individual. If the latent conditions of hypothermia or frostbite are noted or suspected, medical attention must be sought **IMMEDIATELY** to prevent permanent injury or death.

To prevent conditions from occurring have personnel:

- Dress in a minimum of three layers (a skin layer to absorb moisture and keep skin dry, an insulating layer, and an outer chemical-protective layer).

- **Avoid touching cold surfaces (especially metal) with bare skin, minimize exposed skin surfaces.**
- **Keep active, use shelter areas during rest cycles.**
- **Maintain body fluids.**
- **Use wind breaks whenever possible.**

## 7.0 - SAFE BOAT OPERATIONS

### 7.1 OBJECTIVE

To provide safe operating procedures while performing sampling activities from a boat.

### 7.2 EQUIPMENT

Refer to Attachment A, "Federal Requirements for Recreational Boats," for a list of required equipment.

### 7.3 PRELIMINARY ACTIVITIES

Ensure that requirements governing the safe operation of a boat, published by the Department of Transportation, United States Coast Guard (Attachment A) are reviewed prior to placing the boat in the water.

### 7.4 OPERATING PROCEDURE

Operate the boat according to the Department of Transportation, United States Coast Guard Regulations (Attachment A), where applicable.

### 7.5 REFERENCES

U.S. Department of Transportation, United States Coast Guard. Federal Requirements for Recreational Boats. United States Coast Guard, Washington, D. C. 20593.\*

\* It is recognized that these requirements are directed towards recreational boating, but Baker Environmental, Inc. believes that the topics of discussion included in this reference are applicable to the size of boat, and activities to be performed during environmental sampling.




## BE SAFE ON THE WATER

### KNOW . . .

- The stability and handling of the boat you are using.
- How to use the equipment on the boat.
- The waters you will be using, tides, currents, sand bars, and other hazards.
- The weather conditions.
- The safety devices and emergency equipment  
Make sure that life jackets fit properly.
- The navigation rules and observe the courtesies of safe boating.
- Your personal limitations and responsibilities.  
Exposure to sun, wind, cold water, all affect your ability to react.
- That it is illegal to operate a vessel while intoxicated. If you add alcohol or drugs to boating, the results can be fatal.

**. . . BEFORE YOU GO!**

## Federal Requirements for Recreational Boats

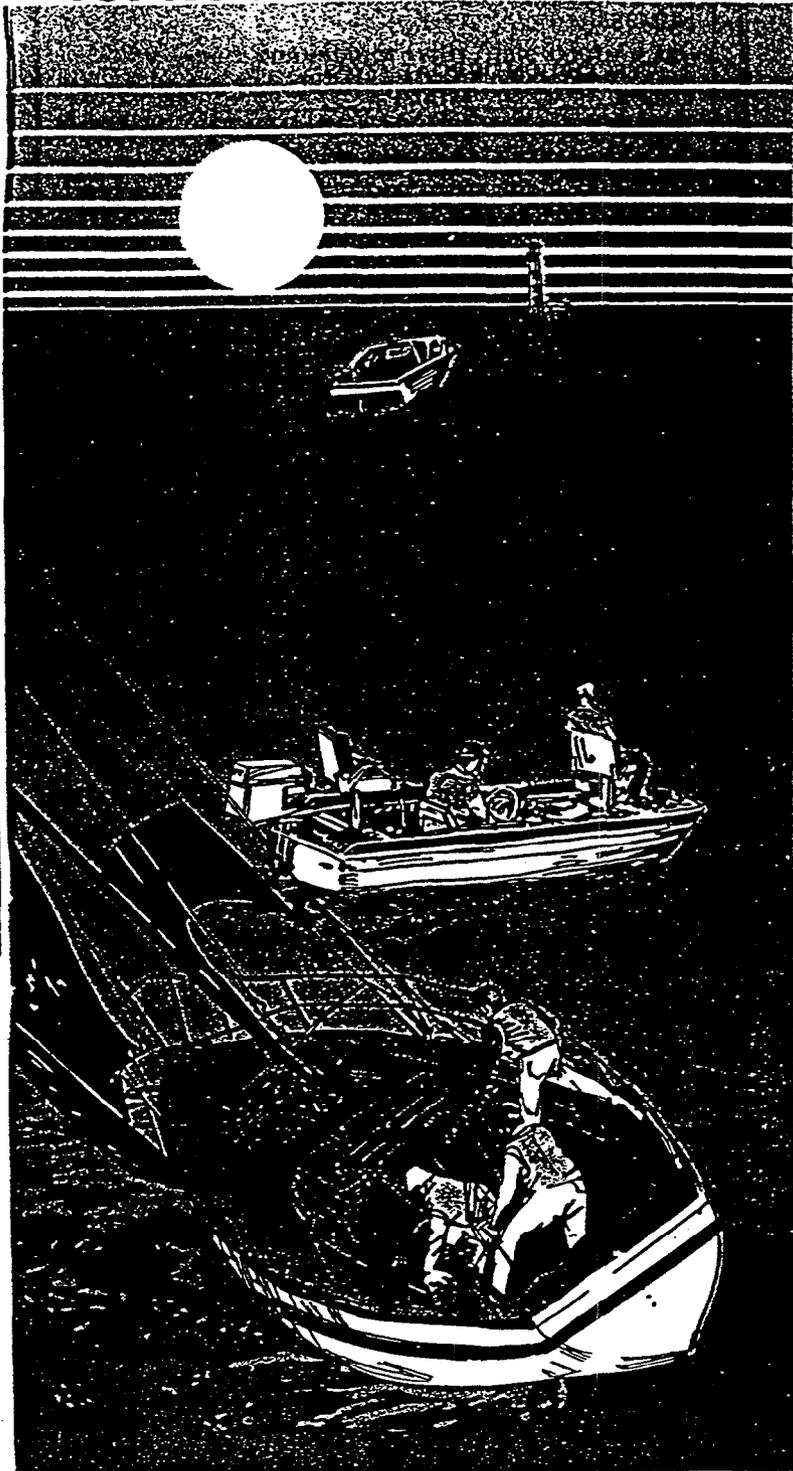

## FLOAT PLAN

Complete this page, before going boating and leave it with a reliable person who can be depended upon to notify the Coast Guard or other rescue organization, should you not return as scheduled. Do not file this plan with the Coast Guard.

1. NAME OF PERSON REPORTING AND TELEPHONE NUMBER \_\_\_\_\_
2. DESCRIPTION OF BOAT. TYPE \_\_\_\_\_  
 COLOR \_\_\_\_\_ TRIM \_\_\_\_\_ REGISTRATION NO. \_\_\_\_\_ LENGTH \_\_\_\_\_ NAME \_\_\_\_\_  
 MAKE \_\_\_\_\_  
 OTHER INFO. \_\_\_\_\_
3. PERSONS ABOARD \_\_\_\_\_  

NAME	AGE	ADDRESS & TELEPHONE NO.
_____	_____	_____
_____	_____	_____
4. DO ANY OF THE PERSONS ABOARD HAVE A MEDICAL PROBLEM? \_\_\_\_\_ IF SO, WHAT? \_\_\_\_\_
5. ENGINE TYPE \_\_\_\_\_ H.P. \_\_\_\_\_  
 NO. OF ENGINES \_\_\_\_\_ FUEL CAPACITY \_\_\_\_\_
6. SURVIVAL EQUIPMENT: (CHECK AS APPROPRIATE)  
 PFDs \_\_\_\_\_ FLARES \_\_\_\_\_ MIRROR \_\_\_\_\_  
 SMOKE SIGNALS \_\_\_\_\_ FLASHLIGHT \_\_\_\_\_  
 FOOD \_\_\_\_\_ PADDLES \_\_\_\_\_ WATER \_\_\_\_\_  
 OTHERS \_\_\_\_\_ ANCHOR \_\_\_\_\_  
 RAFT OR DINGHY \_\_\_\_\_ EPIRB \_\_\_\_\_
7. RADIO YES/NO TYPE \_\_\_\_\_  
 FREQS. \_\_\_\_\_
8. TRIP EXPECTATIONS: LEAVE AT \_\_\_\_\_  
 FROM \_\_\_\_\_ GOING TO \_\_\_\_\_  
 EXPECT TO RETURN BY \_\_\_\_\_ (TIME) AND IN  
 NO EVENT LATER THAN \_\_\_\_\_
9. ANY OTHER PERTINENT INFO. \_\_\_\_\_
10. AUTOMOBILE LICENSE \_\_\_\_\_  
 TYPE \_\_\_\_\_ TRAILER LICENSE \_\_\_\_\_  
 COLOR AND MAKE OF AUTO \_\_\_\_\_  
 WHERE PARKED \_\_\_\_\_
11. IF NOT RETURNED BY \_\_\_\_\_ (TIME)  
 CALL THE COAST GUARD, OR \_\_\_\_\_ (LOCAL  
 AUTHORITY)
12. TELEPHONE NUMBERS \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

This pamphlet contains the Federal equipment carriage requirements for recreational vessels. The owner/operator may be required to comply with additional regulations specific to the State in which the vessel is registered or operated. State laws vary. A vessel in compliance with the laws of the State of registration, may not meet the requirements of another State where it may be operating.

To insure compliance with State boating laws, contact your State boating safety agency.


## REGISTRATION AND NUMBERING REQUIREMENTS

All undocumented vessels equipped with propulsion machinery must be registered in the State of principal use. A certificate of number will be issued upon registering the vessel. These numbers must be displayed on your vessel. Some States require all vessels to be numbered, check with your State boating authority for numbering requirements.

A documented vessel is not exempt from applicable State or Federal taxes, nor is its operator exempt from compliance with Federal or State equipment carriage requirements.

## DISPLAY OF NUMBER

Numbers must be painted or permanently attached to each side of the forward half of the vessel. The Coast Guard and many States issue two validation stickers. They must be affixed within six inches of the registration number. No other letters or numbers may be displayed nearby.

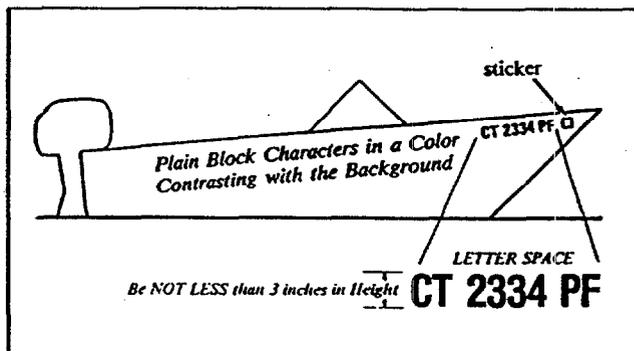

## CERTIFICATE OF NUMBER

The owner/operator of a vessel must carry a valid certificate of number whenever the vessel is in use. When a vessel is moved to a new State of principal use, the certificate of number is valid for 60 days.

The Coast Guard issues the certificate of numbers in Alaska.


## NOTIFICATION OF CHANGES

The owner of a vessel must notify the agency which issued the certificate of numbers within 15 days if:

- The vessel is transferred, destroyed, abandoned, lost, stolen or recovered.
- The certificate of number is lost, destroyed or the owner's address changes.

If the certificate of number becomes invalid for any reason, it must be surrendered in the manner prescribed by the issuing authority within 15 days.

## LAW ENFORCEMENT

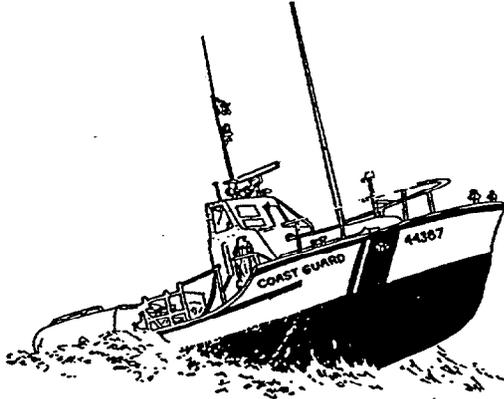

A vessel underway, when hailed by a Coast Guard vessel is required to heave to, or maneuver in such a manner that permits a boarding officer to come aboard.

Other Federal, State and local law enforcement officials may board and examine your vessel, whether it is numbered, unnumbered or documented. Coast Guard law enforcement personnel may also be found aboard other vessels.

## Law Enforcement (continued)

The Coast Guard may impose a civil penalty up to \$1,000 for failure to: comply with numbering requirements; comply with equipment requirements; report a boating accident; or comply with other Federal regulations. Failure to comply with the unified Inland Rules of the Road (Inland Navigation Rules Act of 1980) can result in a civil penalty up to \$5,000.

Improper use of a radiotelephone is a criminal offense. The use of obscene, indecent or profane language during radio communications is punishable by a \$10,000 fine, imprisonment for two years or both. Other penalties exist for misuse of a radio, such as improper use of Channel 16 VHF-FM.

Channel 16 is a calling and distress channel. It is not to be used for conversation or radio checks. Such traffic should be conducted on an authorized working channel.

**OPERATING A VESSEL WHILE INTOXICATED** became a specific federal offense effective January 13, 1988. The final rule set standards for determining when an individual is intoxicated. The BAC is .10% (.08% in Utah) for operators of recreational vessels being used only for pleasure. Violators are subject to civil penalty not to exceed \$1,000 or criminal penalty not to exceed \$5,000, 1 year imprisonment or both.

**NEGLIGENT or GROSSLY NEGLIGENT OPERATION** of a vessel which endangers lives and property is prohibited by law. The Coast Guard may impose a civil penalty for negligent operation. **GROSSLY NEGLIGENT OPERATION** is a criminal offense and an operator may be fined up to \$5,000, imprisoned for one year, or both. Some examples of actions that may constitute negligent or grossly negligent operation are:

- Operating a boat in a swimming area.
- Operating a boat while under the influence of alcohol or drugs.
- Excessive speed in the vicinity of other boats or in dangerous waters.
- Hazardous water skiing practices.
- Bowriding, also riding on seatback, gunwale or transom.

## TERMINATION OF USE

A Coast Guard boarding officer who observes a boat being operated in an **UNSAFE CONDITION**, specifically defined by law or regulation, and who determines that an **ESPECIALLY HAZARDOUS CONDITION** exists, may direct the operator to take immediate steps to correct the condition, including returning to port. Termination of unsafe use may be imposed for:

- Insufficient number of CG Approved Personal Flotation Devices (PFDs).
- Insufficient fire extinguishers.
- Overloading beyond manufacturers recommended safe loading capacity.
- Improper navigation light display.
- Fuel leakage.
- Fuel in bilges.
- Improper ventilation.
- Improper backfire flame control.
- Operating in regulated boating areas during predetermined adverse conditions. (Applies in 13th CG District Only).
- Manifestly unsafe voyage.

An operator who refuses to terminate the unsafe use of a vessel can be cited for failure to comply with the directions of a Coast Guard boarding officer, as well as for the specific violations which were the basis for the termination order. Violators may be fined not more than \$1000 or imprisoned not more than one year or both.

## COAST GUARD APPROVED EQUIPMENT

The Coast Guard sets minimum safety standards for vessels and associated equipment. To meet these standards various equipment must be Coast Guard approved. "Coast Guard Approved Equipment" has been determined to be in compliance with USCG specifications and regulations relating to performance, construction or materials.

## PERSONAL FLOTATION DEVICES (PFDs)

PFDs must be Coast Guard Approved, in good and serviceable condition, and of appropriate size for the intended user. Wearable PFDs must be readily accessible, meaning you must be able to put them on in a reasonable amount of time in an emergency (vessel sinking, on fire, etc.). They should not be stowed in plastic bags, in locked or closed compartments or have other gear stowed on top of them. Throwable devices must be immediately available for use. Though not required, a PFD should be worn at all times when the vessel is underway. A wearable PFD can save your life, but only if you wear it.

Boats less than 16 feet in length (including canoes and kayaks of any length) must be equipped with one Type I, II, III, IV or V PFD for each person aboard.

Boats 16 feet and longer must be equipped with one Type I, II, III or V for each person aboard PLUS one Type IV.

Federal law does not require PFDs on racing shells, rowing skulls and racing kayaks; State laws vary.


## TYPES OF PFDs

A **TYPE I PFD**, or **OFF-SHORE LIFE JACKET** provides the most buoyancy. It is effective for all waters, especially open, rough or remote waters where rescue may be delayed. It is designed to turn most unconscious wearers in the water to a face-up position. The Type I comes in two sizes. The adult size provides at least 22 pounds buoyancy, the child size, 11 pounds, minimum.




Off-shore Lifejacket

Types of PFDs (continued)



Near-Shore Buoyant Vest

A TYPE II PFD, or NEAR-SHORE BUOYANT VEST is intended for calm, inland water or where there is a good chance of quick rescue. This type will turn SOME unconscious wearers to a face-up position in the water. The turning action is not as pronounced and it will not turn as many persons under the same conditions as a Type I. An adult size device provides at least 15 1/2 pounds buoyancy, a medium child size provides 11 pounds. Infant and small child sizes each provide at least 7 pounds buoyancy.

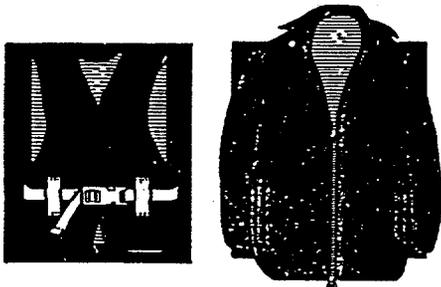


Flotation Aid

A TYPE III PFD, or FLOTATION AID is good for calm, inland water, or where there is a good chance of quick rescue. It is designed so wearers can place themselves in a face-up position in the water. The wearer may have to tilt head back to avoid turning face-down in the water. The Type III has the same minimum buoyancy as a Type II PFD. It comes in many styles, colors and sizes and is generally the most comfortable type for continuous wear. Float coats, fishing vests and vests designed with features suitable for various sports activities are examples of this type PFD.

Types of PFDs (continued)


A TYPE IV PFD, or THROWABLE DEVICE is intended for calm, inland water with heavy boat traffic, where help is always present. It is designed to be thrown to a person in the water and grasped and held by the user until rescued. It is not designed to be worn. Type IV devices include buoyant cushions, ring buoys and horseshoe buoys.

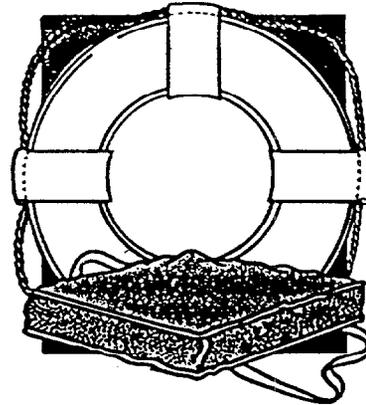

Throwable Device

A TYPE V PFD, or SPECIAL USE DEVICE is intended for specific activities and may be carried instead of another PFD only if used according to the approval conditions on the label. Some Type V devices provide significant hypothermia protection. Varieties include deck suits, work vests, board sailing vests and Hybrid PFDs.

A TYPE V HYBRID INFLATABLE PFD is the least bulky of all PFD types. It contains a small amount of inherent buoyancy, and an inflatable chamber. Its performance is equal to a Type I, II, or III PFD (as noted on the PFD label) when inflated. Hybrid PFDs must be worn when underway to be acceptable.



Inflated Hybrid

## WATER SKIING

A water skier, while being towed, is considered on board the vessel and a PFD is required for the purposes of compliance with the PFD carriage requirements. Although not required by Federal law it is advisable and recommended for a skier to wear a PFD designed and intended to withstand the impact of hitting the water at high speed as when a skier falls. "Impact Class" marking refers to PFD strength, not personal protection. Some State laws require skiers to wear a PFD.

### VISUAL DISTRESS SIGNALS

All vessels, used on coastal waters, the Great Lakes, territorial seas and those waters connected directly to them, up to a point where a body of water is less than two miles wide, must be equipped with visual distress signals. Vessels owned in the United States operating on the high seas must be equipped with visual distress signals. The following vessels are not required to carry day signals but must carry night signals when operating from sunset to sunrise:

- Recreational boats less than 16 feet in length.
- Boats participating in organized events such as races, regattas or marine parades.
- Open sailboats less than 26 feet in length not equipped with propulsion machinery.
- Manually propelled boats.

**PYROTECHNIC VISUAL DISTRESS SIGNALS** must be Coast Guard Approved, in serviceable condition and readily accessible. They are marked with a date showing the service life, which must not be expired. Launchers manufactured before January 1, 1981, intended for use with approved signals, are not required to be Coast Guard Approved. If pyrotechnic devices are selected, a minimum of three are required. That is three signals for day use and three signals for night. Some pyrotechnic signals meet both day and night use requirements. Pyrotechnic devices should be stored in a cool, dry location. A watertight container painted red or orange and prominently marked "DISTRESS SIGNALS" is recommended.

USCG Approved Pyrotechnic Visual Distress Signals and Associated Devices include:

- Pyrotechnic red flares, hand-held or aerial.
- Pyrotechnic orange smoke, hand-held or floating.
- Launchers for aerial red meteors or parachute flares.

**NON-PYROTECHNIC VISUAL DISTRESS SIGNALS** must be in serviceable condition, readily accessible and certified by the manufacturer as complying with USCG requirements, they include:

- Orange distress flag
- Electric distress light

The distress flag is a day signal only. It must be at least 3x3 feet with a black square and ball on an orange background. It is most distinctive when attached and waved on a paddle or boathook or flown from a mast.

The electric distress light is accepted for night use only and must automatically flash the international SOS distress signal (···—···). This is an unmistakable distress signal. A standard flashlight is not acceptable as a visual distress signal.

Under Inland Navigation Rules, a high intensity white light flashing at regular intervals from 50-70 times per minute is considered a distress signal. Strobe lights used in inland waters shall only be used as a distress signal.

Regulations prohibit display of visual distress signals on the water under any circumstances except when assistance is required to prevent immediate or potential danger to persons on board a vessel.

All distress signals have distinct advantages and disadvantages, no single device is ideal under all conditions or suitable for all purposes. Pyrotechnics are excellent distress signals, universally recognized. However, there is potential for injury and property damage if not properly handled. These devices produce a very hot flame, the residue can cause burns and ignite flammable material. Pistol launched and hand-held parachute flares and meteors have many characteristics of a firearm and must be handled with caution.

## FIRE EXTINGUISHERS

Approved extinguishers are classified by a letter and number symbol. The letter indicates the type fire the unit is designed to extinguish (Type B designed to extinguish flammable liquids such as gasoline, oil and grease fires). The number indicates the relative size of the extinguisher (minimum extinguishing agent weight).

Approved extinguishers are hand-portable, either B-I or B-II classification and have the following characteristics:

<u>Classes</u>	<u>Foam</u> <u>(Gals.)</u>	<u>CO<sub>2</sub></u> <u>(LBS)</u>	<u>Dry</u>	
			<u>Chemical</u> <u>(LBS)</u>	<u>Halon</u> <u>(LBS)</u>
B-I	1.25	4	2	2.5
B-II	2.5	15	10	10

Fire extinguishers are required if any one or more of the following conditions exist:

- Inboard engines.
- Closed compartments under thwarts and seats where portable fuel tanks may be stored.
- Double bottoms not sealed to the hull or which are not completely filled with flotation materials.
- Closed living spaces.
- Closed stowage compartments in which combustible or flammable materials are stored.
- Permanently installed fuel tanks. Fuel tanks secured so they cannot be moved in case of fire or other emergency are considered permanently installed. There are no gallon capacity limits to determine if a fuel tank is portable. If the weight of a fuel tank is such that persons on board cannot move it, the Coast Guard considers it permanently installed.

Dry chemical fire extinguishers without gauges or indicating devices must be inspected every 6 months. If the gross weight of a carbon dioxide (CO<sub>2</sub>) extinguisher is reduced by more than 10% of the net weight, the extinguisher is not acceptable and must be recharged.

Check extinguishers regularly to ensure gauges are free and nozzles are clear.

Minimum number of hand portable fire extinguishers required:

VESSEL LENGTH	NO FIXED SYSTEM	WITH APPROVED
		FIXED SYSTEM
Less than 26'	1 B-I	0
26' to less than 40'	2 B-I or 1 B-II	1 B-I
40' to 65'	3 B-I or 1 B-II and 1 B-I	2 B-I or 1 B-II


Coast Guard Approved extinguishers are identified by the following marking on the label: "Marine Type USCG Approved, Size . . . , Type . . . , 162.208/ . . . /", etc



Types of  
Fire  
Extinguishers

## BACKFIRE FLAME CONTROL

Gasoline engines installed in a vessel after April 25, 1940, except outboard motors, must be equipped with an acceptable means of backfire flame control. The device must be suitably attached to the air intake with a flametight connection and is required to be Coast Guard approved.

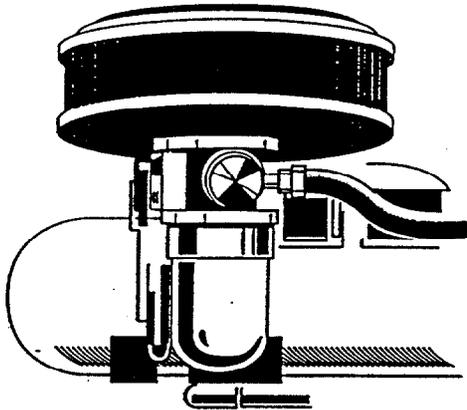

Back Fire Flame Arrester

## REQUIRED NONAPPROVED EQUIPMENT

### NATURAL VENTILATION

All vessels with propulsion machinery that use gasoline for fuel, with enclosed engine and/or fuel tank compartments built after April 25, 1940 and before August 1, 1980 are required to have natural ventilation.

Natural ventilation consists of at least two ventilation ducts fitted with cowls or their equivalent for the purpose of efficiently ventilating the bilges of every engine and fuel tank compartment. At least one exhaust duct extending to the lower portion of the bilge and at least one intake duct extending to a point midway to the bilge or at least below the level of the carburetor air intake is required.

Vessels built after July 31, 1978, but prior to August 1, 1980, have no requirement for ventilation of the fuel tank compartment if there is no electrical source in the compartment and the tank vents to the outside of the vessel.

## POWERED VENTILATION


Vessels built after July 31, 1980 that have gasoline engines, with a cranking motor (starter), for electrical generation, mechanical power or propulsion in a closed compartment are required to have a powered ventilation system. This includes each compartment with such an engine.

No person may operate a vessel built after July 31, 1980 with a gasoline engine in a closed compartment unless it is equipped with an operable ventilation system that meets Coast Guard standards. The operator is required to keep the system in operating condition and ensure cowls and ducting are not blocked or torn.

## SOUND SIGNALLING DEVICES

Regulations do not specifically require vessels less than 12 meters to carry a whistle, horn or bell. However, the navigation rules require sound signals to be made under certain circumstances. Meeting, crossing and overtaking situations described in Navigation Rules section are examples of when sound signals are required. Recreational vessels are also required to sound fog signals during periods of reduced visibility. Therefore, you must have some means of making an efficient sound signal.


Vessels 12 meters or more in length are required to carry on board a power whistle or power horn and a bell.

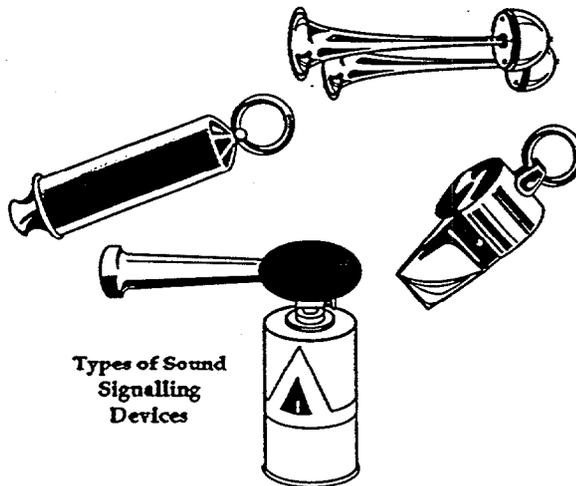


Types of Sound Signalling Devices

## NAVIGATION RULES

The Navigation Rules establish actions to be taken by vessels to avoid collision. The vessel operator is responsible for knowing and following applicable navigation rules. The following diagrams describe the whistle signals and actions to be taken by recreational vessels in a crossing, meeting and overtaking situation. These are basic examples, for further information consult the NAVIGATION RULES International - Inland (COMDTINST M16672.2A).

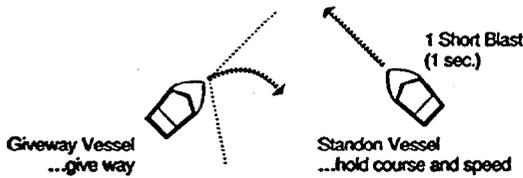

### Meeting Head-On or Nearly So

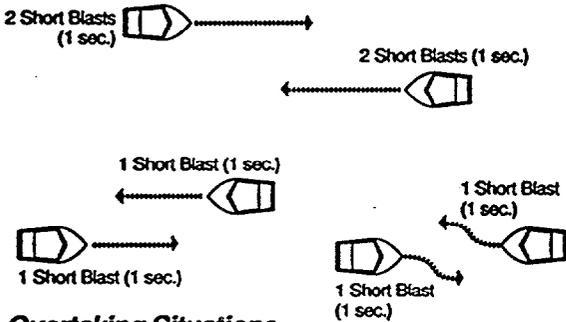

### Overtaking Situations




International Rules apply outside established lines of demarcation and Inland Rules apply inside the lines. Demarcation lines are printed on most navigational charts and are published in the Navigation Rules.

## NAVIGATION LIGHTS

Recreational vessels are required to display navigation lights between sunset and sunrise and other periods of reduced visibility (fog, rain, haze etc.). The U. S. Coast Guard Navigation Rules, International - Inland encompasses lighting requirements for every description of watercraft. The information provided here is intended for power-driven and sailing vessels less than 20 meters.

### POWER DRIVEN VESSELS

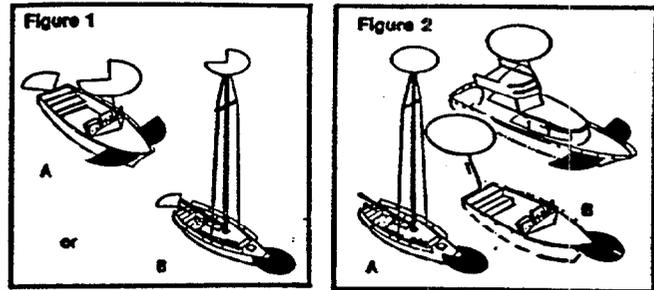

Power-driven vessels of less than 20 meters, shall exhibit navigation lights as shown in Figure 1. Vessels of less than 12 meters in length, may show the lights in either Figure 1 or Figure 2.

Power-driven vessels of less than 7 meters whose maximum speed cannot exceed 7 knots may exhibit an all-round white light, and if practicable sidelights instead of the lights prescribed above, in International Waters only.





Sailing vessels operating under machinery, or under sail and machinery are considered power-driven and must display the lights prescribed for a power-driven vessel.

### SAILING VESSELS AND VESSELS UNDER OARS

Sailing vessels less than 20 meters exhibit navigation lights shown in Figures 3 or 4 or may be combined in a single lantern carried at the top of the mast as shown in Figure 5.

Sailing vessels less than 7 meters may carry an electric torch or lighted lantern showing a white light

Sailing Vessels and Vessels Under Oars (continued)

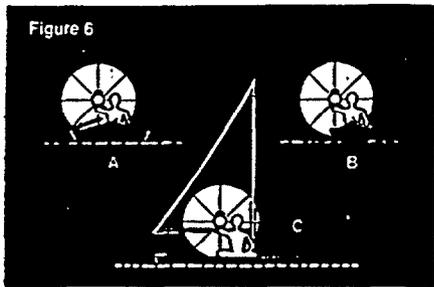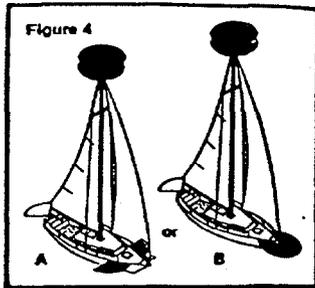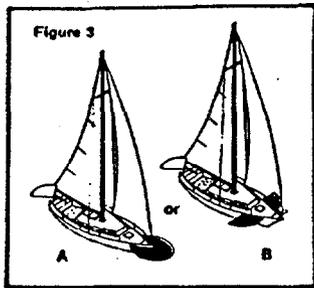

to be displayed in sufficient time to prevent collision (see Figure 6), if practicable, the lights prescribed for sailing vessels less than 20 meters should be displayed.

Vessels under oars may display the lights prescribed for sailing vessels, but if not, must have ready at hand an electric torch or lighted lantern showing a white light to be shown in sufficient time to prevent collision (see Figure 6).

LIGHTS FOR ANCHORED VESSELS

Power-driven vessels and sailing vessels at anchor must display anchor lights. An anchor light for a vessel less than 20 meters in length is an all-round white light visible for 2 miles exhibited where it can best be seen.

Vessels less than 7 meters are not required to display anchor lights unless anchored in or near a narrow channel, fairway or anchorage or where other vessels normally navigate.

Anchor lights are not required on vessels less than 20 meters, anchored in special anchorages designated by the Secretary of Transportation in Inland Waters.


Vessels under sail also being propelled by machinery, must exhibit forward, where it can best be seen, a conical shape, apex down (See Figure 7). Vessels less than 12 meters are not required to exhibit the dayshape in Inland Waters.

DIVING OPERATIONS

The Navigational Rules require vessels restricted in ability to maneuver to display appropriate day shapes. To meet this requirement, recreational vessels engaged in diving activities may exhibit a rigid replica of the international code flag "A" not less than one meter in height (See Figure 8).

This requirement does not affect the use of the red and white diver's flag which may be required by State or local law to mark the diver's location under water. The "A" flag is a navigation signal advertising the vessel's restricted maneuverability. It does not pertain to the diver.

DAY SHAPES REQUIRED BETWEEN SUNRISE AND SUNSET

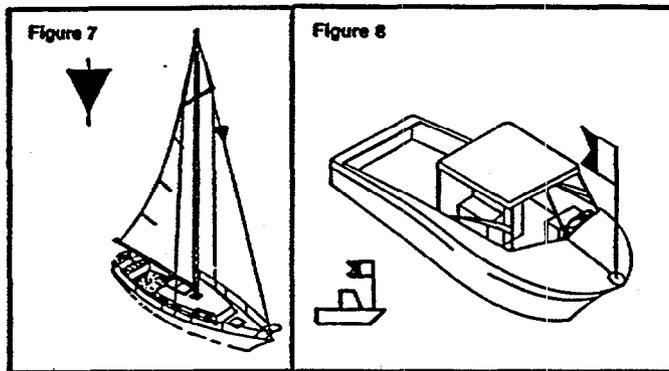

The operator of each self-propelled vessel 12 meters or more in length is required to carry on board, and maintain for ready reference, a copy of the Inland Navigation Rules while operating on Inland waters, subject to a penalty for failure to comply of not more than \$5,000. Copies of the rules may be obtained from the Superintendent of Documents, U. S. Government Printing Office, Washington, D. C. 20402 (tel: (202) 783-3238). Stock number 050-012-00205-3, \$6.00 each.

## POLLUTION REGULATIONS

The Refuse Act of 1899 prohibits throwing, discharging or depositing any refuse matter of any kind (including trash, garbage, oil and other liquid pollutants) into the waters of the United States. The Federal Water Pollution Control Act prohibits the discharge of oil or hazardous substances which may be harmful into U. S. navigable waters. You must immediately notify the U. S. Coast Guard if your vessel discharges oil or hazardous substances into the water. Call toll-free 800-424-8802 (In Washington, D. C. (202) 267-2675). Report the following information:

- a. location      c. size      e. substance
- b. source        d. color     f. time observed

Avoid flame, physical contact or inhalation of fumes near any source of pollution.

Regulations issued under the Federal Water Pollution Control Act require all vessels with machinery propulsion to have a capacity to retain oily mixtures on board. A fixed or portable means to discharge oily waste to a reception facility is required. A bucket or bailer is suitable as a portable means of discharging oily waste on recreational vessels.

No person may intentionally drain oil or oily waste from any source into the bilge of any vessel.

Vessels 26 feet in length and over must display a placard at least 5 by 8 inches, made of durable material, fixed in a conspicuous place in the machinery spaces, or at the bilge pump control station, stating the following:

### DISCHARGE OF OIL PROHIBITED

The Federal Water Pollution Control Act prohibits the discharge of oil or oily waste into or upon the navigable waters of the United States or the waters of the contiguous zone if such discharge causes a film or sheen upon, or discoloration of, the surface of the water, or causes a sludge or emulsion beneath the surface of the water. Violators are subject to a penalty of \$5,000.

## Marine Sanitation Devices

All recreational boats with installed toilet facilities must have an operable marine sanitation device (MSD) on board. Vessels 65 feet and under may use a Type I, II or III MSD. Vessels over 65 feet must install a Type II or III MSD. All installed MSDs must be Coast Guard certified. Coast Guard certified devices are so labeled except for some holding tanks, which are certified by definition under the regulations.

## REPORTING BOATING ACCIDENTS

All boating accidents or accidents resulting from the use of related equipment (which meet the criteria below), must be reported by the operator or owner of the vessel to the proper marine law enforcement authority for the State in which the accident occurred.

**IMMEDIATE NOTIFICATION REQUIRED FOR FATAL ACCIDENTS.** If a person dies or disappears as a result of a recreational boating accident the nearest State boating authority must be notified without delay, providing the following information:

- Date, time and exact location of the accident;
- Name of each person who died or disappeared;
- Number and name of the vessel; and
- Names and addresses of the owner and operator.

**A FORMAL REPORT OF A FATALITY MUST BE FILED WITH IN 48 HOURS.** If, as a result of a boating or related equipment accident, a person sustains injuries that require more than first aid, a formal report must be filed.

**ACCIDENTS INVOLVING MORE THAN \$200 DAMAGE MUST BE REPORTED WITHIN 10 DAYS.** A formal report must be made if property damage exceeds \$200; or there is a complete loss of a vessel.

If you need further information regarding accident reporting, please call the Boating Safety Hotline, 800-268-5647.

## RENDERING ASSISTANCE

The master or person in charge of a vessel is obligated by law to provide assistance that can be safely provided to any individual at sea in danger of being lost, and is subject to a fine and/or imprisonment for failure to do so.

## ADDITIONAL EQUIPMENT AND ADVICE

As the operator and/or owner you are responsible for the prudent and safe operation of your vessel, and for the lives and safety of your passengers and others around you. You should become familiar with Federal, State and local rules and regulations regarding safe boat operation and attempt to learn and practice good seamanship, boathandling, navigation and piloting, etc.

Besides meeting the legal requirements, prudent boaters carry additional safety equipment.


## ADDITIONAL MEANS OF PROPULSION

Vessels less than 16 feet should carry alternate propulsion, such as a paddle or oars. If an alternate means of mechanical propulsion is carried it should use a separate fuel tank and starting source than the main propulsion motor.

## ANCHORING

All vessels should be equipped with an anchor and line of suitable size and length for the vessel and waters in which it is being operated. Choose the right anchor for your vessel and the type of bottom you expect to be anchoring in.

To anchor, bring the bow into the wind or current and put the engine in neutral. When the vessel comes to a stop, lower, do not throw, the anchor over the bow. The anchor line should be 5 to 7 times the depth of water.



Types of anchors



## STERN ANCHORING

Anchoring a small boat by the stern has caused many to capsize and sink. The transom is usually squared off and has less freeboard than the bow. In a current, the stern can be pulled under by the force of the water. The boat is also vulnerable to swamping by wave action. The weight of a motor, fuel tank, or other gear in the stern increases the risk. Do not anchor by the stern!!

## BAILER


All vessels should carry at least one effective manual device (portable bilge pump, bucket, scoop, etc.) for bailing water, in addition to any installed electric bilge pump.

## FIRST AID

As the operator of a small boat you should consider taking a First Aid course and becoming proficient in its application. A first aid kit and manual, bandages, gauze, adhesive tape, antiseptic, aspirin, etc. is suggested.

## LOADING YOUR VESSEL

Keep the load low and evenly distributed. Do not exceed the "U.S. Coast Guard Maximum Capacities" label. If there is no capacity label use the following formula to determine the maximum number of persons you can safely carry in calm weather:

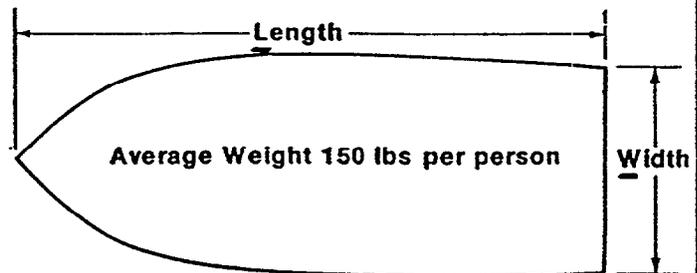

$$\text{People} = \frac{L \times W}{15}$$

Length is determined by measuring in a straight line from the foremost part to the aftermost of the vessel, parallel to the centerline, exclusive of sheer. Bowsprits, rudders, outboard motors and similar fittings are not included in the measurement.

### FUELING PRECAUTIONS

Fill portable tanks off the vessel. Close all hatches and other openings before fueling. Extinguish smoking materials. Secure all electrical equipment, radios, stoves and other appliances. Secure all engines and motors.

Wipe up any spilled fuel immediately. Open all hatches to air out the vessel. Run the blower five minutes, and then check the bilges for fuel vapors before starting the engine. NEVER start the engine until all traces of fuel vapors are eliminated.


### FUEL TANKS

Ensure portable fuel tanks are constructed of sturdy material and in good condition, free of excessive corrosion and do not leak. The vents on portable tanks must be operable and the tanks should have a vapor-tight, leak-proof cap. Do not allow excessive movement of portable tanks.

Permanent fuel tanks and lines should be free of corrosion and must not leak. Tanks must be vented to the outside of the hull. The fill pipe and plate must fit tightly and be located outside of closed compartments.

### FUEL MANAGEMENT

Practice the "One-Third Rule" by using one-third of the fuel going out, one-third to get back and one-third in reserve.

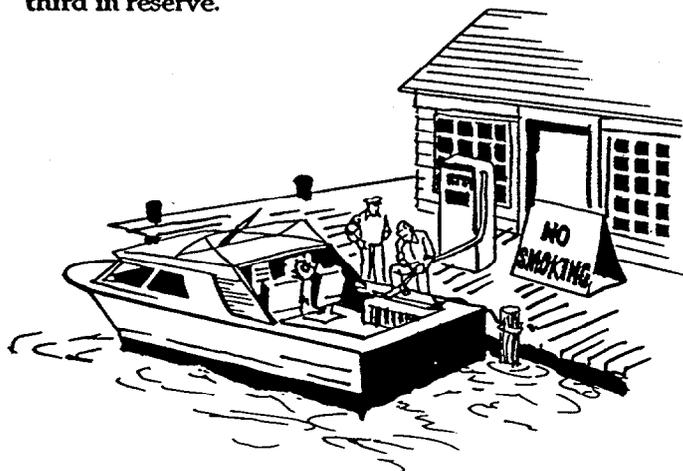

All equipment and supplies should be properly secured. Keep decks and other spaces clean, free of clutter and trash. The vessel should be free of fire hazards with clean bilges and in good condition. Inspection and required maintenance on a regular schedule will ensure the hull and superstructure remain sound. Ensure all repairs are made properly and with marine rated parts. You should carry a few tools, spare parts and learn how to make minor repairs.

### FLOAT PLAN

Tell a friend or relative where you are going and when you plan to return. Make sure they have a description of your vessel and other information that will make identification easier should the need arise. An example is provided on the inside front cover.

### WEATHER

Check weather reports before leaving shore and remain watchful for signs of bad weather. Become familiar with National Weather Service Storm Advisory Signals and know where they are displayed.

### SMALL BOATS AND WATER ACTIVITIES

Most hunters and anglers do not think of themselves as boaters. But many use small semi-v hull vessels, flatbottom jon boats or canoes to pursue their sport. These boats tend to be unstable and easily capsized. Capsizings, sinkings, and falls overboard account 70% of boating fatalities and are directly related to poor stability. These facts mean care must be used in operating small boats. You must have a greater awareness of the boat's limitations and the skill and knowledge to overcome them.

Standing in a small boat raises the center of gravity, often to the point of capsizing. Standing for any reason or even changing position in a small boat can be dangerous, as is sitting on the gunnels or seat backs or in a pedestal seat while underway. A wave or sudden turn may cause a fall overboard or capsizing because of the raised center of gravity.

## SURVIVAL TIPS

It is a common belief that someone dressed in heavy clothing or waders will sink immediately if they fall overboard. This is not true. Air trapped in clothing provides considerable flotation, bending the knees will trap air in waders, providing additional flotation. To stay afloat, remain calm, do not thrash about or try to remove clothing or footwear, this leads to exhaustion and increases the loss of air that keeps you afloat. Keep your knees bent, float on your back and paddle slowly to safety.

## HYPOTHERMIA

Hypothermia is the loss of body heat, immersion in water speeds the loss of heat. If your boat capsizes it will likely float on or just below the surface. Vessels built after 1978 will support you even if full of water or capsized. To reduce the effects of hypothermia get in or on the boat. Try to get as much of your body out of the water as possible. If you can't get in the boat a PFD will enable you to keep your head out of the water. This is very important because about 50% of body heat loss is from the head.

## SUDDEN DISAPPEARANCE SYNDROME

Sudden immersion in cold water can induce rapid, uncontrolled breathing, cardiac arrest, and other life-threatening situations which can result in drowning. Wearing a PFD will prevent this. If you must enter the water, button up your clothing, wear a PFD, cover your head if possible and enter the water slowly.

## COLD WATER DROWNING

It may be possible to revive a drowning victim who has been under water for considerable time and shows no signs of life. Increasingly numerous documented cases exist where victims have been resuscitated with no apparent harmful effects after long immersions. Start CPR immediately and get the victim to a hospital as quickly as possible.

## CONVERSION OF METRIC TO U. S. UNITS

Metric Measure	Feet in Decimals	Feet and Inches
50 Meters (M)	164.0 ft.	164'1/2"
20 Meters (M)	65.6 ft.	65'7 1/2"
12 M	39.4 ft.	39'4 1/2"
10 M	32.8 ft.	32'9 3/4"
8 M	26.2 ft.	26'3"
7 M	23.0 ft.	23'11 1/2"
6 M	19.7 ft.	19'8 1/4"
5 M	16.4 ft.	16'4 3/4"
4 M	13.1 ft.	13'1 1/2"
2.5 M	8.2 ft.	8'2 1/2"
1 M	3.3 ft.	3'3 1/4"

**Boating Safety is no accident. To build sound knowledge, proficiency and confidence, the keys to safe boating, take a boating safety course.**



**Coast Guard**

**Boating Safety Hotline:  
800-368-5647**

- ✓ For Boating Safety Recall Information.
- ✓ To Report Possible Safety Defects In Boats.
- ✓ For Answers To Boating Safety Questions.

**✓ Call, Toll Free!**

**For more information on boating safety and boating courses, contact your State Boating Agency, local Coast Guard District or call the Boating Safety Hotline.**

**Appendix B**  
**Material Safety Data Sheets**

---



# Genium Publishing Corporation

1145 Catalyn Street  
Schenectady, NY 12303-1836 USA  
(518) 377-8854

Sheet No. 316  
Benzene

Issued: 11/78

Revision: E, 8/90

## Section 1. Material Identification

**Benzene (C<sub>6</sub>H<sub>6</sub>) Description:** Derived by fractional distillation of coal tar, hydrodealkylation of toluene or pyrolysis of gasoline, catalytic reforming of petroleum, and transalkylation of toluene by disproportionation reaction. Used as a fuel; a chemical reagent; a solvent for a large number of materials such as paints, plastics, rubber, inks, oils, and fats; in manufacturing phenol, ethylbenzene (for styrene monomer), nitrobenzene (for aniline), dodecylbenzene (for detergents), cyclohexane (for nylon), chlorobenzene, diphenyl, benzene hexachloride, maleic anhydride, benzene-sulfonic acid, artificial leather, linoleum, oil cloth, varnishes, and lacquers; for printing and lithography; in dry cleaning; in adhesives and coatings; for extraction and rectification; as a degreasing agent; in the tire industry; and in shoe factories. Benzene has been banned as an ingredient in products intended for household use and is no longer used in pesticides.

**Other Designations:** CAS No. 0071-43-2, benzol, carbon oil, coal naphtha, cyclohexatriene, mineral naphtha, nitration benzene, phene, phenyl hydride, pyrobenzol.

**Manufacturer:** Contact your supplier or distributor. Consult the latest *Chemicalweek Buyers' Guide*<sup>(3)</sup> for a suppliers list.

R	1	NFPA
I	4	
S	2*	
K	4	
*Skin absorption		



HMS  
H 3  
F 3  
R 0  
PPG†  
† Sec. 8

**Cautions:** Benzene is a confirmed *human carcinogen* by the IARC. *Chronic low-level exposure may cause cancer (leukemia) and bone marrow damage, with injury to blood-forming tissue.* It is also a dangerous fire hazard when exposed to heat or flame.

## Section 2. Ingredients and Occupational Exposure Limits

Benzene, ca 100%\*

**1989 OSHA PELs**  
(29 CFR 1910.1000, Table Z-1-A)  
8-hr TWA: 1 ppm, 3 mg/m<sup>3</sup>  
15-min STEL: 5 ppm, 15 mg/m<sup>3</sup>

**1989-90 ACGIH**  
TLV-TWA: 10 ppm, 32 mg/m<sup>3</sup>

**1985-86 Toxicity Data†**  
Man, oral, LD<sub>50</sub>: 50 mg/kg; no toxic effect noted  
Man, inhalation, TC<sub>50</sub>: 150 ppm inhaled intermittently over 1 yr in a number of discrete, separate doses affects the blood (other changes) and nutritional and gross metabolism (body temperature increase)  
Rabbit, eye: 2 mg administered over 24 hr produces severe irritation

(29 CFR 1910.1000, Table Z-2)  
8-hr TWA: 10 ppm  
Acceptable Ceiling Concentration: 25 ppm  
Acceptable Maximum Peak: 50 ppm (10 min)†

**1988 NIOSH RELs**  
TWA: 0.1 ppm, 0.3 mg/m<sup>3</sup>  
Ceiling: 1 ppm, 3 mg/m<sup>3</sup>

\* OSHA 29 CFR 1910.1000, Subpart Z, states that the final benzene standard in 29 CFR 1910.1028 applies to all occupational exposures to benzene except in some subsegments of industry where exposures are consistently under the action level (i.e., distribution and sale of fuels, sealed containers and pipelines, coke production, oil and gas drilling and production, natural gas processing, and the percentage exclusion for liquid mixtures); for the excepted subsegments, the benzene limits in Table Z-2 apply.

† Acceptable maximum peak above the acceptable ceiling concentration for an 8-hr shift.

‡ See NIOSH, *RTECS* (CY1400000), for additional irritative, mutative, reproductive, tumorigenic, and toxicity data.

## Section 3. Physical Data

Boiling Point: 176 °F (80 °C)  
Melting Point: 42 °F (5.5 °C)  
Vapor Pressure: 100 mm Hg at 79 °F (26.1 °C)  
Vapor Density (Air = 1): 2.7  
Evaporation Rate (Ether = 1): 2.8

Molecular Weight: 78.11  
Specific Gravity (15 °C/4 °C): 0.8787  
Water Solubility: Slightly (0.180 g/100 g of H<sub>2</sub>O at 25 °C)  
% Volatile by Volume: 100  
Viscosity: 0.6468 mPa at 20 °C

**Appearance and Odor:** A colorless liquid with a characteristic sweet, aromatic odor. The odor recognition threshold (100% of panel) is approximately 5 ppm (unfatigued) in air. Odor is *not* an adequate warning of hazard.

## Section 4. Fire and Explosion Data

Flash Point: 12 °F (-11.1 °C), CC      Autoignition Temperature: 928 °F (498 °C)      LEL: 1.3% v/v      UEL: 7.1% v/v

**Extinguishing Media:** Use dry chemical, foam, or carbon dioxide to extinguish benzene fires. Water may be ineffective as an extinguishing agent since it can scatter and spread the fire. Use water spray to cool fire-exposed containers, flush spills away from exposures, disperse benzene vapor, and protect personnel attempting to stop an unignited benzene leak.

**Unusual Fire or Explosion Hazards:** Benzene is a Class 1B flammable liquid. A concentration exceeding 3250 ppm is considered a potential fire explosion hazard. Benzene vapor is heavier than air and can collect in low lying areas or travel to an ignition source and flash back. Explosive and flammable benzene vapor-air mixtures can easily form at room temperature. Eliminate all ignition sources where benzene is used, handled, or stored.

**Special Fire-fighting Procedures:** Isolate hazard area and deny entry. Since fire may produce toxic fumes, wear a self-contained breathing apparatus (SCBA) with a full facepiece operated in the pressure-demand or positive-pressure mode and full protective equipment. Structural firefighter's protective clothing provides limited protection. Stay out of low areas. Be aware of runoff from fire control methods. Do not release to sewers or waterways. Runoff to sewer can create pollution, fire, and explosion hazard.

## Section 5. Reactivity Data

**Stability/Polymerization:** Benzene is stable at room temperature in closed containers under normal storage and handling conditions. Hazardous polymerization cannot occur.

**Chemical Incompatibilities:** Benzene explodes on contact with diborane, permanganic acid, bromine pentafluoride, peroxodisulfuric acid, and peroxomonosulfuric acid. It ignites on contact with dioxygen difluoride, dioxygenyl tetrafluoroborate, iodine heptafluoride, and sodium peroxide + water. Benzene forms sensitive, explosive mixture with iodine pentafluoride, ozone, liquid oxygen, silver perchlorate, nitril perchlorate, nitric acid, and arsenic pentafluoride + potassium methoxide (explodes above 30 °C). A vigorous or incandescent reaction occurs with bromine trifluoride, uranium hexafluoride, and hydrogen + Raney nickel [above 410 °F (210 °C)]. Benzene is incompatible with oxidizing materials.

**Conditions to Avoid:** Avoid heat and ignition sources.

**Hazardous Products of Decomposition:** Thermal oxidative decomposition of benzene can produce toxic gases and vapors such as carbon monoxide.

**Section 6. Health Hazard Data**

**Carcinogenicity:** The ACGIH, OSHA, and IARC list benzene as, respectively, a suspected human carcinogen, a cancer hazard, and, based on sufficient human and animal evidence, a human carcinogen (Group 1).

**Summary of Risks:** Prolonged skin contact or excessive inhalation of benzene vapor may cause headache, weakness, appetite loss, and fatigue. The most important health hazards are cancer (leukemia) and bone marrow damage with injury to blood-forming tissue from chronic low-level exposure. Higher level exposures may irritate the respiratory tract and cause central nervous system (CNS) depression.

**Medical Conditions Aggravated by Long-Term Exposure:** Exposure may worsen ailments of the heart, lungs, liver, kidneys, blood, and CNS.

**Target Organs:** Blood, central nervous system, bone marrow, eyes, upper respiratory tract, and skin.

**Primary Entry Routes:** Inhalation, skin contact.

**Acute Effects:** Symptoms of acute overexposure include irritation of the eyes, nose, and respiratory tract, breathlessness, euphoria, nausea, drowsiness, headache, dizziness, and intoxication. Severe exposure may lead to convulsions and unconsciousness. Skin contact may cause a drying rash (dermatitis).

**Chronic Effects:** Long-term chronic exposure may result in many blood disorders ranging from aplastic anemia (an inability to form blood cells) to leukemia.

**FIRST AID**

**Eyes:** Gently lift the eyelids and flush immediately and continuously with flooding amounts of water until transported to an emergency medical facility. Consult a physician immediately.

**Skin:** Quickly remove contaminated clothing. Immediately rinse with flooding amounts of water for at least 15 min. For reddened or blistered skin, consult a physician. Wash affected area with soap and water.

**Inhalation:** Remove exposed person to fresh air. Emergency personnel should protect against inhalation exposure. Provide CPR to support breathing or circulation as necessary. Keep awake and transport to a medical facility.

**Ingestion:** Never give anything by mouth to an unconscious or convulsing person. If ingested, *do not induce vomiting* since aspiration may be fatal. Call a physician immediately.

After first aid, get appropriate in-plant, paramedic, or community medical support.

**Physician's Note:** Evaluate chronic exposure with a CBC, peripheral smear, and reticulocyte count for signs of myelotoxicity. Follow up any early indicators of leukemia with a bone marrow biopsy. Urinary phenol conjugates may be used for biological monitoring of recent exposure. Acute management is primarily supportive for CNS depression.

**Section 7. Spill, Leak, and Disposal Procedures**

**Spill/Leak:** Design and practice a benzene spill control and countermeasure plan (SCCP). Notify safety personnel, evacuate all unnecessary personnel, eliminate all heat and ignition sources, and provide adequate ventilation. Cleanup personnel should protect against vapor inhalation, eye contact, and skin absorption. Absorb as much benzene as possible with an inert, noncombustible material. For large spills, dike far ahead of spill and contain liquid. Use nonsparking tools to place waste liquid or absorbent into closable containers for disposal. Keep waste out of confined spaces such as sewers, watersheds, and waterways because of explosion danger. Follow applicable OSHA regulations (29 CFR 1910.120).

**Disposal:** Contact your supplier or a licensed contractor for detailed recommendations. Follow applicable Federal, state, and local regulations.

**EPA Designations**

Listed as a RCRA Hazardous Waste (40 CFR 261.33), Hazardous Waste No. U019

Listed as a CERCLA Hazardous Substance\* (40 CFR 302.4), Reportable Quantity (RQ): 1000 lb (454 kg) [\* per Clean Water Act, Sec. 307 (a), 311 (b)(4), 112; and per RCRA, Sec. 3001]

SARA Extremely Hazardous Substance (40 CFR 355): Not listed

Listed as SARA Toxic Chemical (40 CFR 372.65)

**OSHA Designations**

Listed as an Air Contaminant (29 CFR 1910.1000, Tables Z-1-A and Z-2)

**Section 8. Special Protection Data**

**Goggles:** Wear protective eyeglasses or chemical safety goggles, per OSHA eye- and face-protection regulations (29 CFR 1910.133).

**Respirator:** Seek professional advice prior to respirator selection and use. Follow OSHA respirator regulations (29 CFR 1910.134) and, if necessary, wear a NIOSH-approved respirator. For emergency or nonroutine operations (cleaning spills, reactor vessels, or storage tanks), wear an SCBA. **Warning! Air-purifying respirators do not protect workers in oxygen-deficient atmospheres.**

**Other:** Wear impervious gloves, boots, aprons, and gauntlets to prevent skin contact.

**Ventilation:** Provide general and local explosion-proof ventilation systems to maintain airborne concentrations at least below the OSHA PELs (Sec. 2). Local exhaust ventilation is preferred since it prevents contaminant dispersion into the work area by controlling it at its source.<sup>(10)</sup>

**Safety Stations:** Make available in the work area emergency eyewash stations, safety/quick-drench showers, and washing facilities.

**Contaminated Equipment:** Never wear contact lenses in the work area: soft lenses may absorb, and all lenses concentrate, irritants. Remove this material from your shoes and equipment. Launder contaminated clothing before wearing.

**Comments:** Never eat, drink, or smoke in work areas. Practice good personal hygiene after using this material, especially before eating, drinking, smoking, using the toilet, or applying cosmetics.

**Section 9. Special Precautions and Comments**

**Storage Requirements:** Store in tightly closed containers in a cool, dry, well-ventilated area away from all heat and ignition sources and incompatible materials. **Caution! Benzene vapor may form explosive mixtures in air.** To prevent static sparks, electrically ground and bond all containers and equipment used in shipping, receiving, or transferring operations in production and storage areas. When opening or closing benzene containers, use nonsparking tools. Keep fire extinguishers readily available.

**Engineering Controls:** Because OSHA specifically regulates benzene (29 CFR 1910.1028), educate workers about its potential hazards and dangers. Minimize all possible exposures to carcinogens. If possible, substitute less toxic solvents for benzene; use this material with extreme caution and only if absolutely essential. Avoid vapor inhalation and skin and eye contact. Use only with adequate ventilation and appropriate personal protective gear. Institute a respiratory protection program that includes regular training, maintenance, inspection, and evaluation.

Designate regulated areas of benzene use (see legend in the box below) and label benzene containers with "DANGER, CONTAINS BENZENE, CANCER HAZARD."

**Other Precautions:** Provide preplacement and periodic medical examinations with emphasis on a history of blood disease or previous exposure.

**Transportation Data (49 CFR 172.101, .102)**

DOT Shipping Name: Benzene (benzol)

DOT Hazard Class: Flammable liquid

ID No.: UN1114

DOT Label: Flammable liquid

DOT Packaging Exceptions: 173.118

DOT Packaging Requirements: 173.119

IMO Shipping Name: Benzene

IMO Hazard Class: 3.2

ID No.: UN1114

IMO Label: Flammable liquid

IMDG Packaging Group: II

DANGER
BENZENE
CANCER HAZARD
FLAMMABLE-NO SMOKING
AUTHORIZED PERSONNEL ONLY
RESPIRATOR REQUIRED

**MSDS Collection References:** 1, 2, 12, 26, 73, 84-94, 100, 101, 103, 109, 124, 126, 127, 132, 134, 136, 138, 139, 143

**Prepared by:** MJ Allison, BS; **Industrial Hygiene Review:** DJ Wilson, CIH; **Medical Review:** MJ Upfal, MD, MPH; **Edited by:** JR Stuart, MS



**Genium Publishing Corporation**  
 1145 Catalyn Street  
 Schenectady, NY 12303-1836 USA  
 (518) 377-8854

Material Safety Data Sheets Collection:

Sheet No. 470  
 Diesel Fuel Oil No. 2-D

Issued: 10/81 Revision: A, 11/90

**Section 1. Material Identification**

33

**Diesel Fuel Oil No. 2-D Description:** Diesel fuel is obtained from the middle distillate in petroleum separation; a distillate oil of low sulfur content. It is composed chiefly of unbranched paraffins. Diesel fuel is available in various grades, one of which is synonymous with fuel oil No. 2-D. This diesel fuel oil requires a minimum Cetane No. (efficiency rating for diesel fuel comparable to octane number ratings for gasoline) of 40 (ASTM D613). Used as a fuel for trucks, ships, and other automotive engines; as mosquito control (coating on breeding waters); and for drilling muds.  
**Other Designations:** CAS No. 68334-30-5, diesel fuel.  
**Manufacturer:** Contact your supplier or distributor. Consult the latest *Chemicalweek Buyers' Guide*<sup>(73)</sup> for a suppliers list.

R	1	
I	-	
S	2	
K	2	

NFPA  
 HMIS  
 H 0  
 F 2  
 R 0  
 PPG\*  
 \* Sec. 8

**Cautions:** Diesel fuel oil No. 2-D is a skin irritant and central nervous depressant with high mist concentrations. It is an environmental hazard and moderate fire risk.

**Section 2. Ingredients and Occupational Exposure Limits**

Diesel fuel oil No. 2-D\*

1989 OSHA PEL	1990-91 ACGIH TLV	1988 NIOSH REL	1985-86 Toxicity Data†
None established	Mineral Oil Mist TWA: 5 mg/m <sup>3</sup> † STEL: 10 mg/m <sup>3</sup>	None established	Rat, oral, LD <sub>50</sub> : 9 g/kg produces gastrointestinal (hypermotility, diarrhea) effects

\* Diesel fuel No. 2-D tends to be low in aromatics and high in paraffinics. This fuel oil is complex mixture of: 1) >95% paraffinic, olefinic, naphthenic, and aromatic hydrocarbons, 2) sulfur (<0.5%), and 3) benzene (<100 ppm). [A low benzene level reduces carcinogenic risk. Fuel oils can be exempted under the benzene standard (29 CFR 1910.1028)]. Although low in the fuel itself, benzene concentrations are likely to be much higher in processing areas.

† As sampled by nonvapor-collecting method.

‡ Monitor NIOSH, RTECS (HZ1800000), for future toxicity data.

**Section 3. Physical Data**

**Boiling Point Range:** 340 to 675 °F (171 to 358 °C)      **Specific Gravity:** <0.86  
**Viscosity:** 1.9 to 4.1 centistoke at 104 °F (40 °C)      **Water Solubility:** Insoluble  
**Appearance and Odor:** Brown, slightly viscous liquid.

**Section 4. Fire and Explosion Data**

**Flash Point:** 125 °F (52 °C) min.      **Autolgnition Temperature:** >500 °F (932 °C)      **LEL:** 0.6% v/v      **UEL:** 7.5% v/v

**Extinguishing Media:** Use dry chemical, carbon dioxide, or foam to fight fire. Use a water spray to cool fire exposed containers. Do not use a forced water spray directly on burning oil since this will scatter the fire. Use a smothering technique for extinguishing fire.

**Unusual Fire or Explosion Hazards:** Diesel fuel oil No. 2-D is a OSHA Class II combustible liquid. Its volatility is similar to that of gas oil. Vapors may travel to a source of ignition and flash back.

**Special Fire-fighting Procedures:** Isolate hazard area and deny entry. Since fire may produce toxic fumes, wear a self-contained breathing apparatus (SCBA) with a full facepiece operated in the pressure-demand or positive-pressure mode and full protective clothing. If feasible, remove containers from fire. Be aware of runoff from fire control methods. Do not release to sewers or waterways due to pollution and fire or explosion hazard.

**Section 5. Reactivity Data**

**Stability/Polymerization:** Diesel fuel oil No. 2-D is stable at room temperature in closed containers under normal storage and handling conditions. Hazardous polymerization cannot occur.

**Chemical Incompatibilities:** It is incompatible with strong oxidizing agents; heating greatly increases the fire hazard.

**Conditions to Avoid:** Avoid heat and ignition sources.

**Hazardous Products of Decomposition:** Thermal oxidative decomposition of diesel fuel oil No. 2-D can produce various hydrocarbons and hydrocarbon derivatives, and other partial oxidation products such as carbon dioxide, carbon monoxide, and sulfur dioxide.

**Section 6. Health Hazard Data**

**Carcinogenicity:** Although the IARC has not assigned an overall evaluation to diesel fuels as a group, it has evaluated occupational exposures in petroleum refining as an IARC probable human carcinogen (Group 2A). It has evaluated distillate (light) diesel oils as not classifiable as human carcinogens (Group 3).

**Summary of Risks:** Although diesel fuel's toxicologic effects should resemble kerosine's, they are somewhat more pronounced due to additives such as sulfurized esters. Excessive inhalation of aerosol or mist can cause respiratory tract irritation, headache, dizziness, nausea, vomiting, and loss of coordination, depending on concentration and exposure time. When removed from exposure area, affected persons usually recover completely. If vomiting occurs after ingestion and if oil is aspirated into the lungs, hemorrhaging and pulmonary edema, progressing to renal involvement and chemical pneumonitis, may result. A comparative ratio of oral to aspirated lethal doses may be 1 pt vs. 5 ml. Aspiration may also result in transient CNS depression or excitement. Secondary effects may include hypoxia (insufficient oxygen in body cells), infection, pneumatocele formation, and chronic lung dysfunction. Inhalation may result in euphoria, cardiac dysrhythmias, respiratory arrest, and CNS toxicity. Prolonged or repeated skin contact may irritate hair follicles and block sebaceous glands, producing a rash of acne pimples and spots, usually on arms and legs.

**Medical Conditions Aggravated by Long-Term Exposure:** None reported.

**Target Organs:** Central nervous system, skin, and mucous membranes.

**Primary Entry Routes:** Inhalation, ingestion.

**Acute Effects:** Systemic effects from ingestion include gastrointestinal irritation, vomiting, diarrhea, and in severe cases central nervous system depression, progressing to coma or death. Inhalation of aerosols or mists may result in increased rate of respiration, tachycardia (excessively rapid heart beat), and cyanosis (dark purplish discoloration of the skin and mucous membranes caused by deficient blood oxygenation).

**Chronic Effects:** Repeated contact with the skin causes dermatitis.

**FIRST AID**

**Eyes:** Gently lift the eyelids and flush immediately and continuously with flooding amounts of water until transported to an emergency medical facility. Consult a physician immediately.

**Skin:** Quickly remove contaminated clothing. Rinse with flooding amounts of water for at least 15 min. If large areas of the body have been exposed or if irritation persists, get medical help immediately. Wash affected area with soap and water.

**Inhalation:** Remove exposed person to fresh air and support breathing as needed.

**Ingestion:** Never give anything by mouth to an unconscious or convulsing person. If ingested, *do not induce vomiting* due to aspiration hazard.

Contact a physician immediately. Position to avoid aspiration.

After first aid, get appropriate in-plant, paramedic, or community medical support.

**Note to Physicians:** Gastric lavage is contraindicated due to aspiration hazard. Preferred antidotes are charcoal and milk. In cases of severe aspiration pneumonitis, consider monitoring arterial blood gases to ensure adequate ventilation. Observe the patient for 6 hr. If vital signs become abnormal or symptoms develop, obtain a chest x-ray.

**Section 7. Spill, Leak, and Disposal Procedures**

**Spill/Leak:** Notify safety personnel, evacuate area for large spills, remove all heat and ignition sources, and provide maximum explosion-proof ventilation. Cleanup personnel should protect against vapor inhalation and liquid contact. Clean up spills promptly to reduce fire or vapor hazards. Use a noncombustible absorbent material to pick up small spills or residues. For large spills, dike far ahead to contain. Pick up liquid for reclamation or disposal. Do not release to sewers or waterways due to health and fire and/or explosion hazard. Follow applicable OSHA regulations (29 CFR 1910.120). Diesel fuel oil No. 2-D spills may be environmental hazards. Report large spills.

**Disposal:** Contact your supplier or a licensed contractor for detailed recommendations. Follow applicable Federal, state, and local regulations.

**EPA Designations**

RCRA Hazardous Waste (40 CFR 261.21): Ignitable waste

CERCLA Hazardous Substance (40 CFR 302.4): Not listed

SARA Extremely Hazardous Substance (40 CFR 355): Not listed

SARA Toxic Chemical (40 CFR 372.65): Not listed

**OSHA Designations**

Air Contaminant (29 CFR 1910.1000, Subpart Z): Not listed

**Section 8. Special Protection Data**

**Goggles:** Wear protective eyeglasses or chemical safety goggles, per OSHA eye- and face-protection regulations (29 CFR 1910.133).

**Respirator:** Seek professional advice prior to respirator selection and use. Follow OSHA respirator regulations (29 CFR 1910.134) and, if necessary, use a NIOSH-approved respirator with a mist filter and organic vapor cartridge. For emergency or nonroutine operations (cleaning spills, reactor vessels, or storage tanks), wear an SCBA. *Warning! Air-purifying respirators do not protect workers in oxygen-deficient atmospheres.*

**Other:** Wear impervious gloves, boots, aprons, and gauntlets to prevent skin contact.

**Ventilation:** Provide general and local explosion-proof ventilation systems to maintain airborne concentrations that promote worker safety and productivity. Local exhaust ventilation is preferred since it prevents contaminant dispersion into the work area by controlling it at its source.<sup>(10)</sup>

**Safety Stations:** Make available in the work area emergency eyewash stations, safety/quick-drench showers, and washing facilities.

**Contaminated Equipment:** Never wear contact lenses in the work area: soft lenses may absorb, and all lenses concentrate, irritants. Remove this material from your shoes and equipment. Launder contaminated clothing before wearing.

**Comments:** Never eat, drink, or smoke in work areas. Practice good personal hygiene after using this material, especially before eating, drinking, smoking, using the toilet, or applying cosmetics.

**Section 9. Special Precautions and Comments**

**Storage Requirements:** Use and storage conditions should be suitable for a OSHA Class II combustible liquid. Store in closed containers in a well-ventilated area away from heat and ignition sources and strong oxidizing agents. Protect containers from physical damage. To prevent static sparks, electrically ground and bond all containers and equipment used in shipping, receiving, or transferring operations. Use nonsparking tools and explosion-proof electrical equipment. No smoking in storage or use areas.

**Engineering Controls:** Avoid vapor or mist inhalation and prolonged skin contact. Wear protective rubber gloves and chemical safety glasses where contact with liquid or high mist concentration may occur. Additional suitable protective clothing may be required depending on working conditions. Institute a respiratory protection program that includes regular training, maintenance, inspection, and evaluation. Practice good personal hygiene and housekeeping procedures. Do not wear oil contaminated clothing. At least weekly laundering of work clothes is recommended. Do not put oily rags in pockets. When working with this material, wear gloves or use barrier cream.

**Transportation Data (49 CFR 172.101)**

DOT Shipping Name: Fuel oil

DOT Hazard Class: Combustible liquid

ID No.: NA1993

DOT Label: None

DOT Packaging Exceptions: 173.118a

DOT Packaging Requirements: None

**MSDS Collection References:** 1, 6, 7, 12, 73, 84, 101, 103, 126, 127, 132, 133, 136, 143, 146

**Prepared by:** MJ Allison, BS; **Industrial Hygiene Review:** DJ Wilson, CIH; **Medical Review:** AC Darlington, MD; **Edited by:** JR Stuart, MS



Genium Publishing Corporation

One Genium Plaza  
Schenectady, NY 12304-4690 USA  
(518) 377-8854

Material Safety Data Sheets Collection:

Sheet No. 385  
Ethylbenzene

Issued: 8/78

Revision: B, 9/92

**Section 1. Material Identification**

**Ethylbenzene (C<sub>6</sub>H<sub>5</sub>C<sub>2</sub>H<sub>5</sub>) Description:** Derived by heating benzene and ethylene in presence of aluminum chloride with subsequent distillation, by fractionation directly from the mixed xylene stream in petroleum refining, or dehydrogenation of naphthenes. Used as a solvent, an antiknock agent in gasoline; and as an intermediate in production of synthetic rubber, styrene, cellulose acetate, diethylbenzene, acetophenone, ethyl anthraquinone, propyl oxide, and  $\alpha$ -methylbenzol alcohol. Other Designations: CAS No. 100-41-4, ethylbenzol, EB, phenylethane, NCI-C56393. Manufacturer: Contact your supplier or distributor. Consult latest *Chemical Week Buyers' Guide*<sup>(73)</sup> for a suppliers list.

R	1		NFPA
I	3		
S	2*		
K	4		
* Skin absorption			HMS
			H 2+
			F 3
			R 0
			PPE - Sec. 8
			† Chronic effects

**Cautions:** Ethylbenzene is a skin and mucous membrane irritant considered the most irritating of the benzene series. Inhalation causes acute and chronic central nervous system (CNS) effects. It is highly flammable and forms explosive mixtures with air.

**Section 2. Ingredients and Occupational Exposure Limits**

Ethylbenzene, ca >99.0%. Impurities include ~ 0.1% *meta* & *para* xylene, ~ 0.1% cumene, and ~ 0.1% toluene.

**1991 OSHA PELs**  
8-hr TWA: 100 ppm (435 mg/m<sup>3</sup>)  
15-min STEL: 125 ppm (545 mg/m<sup>3</sup>)  
Action Level: 50 ppm (217 mg/m<sup>3</sup>)

**1990 IDLH Level**  
2000 ppm

**1990 NIOSH REL**  
TWA: 100 ppm (435 mg/m<sup>3</sup>)  
STEL: 125 ppm (545 mg/m<sup>3</sup>)

**1992-93 ACGIH TLVs**  
TWA: 100 ppm (434 mg/m<sup>3</sup>)  
STEL: 125 ppm (545 mg/m<sup>3</sup>)

**1990 DFG (Germany) MAK**  
TWA: 100 ppm (440 mg/m<sup>3</sup>)  
Category 1: local irritants  
Peak Exposure Limit: 200 ppm, 5 min momentary value, max of 8/shift  
Danger of cutaneous absorption

**1985-86 Toxicity Data\***  
Human, inhalation, TC<sub>Lo</sub>: 100 ppm/8 hr caused eye effects, sleep, and respiratory changes.  
Human, lymphocyte: 1 mmol/L induced sister chromatid exchange.  
Rat, oral, LD<sub>50</sub>: 3500 mg/kg; toxic effects not yet reviewed  
Rat (female), inhalation, TC<sub>Lo</sub>: 1000 ppm/7 hr/day, 5 days/wk, for 3 wk prior to mating and daily for 19 days of gestation produced pups with high incidence of extra ribs.<sup>(179)</sup>

\* See NIOSH, RTECS (DA0700000), for additional irritation, mutation, reproductive, and toxicity data.

**Section 3. Physical Data**

**Boiling Point:** 277 °F (136 °C)  
**Melting Point:** -139 °F (-95 °C)  
**Surface Tension:** 31.5 dyne/cm  
**Ionization Potential:** 8.76 eV  
**Viscosity:** 0.64 cP at 77 °F (25 °C)  
**Refraction Index:** 1.4959 at 68 °F (20 °C)  
**Relative Evaporation Rate (ether = 1):** 0.0106  
**Bulk Density:** 7.21 lb/Gal at 77 °F (25 °C)  
**Critical Temperature:** 651 °F (343.9 °C)  
**Critical Pressure:** 35.6 atm

**Molecular Weight:** 106.16  
**Density:** 0.863 at 77 °F (25 °C)  
**Water Solubility:** Slightly, 14 mg/100 mL at 59 °F (15 °C)  
**Other Solubilities:** Miscible in alcohol, ether; soluble in carbon tetrachloride, benzene, sulfur dioxide, and many organic solvents; insoluble in ammonia  
**Odor Threshold:** 2.3 ppm  
**Vapor Pressure:** 7.1 mm Hg at 68 °F (20 °C); 10 mmHg at 78.62 °F (25.9 °C); 100 mm Hg 165.38 °F (74.1 °C)  
**Saturated Vapor Density (Air = 0.075 lb/ft<sup>3</sup> or 1.2 kg/m<sup>3</sup>):** 0.0768 lb/ft<sup>3</sup> or 1.2298 kg/m<sup>3</sup>

**Appearance and Odor:** Colorless, flammable liquid with a pungent odor.

**Section 4. Fire and Explosion Data**

**Flash Point:** 64 °F (18 °C) CC      **Autoignition Temperature:** 810 °F (432 °C)      **LEL:** 1.0% v/v      **UEL:** 6.7% v/v

**Extinguishing Media:** Class 1B Flammable liquid. For small fires, use dry chemical, carbon dioxide, or 'alcohol-resistant' foam. For large fires, use fog or 'alcohol-resistant' foam. Use water only if other agents are unavailable; EB floats on water and may travel to an ignition source and spread fire. Unusual Fire or Explosion Hazards: Burning rate = 5.8 mm/min. Vapors may travel to an ignition source and flash back. Container may explode in heat of fire. EB poses a vapor explosion hazard indoors, outdoors, and in sewers. Special Fire-fighting Procedures: Because fire may produce toxic thermal decomposition products, wear a self-contained breathing apparatus (SCBA) with a full facepiece operated in pressure-demand or positive-pressure mode. Cool container sides with water until well after fire is out. Stay away from ends of tanks. For massive fire in cargo area, use monitor nozzles or unmanned hose holders; if impossible, withdraw from area and let fire burn. Withdraw immediately if you hear rising sound from venting safety device or notice any tank discoloration due to fire. Do not release runoff from fire control methods to sewers or waterways.

**Section 5. Reactivity Data**

**Stability/Polymerization:** Ethylbenzene is stable at room temperature in closed containers under normal storage and handling conditions. Hazardous polymerization cannot occur.  
**Chemical Incompatibilities:** Reacts vigorously with oxidizers.  
**Conditions to Avoid:** Exposure to heat and oxidizers.  
**Hazardous Products of Decomposition:** Thermal oxidative decomposition of EB can produce acrid smoke and irritating fumes.

**Section 6. Health Hazard Data**

**Carcinogenicity:** The IARC,<sup>(164)</sup> NTP,<sup>(169)</sup> and OSHA<sup>(164)</sup> do not list EB as a carcinogen. Summary of Risks: Occupational exposure to EB alone is rare since it is usually present together with other solvents. EB is irritating to the eyes, skin, and respiratory tract. Vapor inhalation produces varying degrees of CNS effects depending on concentration. The liquid is absorbed through the skin but vapors are not. 56 to 64% of inhaled ethylbenzene is retained and metabolized. Urinary metabolites following exposure to 23 to 85 ppm for 8 hr are mandelic acid (64%), phenylglyoxylic acid (25%), and methylphenylcarbinol/1-phenyl ethanol (5%). Concurrent exposure to xylene and ethylbenzene causes slower excretion of EB metabolites. Based on the rat LD<sub>50</sub>, one manufacturer gives 3 to 4 oz. as the lethal dose for a 100 lb person.

Continue on next page

**Section 6. Health Hazard Data**

**Medical Conditions Aggravated by Long-Term Exposure:** Skin and CNS diseases and impaired pulmonary function (especially obstructive airway disease). **Target Organs:** Eyes, respiratory system, skin, CNS, blood. **Primary Entry Routes:** Inhalation, skin and eye contact. **Acute Effects:** Vapor inhalation of 200 ppm caused transient eye irritation; 1000 ppm caused eye irritation with profuse watering (tolerance developed rapidly); 2000 ppm caused severe and immediate eye irritation and watering, nasal irritation, chest constriction, and vertigo; 5000 ppm was intolerable and caused eye and nose irritation. Inhalation of high concentrations may cause narcosis, cramps, and death due to respiratory paralysis. Skin exposed to pure ethylbenzene for 10 to 15 min absorbed 22 to 33 mg/cm<sup>2</sup>/hr. Immersion of hand in solutions of 112 & 156 mg/L for 1 hr absorbed 118 & 215.7 µg/cm<sup>2</sup>/hr, respectively. **Chronic Effects:** Repeated skin contact may cause dryness, scaling, and fissuring. Workers chronically exposed to > 100 ppm complained of fatigue, sleepiness, headache, and mild irritation of the eyes and respiratory tract. Repeated vapor inhalation may result in blood disorders, particularly leukopenia (abnormally low level of white blood cells) and lymphocytosis.

**FIRST AID**

**Eyes:** Do not allow victim to rub or keep eyes tightly shut. Gently lift eyelids and flush immediately and continuously with flooding amounts of water until transported to an emergency medical facility. Consult a physician immediately. **Skin:** Quickly remove contaminated clothing. Rinse with flooding amounts of water for at least 15 min. Wash exposed area with soap and water. For reddened or blistered skin, consult a physician. **Inhalation:** Remove exposed person to fresh air and support breathing as needed. **Ingestion:** Never give anything by mouth to an unconscious or convulsing person. Contact a poison control center and unless otherwise advised, have that conscious and alert person drink 1 to 2 glasses of water to dilute. Do not induce vomiting! Aspiration of even a small amount of EB in vomitus can cause severe damage since its low viscosity and surface tension will cause it to spread over a large area of the lung tissue.

After first aid, get appropriate in-plant, paramedic, or community medical support.

**Note to Physicians:** BEI = mandelic acid in urine (1.5 g/g of creatinine), sample at end of shift at workweeks end. Since this test is not specific, test for EB in expired air for confirmation.

**Section 7. Spill, Leak, and Disposal Procedures**

**Spill/Leak:** Notify safety personnel. Isolate and ventilate area, deny entry and stay upwind. Shut off all ignition sources. Cleanup personnel should protect against vapor inhalation and skin/eye contact. Take up small spills with earth, sand, vermiculite, or other absorbent, noncombustible material and place in suitable container. Dike far ahead of large spill for later reclamation or disposal. Report any release >1000 lb. Follow applicable OSHA regulations (29 CFR 1910.120). **Environmental Transport:** If released to soil, EB partially evaporates into the atmosphere, with a half-life of hrs to wks, and some leaches into groundwater, especially in soil with low organic carbon content. Biodegradation occurs with a half-life of 2 days. Some EB may absorb to sediment or bioconcentrate in fish. Evidence points to slow biodegradation in groundwater. In air, it reacts with photochemically produced hydroxyl radicals with a half-life of hrs to 2 days. Additional amounts may be removed by rain. **Ecotoxicity Values:** Shrimp (*Mysidopsis bahia*), LC<sub>50</sub> = 87.6 mg/L/96 hr; sheepshead minnow (*Cyprinodon variegatus*) LC<sub>50</sub> = 275 mg/L/96 hr; fathead minnow (*Pimephales promelas*) LC<sub>50</sub> = 42.3 mg/L/96 hr in hard water & 48.5 mg/L/96 hr in softwater. **Disposal:** A candidate for rotary kiln incineration at 1508 to 2912°F (820 to 1600°C), liquid injection incineration at 1202 to 2912°F (650 to 1600°C), and fluidized bed incineration at 842 to 1796°F (450 to 980°C). Contact your supplier or a licensed contractor for detailed recommendations. Follow applicable Federal, state, and local regulations.

**EPA Designations**

Listed as a RCRA Hazardous Waste (40 CFR 261.21): No. D001

Listed as a SARA Toxic Chemical (40 CFR 372.65)

SARA Extremely Hazardous Substance (40 CFR 355), TPQ: Not listed

Listed as a CERCLA Hazardous Substance\* (40 CFR 302.4): Final Reportable Quantity (RQ), 1000 lb (454 kg) [\* per CWA, Sec. 311 (b)(4) & CWA, Sec. 307 (a)]

**OSHA Designations**

Listed as an Air Contaminant (29 CFR 1910.1000, Table Z-1-A)

**Section 8. Special Protection Data**

**Goggles:** Wear protective eyeglasses or chemical safety goggles, per OSHA eye- and face-protection regulations (29 CFR 1910.133). Because contact lens use in industry is controversial, establish your own policy. **Respirator:** Seek professional advice prior to selection and use. Follow OSHA respirator regulations (29 CFR 1910.134) and, if necessary, wear a MSHA/NIOSH-approved respirator. For < 1000 ppm, use a powered air-purifying respirator with an appropriate organic vapor cartridge, a supplied-air respirator (SAR), SCBA, or chemical cartridge respirator with appropriate organic vapor cartridge. For < 2000 ppm, use a SAR or SCBA with a full facepiece. For emergency or nonroutine operations (cleaning spills, reactor vessels, or storage tanks), wear an SCBA. **Warning!** Air-purifying respirators do not protect workers in oxygen-deficient atmospheres. If respirators are used, OSHA requires a respiratory protection program that includes at least: medical certification, training, fit-testing, periodic environmental monitoring, maintenance, inspection, cleaning, and convenient, sanitary storage areas. **Other:** Wear chemically protective gloves, boots, aprons, and gauntlets made of Viton or polyvinylchloride to prevent skin contact. **Ventilation:** Provide general and local exhaust ventilation systems to maintain airborne concentrations below the OSHA PELs (Sec. 2). Local exhaust ventilation is preferred because it prevents contaminant dispersion into the work area by controlling it at its source.<sup>(103)</sup> **Safety Stations:** Make available in the work area emergency eyewash stations, safety/quick-drench showers, and washing facilities. **Contaminated Equipment:** Separate contaminated work clothes from street clothes and launder before reuse. Remove this material from your shoes and clean PPE. **Comments:** Never eat, drink, or smoke in work areas. Practice good personal hygiene after using this material, especially before eating, drinking, smoking, using the toilet, or applying cosmetics.

**Section 9. Special Precautions and Comments**

**Storage Requirements:** Store in a cool, dry, well-ventilated area away from ignition sources and oxidizers. Outside or detached storage is preferred. If inside, store in a standard flammable liquids cabinet. Containers should have flame-arrester or pressure-vacuum venting. To prevent static sparks, electrically ground and bond all equipment used with ethylbenzene. Install Class 1, Group D electrical equipment. **Engineering Controls:** To reduce potential health hazards, use sufficient dilution or local exhaust ventilation to control airborne contaminants and to maintain levels as low as possible. Purge and ventilate reaction vessels before workers are allowed to enter for maintenance or cleanup. **Administrative Controls:** Consider preplacement and periodic medical exams of exposed workers that emphasize the CNS, skin, blood, and respiratory system.

**Transportation Data (49 CFR 172.101)**

DOT Shipping Name: Ethylbenzene

DOT Hazard Class: 3

ID No.: UN1175

DOT Packing Group: II

DOT Label: Flammable liquid

Special Provisions (172.102): T1

Packaging Authorizations

a) Exceptions: 173.150

b) Non-bulk Packaging: 173.202

c) Bulk Packaging: 173.242

Quantity Limitations

a) Passenger Aircraft or Railcar: 5L

b) Cargo Aircraft Only: 60 L

Vessel Stowage Requirements

a) Vessel Stowage: B

b) Other: —

**MSDS Collection References:** 26, 73, 100, 101, 103, 124, 126, 127, 132, 133, 136, 139, 140, 148, 153, 159, 162, 163, 164, 167, 168, 171, 176, 179

**Prepared by:** M Gannon, BA; **Industrial Hygiene Review:** D Wilson, CIH; **Medical Review:** W Silverman, MD



# Genium Publishing Corporation

1145 Catalyn Street  
Schenectady, NY 12303-1836 USA  
(518) 377-8854

## Material Safety Data Sheets Collection:

Sheet No. 474  
Fuel Oil No. 6

Issued: 10/81

Revision: A, 11/90

### Section 1. Material Identification

33

Fuel Oil No. 6 Description: A high-viscosity residual oil. Used to power heavy units such as ships, trucks, and trains. A thick paste, fuel oil No. 6 is not usually used unless preheated to decrease its viscosity.  
Other Designations: CAS No. 68553-00-4, bunker C.  
Manufacturer: Contact your supplier or distributor. Consult the latest *Chemicalweek Buyers' Guide*<sup>(TM)</sup> for a suppliers list.

R 1  
I -  
S 2  
K 2



HMIS  
H 0  
F 2  
R 0  
PPG\*  
\* Sec. 8

Cautions: Fuel oil No. 6 is a respiratory irritant and central nervous system (CNS) depressant. It is a moderate fire hazard when exposed to heat or flame.

### Section 2. Ingredients and Occupational Exposure Limits

Fuel oil No. 6\*

1989 OSHA PEL  
None established

1990-91 ACGIH TLV  
None established

1988 NIOSH REL  
None established

1985-86 Toxicity Data†  
Rat, oral, LD<sub>50</sub>: 9 g/kg

\* A complex mixture of paraffinic, olefinic, naphthenic, and aromatic hydrocarbons, including polycyclic aromatic hydrocarbons. Sulfur content is <2.8%. A fuel oil No. 6 with low sulfur (0.2 and 1.2%) is commercially available.

† Monitor NIOSH, RTECS (HZ1800000), for future toxicity data.

### Section 3. Physical Data

Boiling Point: 500 °F (>260 °C)

Specific Gravity: ~0.966

Vapor Pressure: 0.2 mm Hg at 70 °F (21 °C)

Water Solubility: Insoluble

Viscosity: 36,000 centistoke at 100 °F (37.8 °C)

Appearance and Odor: Black liquid to heavy paste with a petroleum odor.

### Section 4. Fire and Explosion Data

Flash Point: 150 to 270 °F (66 to 132 °C) | Autoignition Temperature: 765 °F (407 °C) | LEL: 3.9% v/v | UEL: 20.1% v/v

Extinguishing Media: Use dry chemical, carbon dioxide, foam, water fog, or spray. Do not use a forced water spray directly on burning oil since this scatters the fire. Use a smothering technique to extinguish fire. Cool fire-exposed containers with water spray.

Unusual Fire or Explosion Hazards: Fuel oil No. 6 is an OSHA Class IIIA combustible liquid that exhibits "boil-over" characteristics.

Special Fire-fighting Procedures: Isolate hazard area and deny entry. Since fire may produce toxic fumes, wear a self-contained breathing apparatus (SCBA) with a full facepiece operated in pressure-demand or positive-pressure mode and full protective clothing. If feasible, remove containers from fire hazard area. Be aware of runoff from fire control methods. Do not release to sewers or waterways.

### Section 5. Reactivity Data

Stability/Polymerization: Fuel oil No. 6 is stable at room temperature in closed containers under normal storage and handling conditions. Hazardous polymerization cannot occur.

Chemical Incompatibilities: Incompatible with strong oxidizing agents; heating greatly increases fire hazard.

Conditions to Avoid: Avoid heat and ignition sources.

Hazardous Products of Decomposition: Thermal oxidative decomposition of fuel oil No. 6 can produce various hydrocarbons and hydrocarbon derivatives and partial oxidation products including carbon dioxide, carbon monoxide, and sulfur dioxide.

**Section 6. Health Hazard Data**

**Carcinogenicity:** The IARC lists fuel oils, residual (heavy) as possible human carcinogen (Group 2B); animal evidence-limited.  
**Summary of Risks:** Residual oils are generally more viscous and less toxic than kerosene due to their low volatility and limited absorption through the intestinal tract. Inhalation of heated or misted fuel oil No. 6 can cause the same systemic and local pulmonary effects seen with lighter grade fuel oils, respiratory tract irritation, headache, dizziness, nausea, stupor, convulsions, or unconsciousness, depending on concentration and time of exposure. When removed from exposure area, affected persons usually experience complete recovery. The residual (heavy) oils have a lower aspiration hazard since heavy oils are more viscous. Aspiration is limited to inhalation from vomiting after ingestion and dilution with gastric contents. Significant ingestion is unlikely. In addition, intestinal absorption of long-chain hydrocarbons is low. Its primary toxicities, then, are its laxative effect, mild gastrointestinal (GI) irritation, and skin irritation. After prolonged skin contact, changes in rabbit bladder linings are reported. Prolonged or repeated skin contact may cause irritation and block the sebaceous glands, with a rash of acne-like pimples and spots, usually on the arms and legs. Repeated prolonged dermal contact may also have systemic effects. Heavy repeated application of fuel oil No. 6 to rabbit skin gave severe skin changes and systemic toxicity including an increased incidence of hyperplasia of the urinary bladder epithelium.\*

**Medical Conditions Aggravated by Long-Term Exposure:** None reported.

**Target Organs:** Central nervous system (CNS), skin, and mucous membranes.

**Primary Entry Routes:** Inhalation, ingestion.

**Acute Effects:** Systemic effects from ingestion include gastrointestinal (GI) irritation, vomiting, diarrhea, and in severe cases, CNS depression, progressing to coma and death. Inhalation of aerosol or mists may result in increased rate of respiration, tachycardia (excessively rapid heart beat), and cyanosis (dark purplish coloration of the skin and mucous membranes caused by deficient oxygenation of the blood).

**Chronic Effects:** Repeated skin contact causes dermatitis and possible systemic toxicity.

**FIRST AID**

**Eyes:** Gently lift the eyelids and flush immediately and continuously with flooding amounts of water until transported to an emergency medical facility. Consult a physician immediately.

**Skin:** Quickly remove contaminated clothing. Rinse with flooding amounts of water for at least 15 min. For reddened or blistered skin, consult a physician. Wash affected area with soap and water.

**Inhalation:** Remove exposed person to fresh air and support breathing as needed.

**Ingestion:** Never give anything by mouth to an unconscious or convulsing person. If ingested, *do not induce vomiting*. Consulting a physician immediately.

After first aid, get appropriate in-plant, paramedic, or community medical support.

Note to Physicians: Gastric lavage is contraindicated due to aspiration hazard. Preferred antidotes are charcoal and milk.

\* EPA (TOSCA) document 8EHQ-0181-0377, December, 1980.

**Section 7. Spill, Leak, and Disposal Procedures**

**Spill/Leak:** Notify safety personnel, evacuate area for large spills, remove all heat and ignition sources, and provide maximum explosion-proof ventilation. Cleanup personnel should protect against vapor inhalation and liquid contact. Clean up spills promptly to reduce fire or vapor hazards. Use a noncombustible absorbent material to pick up small spills or residues. For large spills, dike far ahead to contain. Pick up liquid for reclaim or disposal. Do not release to sewers or waterways due to health and fire and/or explosion hazard. Follow applicable OSHA regulations (29 CFR 1910.120). Report large oil spills.

**Disposal:** Contact your supplier or a licensed contractor for detailed recommendations. Follow applicable Federal, state, and local regulations.

**EPA Designations**

RCRA Hazardous Waste (40 CFR 261.33): Not listed

CERCLA Hazardous Substance (40 CFR 302.4): Not listed

SARA Extremely Hazardous Substance (40 CFR 355): Not listed

SARA Toxic Chemical (40 CFR 372.65): Not listed

**OSHA Designations**

Air Contaminant (29 CFR 1910.1000, Subpart Z): Not listed

**Section 8. Special Protection Data**

**Goggles:** Wear protective eyeglasses or chemical safety goggles, per OSHA eye- and face-protection regulations (29 CFR 1910.133).

**Respirator:** Seek professional advice prior to respirator selection and use. Follow OSHA respirator regulations (29 CFR 1910.134) and, if necessary, use a NIOSH-approved respirator with mist filter and organic vapor cartridge. For emergency or nonroutine operations (cleaning spills, reactor vessels, or storage tanks), wear an SCBA. *Warning! Air-purifying respirators do not protect workers in oxygen-deficient atmospheres.*

**Other:** Wear impervious gloves, boots, aprons, and gauntlets to prevent skin contact.

**Ventilation:** Provide general and local explosion-proof ventilation systems to maintain airborne concentrations that promote worker safety and productivity. Local exhaust ventilation is preferred since it prevents contaminant dispersion into the work area by controlling it at its source.<sup>(10)</sup>

**Safety Stations:** Make available in the work area emergency eyewash stations, safety/quick-drench showers, and washing facilities.

**Contaminated Equipment:** Never wear contact lenses in the work area; soft lenses may absorb, and all lenses concentrate, irritants. Remove this material from your shoes and equipment. Launder contaminated clothing before wearing.

**Comments:** Never eat, drink, or smoke in work areas. Practice good personal hygiene after using this material, especially before eating, drinking, smoking, using the toilet, or applying cosmetics.

**Section 9. Special Precautions and Comments**

**Storage Requirements:** Use and storage conditions should be suitable for an OSHA Class IIIA combustible liquid. Store in closed containers in a well-ventilated area away from heat and ignition sources and strong oxidizing agents. Protect containers from physical damage. To prevent static sparks, electrically ground and bond all containers and equipment used in shipping, receiving, or transferring operations. Use nonsparking tools and explosion-proof electrical equipment. No smoking in area of storage or use.

**Engineering Controls:** Avoid prolonged skin contact and vapor or mist inhalation. Use only in a well-ventilated area with personal protective gear. Institute a respiratory protection program that includes regular training, maintenance, inspection, and evaluation. Practice good personal hygiene and housekeeping procedures. Do not wear oil-contaminated clothing. Do not put oily rags in pockets. When working with this material, wear gloves or use barrier cream.

**Transportation Data (49 CFR 172.101)**

DOT Shipping Name: Fuel oil

DOT Hazard Class: Combustible liquid

ID No.: NA1993

DOT Label: None

DOT Packaging Exceptions: 173.118a

DOT Packaging Requirements: None

**MSDS Collection References:** 1, 6, 7, 12, 73, 84, 103, 126, 131, 132, 133, 136, 143

Prepared by: MJ Allison, BS; Industrial Hygiene Review: DJ Wilson, CIH; Medical Review: W Silverman, MD; Edited by: JR Stuart, MS

98



# Genium Publishing Corporation

1145 Catalyn Street  
Schenectady, NY 12303-1836 USA  
(518) 377-8854

## Material Safety Data Sheets Collection:

Sheet No. 467  
Automotive Gasoline, Lead-free

Issued: 10/81      Revision: A, 9/91

Section 1. Material Identification		35
<p><b>Automotive Gasoline, Lead-free, Description:</b> A mixture of volatile hydrocarbons composed mainly of branched-chain paraffins, cycloparaffins, olefins, naphthenes, and aromatics. In general, gasoline is produced from petroleum, shale oil, Athabasca tar sands, and coal. Motor gasolines are made chiefly by cracking processes, which convert heavier petroleum fractions into more volatile fractions by thermal or catalytic decomposition. Widely used as fuel in internal combustion engines of the spark-ignited, reciprocating type. Automotive gasoline has an octane number of approximately 90. A high content of aromatic hydrocarbons and a consequent high toxicity are also associated with a high octane rating. Some gasolines sold in the US contain a minor proportion of tetraethyllead, which is added in concentrations not exceeding 3 ml per gallon to prevent engine "knock." However, methyl-tert-butyl ether (MTBE) has almost completely replaced tetraethyllead.</p> <p><b>Other Designations:</b> CAS No. 8006-61-9, benzin, gasoline, gasolene, motor spirits, natural gasoline, petrol.</p> <p><b>Manufacturer:</b> Contact your supplier or distributor. Consult latest <i>Chemical Week Buyers' Guide</i><sup>(7)</sup> for a suppliers list.</p>		<p>R 1 I 2 S 2* K 4 * Skin absorption</p> <p>NFPA </p> <p>HMS H 2 F 3 R 1 PPG† † Sec. 8</p>
<p><b>Cautions:</b> Inhalation of automotive gasoline vapors can cause intense burning in throat and lungs, central nervous system (CNS) depression, and possible fatal pulmonary edema. Gasoline is a dangerous fire and explosion hazard when exposed to heat and flames.</p>		
Section 2. Ingredients and Occupational Exposure Limits		
Automotive gasoline, lead-free*		
<p><b>1990 OSHA PELs</b> 8-hr TWA: 300 ppm, 900 mg/m<sup>3</sup> 15-min STEL: 500 ppm, 1500 mg/m<sup>3</sup></p>	<p><b>1990-91 ACGIH TLVs</b> TWA: 300 ppm, 890 mg/m<sup>3</sup> STEL: 500 ppm, 1480 mg/m<sup>3</sup></p> <p><b>1990 NIOSH REL</b> None established</p>	<p><b>1985-86 Toxicity Data*</b> Man, inhalation, TC<sub>Lo</sub>: 900 ppm/1 hr; toxic effects include sense organs and special senses (conjunctiva irritation), behavioral (hallucinations, distorted perceptions), lungs, thorax, or respiration (cough) Human, eye: 140 ppm/8 hr; toxic effects include mild irritation Rat, inhalation, LC<sub>50</sub>: 300 g/m<sup>3</sup>/5 min</p>
<p>* A typical modern gasoline composition is 80% paraffins, 14% aromatics, and 6% olefins. The mean benzene content is approximately 1%. Other additives include sulfur, phosphorus, and MTBE. † See NIOSH, <i>RTECS</i> (LX33300000), for additional toxicity data.</p>		
Section 3. Physical Data		
<p><b>Boiling Point:</b> Initially, 102 °F (39 °C); after 10% distilled, 140 °F (60 °C); after 50% distilled, 230 °F (110 °C); after 90% distilled, 338 °F (170 °C); final boiling point, 399 °F (204 °C)</p> <p><b>Vapor Density (air = 1):</b> 3.0 to 4.0</p>		<p><b>Density/Specific Gravity:</b> 0.72 to 0.76 at 60 °F (15.6 °C)</p> <p><b>Water Solubility:</b> Insoluble</p>
<p><b>Appearance and Odor:</b> A clear (gasoline may be colored with dye), mobile liquid with a characteristic odor recognizable at about 10 ppm in air.</p>		
Section 4. Fire and Explosion Data		
<b>Flash Point:</b> -45 °F (-43 °C)	<b>Autolignition Temperature:</b> 536 to 853 °F (280 to 456 °C)	<b>LEL:</b> 1.3% v/v <b>UEL:</b> 6.0% v/v
<p><b>Extinguishing Media:</b> Use dry chemical, carbon dioxide, or alcohol foam as extinguishing media. Use of water may be ineffective to extinguish fire, but use water spray to knock down vapors and to cool fire-exposed drums and tanks to prevent pressure rupture. Do not use a solid stream of water since it may spread the fuel.</p> <p><b>Unusual Fire or Explosion Hazards:</b> Automobile gasoline is an OSHA Class IB flammable liquid and a dangerous fire and explosion hazard when exposed to heat and flames. Vapors can flow to an ignition source and flash back. Automobile gasoline can also react violently with oxidizing agents.</p> <p><b>Special Fire-fighting Procedures:</b> Isolate hazard area and deny entry. Since fire may produce toxic fumes, wear a self-contained breathing apparatus (SCBA) with a full facepiece operated in pressure-demand or positive-pressure mode, and full protective clothing. When the fire is extinguished, use nonsparking tools for cleanup. Be aware of runoff from fire control methods. Do not release to sewers or waterways.</p>		
Section 5. Reactivity Data		
<p><b>Stability/Polymerization:</b> Automotive gasoline is stable at room temperature in closed containers under normal storage and handling conditions. Hazardous polymerization cannot occur.</p> <p><b>Chemical Incompatibilities:</b> Automotive gasoline can react with oxidizing materials such as peroxides, nitric acid, and perchlorates.</p> <p><b>Conditions to Avoid:</b> Avoid heat and ignition sources.</p> <p><b>Hazardous Products of Decomposition:</b> Thermal oxidative decomposition of automotive gasoline can produce oxides of carbon and partially oxidized hydrocarbons.</p>		

**Section 6. Health Hazard Data**

**Carcinogenicity:** In 1990 reports, the IARC list gasoline as a possible human carcinogen (Group 2B). Although the IARC has assigned an overall evaluation to gasoline, it has not assigned an overall evaluation to specific substances within this group (inadequate human evidence).

**Summary of Risks:** Gasoline vapors are considered moderately poisonous. Vapor inhalation can cause central nervous system (CNS) depression and mucous membrane and respiratory tract irritation. Brief inhalations of high concentrations can cause a fatal pulmonary edema. Reported responses to gasoline vapor concentrations are: 160 to 270 ppm causes eye and throat irritation in several hours; 500 to 900 ppm causes eye, nose, and throat irritation, and dizziness in 1 hr; and 2000 ppm produces mild anesthesia in 30 min. Higher concentrations are intoxicating in 4 to 10 minutes. If large areas of skin are exposed to gasoline, toxic amounts may be absorbed. Repeated or prolonged skin exposure causes dermatitis. Certain individuals may develop hypersensitivity. Ingestion can cause CNS depression. Pulmonary aspiration after ingestion can cause severe pneumonitis. In adults, ingestion of 20 to 50 g gasoline may produce severe symptoms of poisoning.

**Medical Conditions Aggravated by Long-Term Exposure:** None reported.

**Target Organs:** Skin, eye, respiratory and central nervous systems.

**Primary Entry Routes:** Inhalation, ingestion, skin contact.

**Acute Effects:** Acute inhalation produces intense nose, throat, and lung irritation; headaches; blurred vision; conjunctivitis; flushing of the face; mental confusion; staggering gait; slurred speech; and unconsciousness, sometimes with convulsions. Ingestion causes inebriation (drunkenness), vomiting, dizziness, fever, drowsiness, confusion, and cyanosis (a blue to dark purplish coloration of skin and mucous membrane caused by lack of oxygen). Aspiration causes choking, cough, shortness of breath, increased rate of respiration, excessively rapid heartbeat, fever, bronchitis, and pneumonitis. Other symptoms following acute exposure include acute hemorrhage of the pancreas, fatty degeneration of the liver and kidneys, and passive congestion of spleen.

**Chronic Effects:** Chronic inhalation results in appetite loss, nausea, weight loss, insomnia, and unusual sensitivity (hyperesthesia) of the distal extremities followed by motor weakness, muscular degeneration, and diminished tendon reflexes and coordination. Repeated skin exposure can cause blistering, drying, and lesions.

**FIRST AID**

**Eyes:** Gently lift the eyelids and flush immediately and continuously with flooding amounts of water until transported to an emergency medical facility. Consult a physician immediately.

**Skin:** Quickly remove contaminated clothing. Rinse with flooding amounts of water for at least 15 min. For reddened or blistered skin, consult a physician. Wash affected area with soap and water.

**Inhalation:** Remove exposed person to fresh air and support breathing as needed.

**Ingestion:** Never give anything by mouth to an unconscious or convulsing person. If ingested, do not induce vomiting due to aspiration hazard. Give conscious victim a mixture of 2 tablespoons of activated charcoal mixed in 8 oz of water to drink. Consult a physician immediately.

**After first aid, get appropriate in-plant, paramedic, or community medical support.**

**Section 7. Spill, Leak, and Disposal Procedures**

**Spill/Leak:** Notify safety personnel, evacuate all unnecessary personnel, remove heat and ignition sources, and provide maximum explosion-proof ventilation. Cleanup personnel should protect against vapor inhalation and liquid contact. Use nonsparking tools. Take up small spills with sand or other noncombustible adsorbent. Dike storage areas to control leaks and spills. Follow applicable OSHA regulations (29 CFR 1910.120).

**Aquatic Toxicity:** Bluegill, freshwater, LC<sub>50</sub>, 8 ppm/96 hr.

**Disposal:** Contact your supplier or a licensed contractor for detailed recommendations. Follow applicable Federal, state, and local regulations.

**EPA Designations**

**RCRA Hazardous Waste (40 CFR 261.21):** Characteristic of ignitability

**CERCLA Hazardous Substance (40 CFR 302.4):** Not listed

**SARA Extremely Hazardous Substance (40 CFR 355):** Not listed

**SARA Toxic Chemical (40 CFR 372.65):** Not listed

**OSHA Designations**

**Listed as an Air Contaminant (29 CFR 1910.1000, Table Z-1-A)**

**Section 8. Special Protection Data**

**Goggles:** Wear protective eyeglasses or chemical safety goggles, per OSHA eye- and face-protection regulations (29 CFR 1910.133). Since contact lens use in industry is controversial, establish your own policy.

**Respirator:** Seek professional advice prior to respirator selection and use. Follow OSHA respirator regulations (29 CFR 1910.134) and, if necessary, wear a NIOSH-approved respirator. There are no specific NIOSH recommendations. However, for vapor concentrations not immediately dangerous to life or health, use chemical cartridge respirator equipped with organic vapor cartridge(s), or a supplied-air respirator. For emergency or nonroutine operations (cleaning spills, reactor vessels, or storage tanks), wear an SCBA. *Warning! Air-purifying respirators do not protect workers in oxygen-deficient atmospheres.*

**Other:** Wear impervious gloves, boots, aprons, and gauntlets to prevent prolonged or repeated skin contact. Materials such as neoprene or polyvinyl alcohol provide excellent/good resistance for protective clothing. Note: Resistance of specific materials can vary from product to product.

**Ventilation:** Provide general and local explosion-proof exhaust ventilation systems to maintain airborne concentrations below the OSHA PELs (Sec. 2). Local exhaust ventilation is preferred since it prevents contaminant dispersion into the work area by controlling it at its source.<sup>(10)</sup>

**Safety Stations:** Make available in the work area emergency eyewash stations, safety/quick-drench showers, and washing facilities.

**Contaminated Equipment:** Remove this material from your shoes and equipment. Launder contaminated clothing before wearing.

**Comments:** Never eat, drink, or smoke in work areas. Practice good personal hygiene after using this material, especially before eating, drinking, smoking, using the toilet, or applying cosmetics.

**Section 9. Special Precautions and Comments**

**Storage Requirements:** Store in closed containers in a cool, dry, well-ventilated area away from heat and ignition sources and strong oxidizing agents. Protect containers from physical damage. Avoid direct sunlight. Storage must meet requirements of OSHA Class IB liquid. Outside or detached storage preferred.

**Engineering Controls:** Avoid vapor inhalation and skin or eye contact. Consider a respiratory protection program that includes regular training, maintenance, inspection, and evaluation. Indoor use of this material requires explosion-proof exhaust ventilation to remove vapors. Only use gasoline as a fuel source due to its volatility and flammable/explosive nature. Practice good personal hygiene and housekeeping procedures. Wear clean work clothing daily.

**Transportation Data (49 CFR 172.101, .102)**

**DOT Shipping Name:** Gasoline (including casing-head and natural)

**DOT Hazard Class:** Flammable liquid

**ID No.:** UN1203

**DOT Label:** Flammable liquid

**DOT Packaging Exceptions:** 173.118

**DOT Packaging Requirements:** 173.119

**IMO Shipping Name:** Gasoline

**IMO Hazard Class:** 3.1

**ID No.:** UN1203

**IMO Label:** Flammable liquid

**IMDG Packaging Group:** II

**MSDS Collection References:** 26, 73, 89, 100, 101, 103, 124, 126, 127, 132, 133, 136, 138, 140, 143, 146, 153, 159

**Prepared by:** M Allison, BS; **Industrial Hygiene Review:** DJ Wilson, CIH; **Medical Review:** W Silverman, MD; **Edited by:** JR Stuart, MS



# Genium Publishing Corporation

1145 Catalyn Street  
Schenectady, NY 12303-1836 USA  
(518) 377-8854

Sheet No. 488  
Kerosine Burner Fuel

Issued: 11/82      Revision: A, 3/92

## Section 1. Material Identification 37

**Kerosine Burner Fuel** (molecular formula varies according to method of manufacture)\* Description: A mixture of distilled petroleum hydrocarbons, mainly of the methane series with 10 to 16 carbon atoms per molecule. Used as fuel for kerosine lamps, flares, stoves, jet engines, rockets, diesels, and tractors; a degreaser, cleaner, mold-releasing agent, solvent for asphalt coatings, enamels, paints, polishes, thinners and varnishes; and by veterinarians for decontamination. A deodorized and decolorized version called Deobase was formerly used as a solvent for cosmetics and fly spray. Other Designations: CAS No. 8008-20-6, coal oil, Deobase, home heating oil no. 1, kerosene, mineral colza, mineral seal, range oil.

R	2	 NFPA†
I	2	
S	2	
K	2	

HMIS  
H 1  
F 2  
R 0  
PPG‡  
‡ Sec. 8

Manufacturer: Contact your supplier or distributor. Consult latest *Chemical Week Buyers' Guide*<sup>(73)</sup> for a suppliers list.

**Cautions:** Avoid skin contact with kerosine burner fuel because it causes defatting of the skin, leading to irritation and possible dermatitis. Kerosine burner fuel is combustible and may be ignited by heat, sparks, or flames.

\* The ASTM and ACS prefer the spelling "kerosine". See also Kerosine Solvent (MSDS Collection, No. 387).  
† Although the NFPA gives kerosine burner fuel a "0" health rating, many references agree that it is moderately toxic when ingested, when in contact with skin, and when its liquid is aspirated. A health rating of "1" may be more appropriate.

## Section 2. Ingredients and Occupational Exposure Limits

Kerosine burner fuel (hydrocarbon mixtures, paraffins, naphthenes, olefins, and aromatics + 0.04 to 0.3% sulfur), ca >98%

<b>1990 OSHA PEL</b> None established	<b>1991-92 ACGIH TLV</b> None established	<b>1985-86 Toxicity Data*</b> Man, intravenous, TD <sub>01</sub> : 403 mg/kg caused distorted perceptions and hallucinations
<b>1990 NIOSH REL</b> TWA: 14 ppm (100 mg/m <sup>3</sup> )	<b>1990 DFG (Germany) MAK</b> None established	Man, oral, TD <sub>01</sub> : 3570 mg/kg produced coughing, vomiting, and increased body temperature Rat, oral, LD <sub>50</sub> : 800 mg/kg; no toxic effects noted

\* See NIOSH, RTECS (OA5500000), for additional toxicity data.

## Section 3. Physical Data

<b>Bolling Point Range:</b> 347 to 617 °F (175 to 325 °C) <b>Freezing Point:</b> <-22 °F (<-30 °C) <b>Vapor Pressure:</b> 5 mm Hg at 68 °F (20 °C) <b>Vapor Density (air = 1):</b> 4.5 <b>Viscosity:</b> 32	<b>Odor Threshold:</b> 1 ppm <b>Molecular Weight:</b> Variable <b>Density:</b> 0.80 at 68 °F (20 °C) <b>Water Solubility:</b> Insoluble <b>Other Solubilities:</b> Miscible with other petroleum solvents
---	---

**Appearance and Odor:** Pale yellow or water-white, mobile, oily liquid with a characteristic strong petroleum odor.

## Section 4. Fire and Explosion Data

**Flash Point:** 100 to 162 °F (43 to 72 °C)    **Autoignition Temperature:** 444 °F (228 °C)    **LEL:** 0.7% v/v    **UEL:** 5% v/v

**Extinguishing Media:** For small fires, use dry chemical, carbon dioxide (CO<sub>2</sub>), water spray, or regular foam. For large fires, use water spray, fog, or regular foam. Use a "smothering" technique. *Caution! Forced stream of water could scatter flames of burning kerosine.*

**Unusual Fire or Explosion Hazards:** If spilled, and in the absence of ventilation and good air mixing, vapors may travel to an ignition source and flash back. Container may explode in heat of fire. Kerosine burner fuel poses a vapor explosion hazard indoors, outdoors, and in sewers.

**Special Fire-fighting Procedures:** Since fire may produce toxic thermal decomposition products, wear a self-contained breathing apparatus (SCBA) with a full facepiece operated in pressure-demand or positive-pressure mode. Also wear fully protective clothing. If possible without risk, remove container from fire area. Apply cooling water to sides of container until fire is well out. Stay away from ends of tanks. For massive fire in cargo area use monitor nozzles or unmanned hose holders; if impossible, withdraw from area and let fire burn. Withdraw from area immediately if you hear a rising sound from venting safety device or notice any tank discoloration due to fire. Isolate area for 1/2 mile in all directions if fire involves tank truck or rail car. Be aware of runoff from fire control methods. Do not release to sewers or waterways.

## Section 5. Reactivity Data

**Stability/Polymerization:** Kerosine burner fuel is stable at room temperature in closed containers under normal storage and handling conditions. Hazardous polymerization cannot occur. Any increase in temperature could lead to increasing instability.

**Chemical Incompatibilities:** Kerosine burner fuel is incompatible with oxidizing materials.

**Conditions to Avoid:** Excessive heat generation and contact with oxidizing materials.

**Hazardous Products of Decomposition:** Thermal oxidative decomposition of kerosine burner fuel can produce carbon dioxide (CO<sub>2</sub>), carbon monoxide (CO), hydrocarbons, and small amounts of sulfur dioxide (SO<sub>2</sub>), depending on sulfur content.

**Section 6. Health Hazard Data**

**Carcinogenicity:** In 1990 reports, the IARC lists kerosine as Class 7 (substance not assigned an overall evaluation), although *occupational exposures in petroleum refining* are listed as Class 5 (carcinogenic, animal evidence limited). Since kerosine is obtained during petroleum refining, consider these data.

**Summary of Risks:** Kerosine burner fuel toxicity varies widely with methods of manufacture and use. The deodorized and refined kerosines are least toxic. Those containing benzenes can cause hematopoietic (formative of red blood cells) problems and exposure to large amounts can lead to renal (kidney) injury. Minor exposures to kerosine can cause irritation and headache.

**Medical Conditions Aggravated by Long-Term Exposure:** None reported.

**Target Organs:** Respiratory tract, skin, blood, and kidneys.

**Primary Entry Routes:** Inhalation, skin contact, ingestion.

**Acute Effects:** Inhalation of kerosine mists can cause mucous membrane irritation, headache, and drowsiness. High concentrations can lead to suffocation, coma, and death by respiratory arrest. Aspiration of vomitus (after ingestion) can lead to serious pneumonitis (inflammation of lungs) and pulmonary hemorrhage (bleeding in lungs). Ingestion can cause gastrointestinal (GI) tract irritation, vomiting, and diarrhea. Skin contact with kerosine causes immediate defatting of skin, leaving it dry and cracked.

**Chronic Effects:** Chronic skin contact leaves skin dry and cracked, easily irritated, and prone to infection from other agents. Chronic dermatitis may result from long-term skin exposure. Chronic overexposure to hydrocarbon vapors may cause neurological impairment.

**FIRST AID**

**Eyes:** Gently lift eyelids and flush immediately and continuously with flooding amounts of water until transported to an emergency medical facility. *Do not* allow victim to rub or keep eyes tightly shut. Consult a physician immediately.

**Skin:** *Quickly* remove contaminated clothing. Rinse with flooding amounts of water for at least 15 min. For reddened or blistered skin, consult a physician. Wash affected area with soap and water.

**Inhalation:** Remove exposed person to fresh air and support breathing as needed.

**Ingestion:** Never give anything by mouth to an unconscious or convulsing person. Consult a poison control center. Unless otherwise advised, *do not* induce vomiting since aspiration of vomitus can lead to severe pneumonitis. If spontaneous vomiting occurs, hold the victim's head lower than the hips to prevent pulmonary aspiration.

**After first aid, get appropriate in-plant, paramedic, or community medical support.**

**Note to Physicians:** Observe pulmonary function and treat accordingly.

**Section 7. Spill, Leak, and Disposal Procedures**

**Spill/Leak:** Immediately notify safety personnel, isolate and ventilate area, deny entry, and stay upwind. Shut off all sources of ignition—no flares, flames, or smoking in hazard area. Cleanup personnel should prevent against contamination. Water spray may reduce vapor, but it may not prevent ignition in closed spaces. For small spills, using nonsparking tools, take up with earth, sand, vermiculite, or other absorbent, noncombustible material and place in suitable containers for later disposal. For large spills, dike far ahead of liquid spills for later disposal. Follow applicable OSHA regulations (29 CFR 1910.120).

**Disposal:** Contact your supplier or a licensed contractor for detailed recommendations. Follow applicable Federal, state, and local regulations.

**EPA Designations**

Listed as a RCRA Hazardous Waste (40 CFR 261.21): No. D001, Characteristic of ignitability

CERCLA Hazardous Substance (40 CFR 302.4): Not listed

SARA Extremely Hazardous Substance (40 CFR 355): Not listed

SARA Toxic Chemical (40 CFR 372.65): Not listed

**OSHA Designations**

Air Contaminant (29 CFR 1910.1000, Subpart Z): Not listed

**Section 8. Special Protection Data**

**Goggles:** Wear protective eyeglasses or chemical safety goggles, per OSHA eye- and face-protection regulations (29 CFR 1910.133). Since contact lens use in industry is controversial, establish your own policy.

**Respirator:** Seek professional advice prior to respirator selection and use. Follow OSHA respirator regulations (29 CFR 1910.134) and, if necessary, wear a MSHA/NIOSH-approved respirator. Select respirator based upon its suitability to provide adequate worker protection for given working conditions, level of airborne contamination, and presence of sufficient oxygen. For emergency or nonroutine operations (cleaning spills, reactor vessels, or storage tanks), wear an SCBA. **Warning!** *Air-purifying respirators do not protect workers in oxygen-deficient atmospheres.* If respirators are used, OSHA requires a respiratory protection program that includes at least: training, fit-testing, periodic environmental monitoring, maintenance, inspection, cleaning, and convenient, sanitary storage areas.

**Other:** Wear chemically protective gloves, boots, aprons, and gauntlets to prevent repeated and prolonged skin contact. Barrier creams may also be useful.

**Ventilation:** Provide general and local explosion-proof exhaust ventilation systems to maintain airborne concentrations below the NIOSH REL (Sec. 2). Local exhaust ventilation is preferred since it prevents contaminant dispersion into the work area by controlling it at its source.<sup>(103)</sup>

**Safety Stations:** Make available in the work area emergency eyewash stations, safety/quick-drench showers, and washing facilities.

**Contaminated Equipment:** Separate contaminated work clothes from street clothes. Launder contaminated work clothing before wearing.

Remove this material from your shoes and clean personal protective equipment.

**Comments:** Never eat, drink, or smoke in work areas. Practice good personal hygiene after using this material, especially before eating, drinking, smoking, using the toilet, or applying cosmetics.

**Section 9. Special Precautions and Comments**

**Storage Requirements:** Avoid physical damage to containers. Store in cool, dry, well-ventilated area away from ignition sources, direct sunlight, and oxidizing materials. Outdoor or detached storage is recommended for large amounts. Electrically ground all equipment used in the manufacture, use, and storage of kerosine burner fuel. During maintenance use only nonsparking tools. Periodically inspect storage conditions.

**Engineering Controls:** To reduce potential health hazards, use sufficient dilution or local exhaust ventilation to control the airborne contaminants and to maintain concentrations at the lowest practical level.

**Administrative Controls:** Consider preplacement and periodic medical examinations of exposed workers that emphasize respiratory function.

**Transportation Data (49 CFR 172.101, .102)**

DOT Shipping Name: Kerosene

DOT Hazard Class: Combustible liquid

ID No.: UN1223

DOT Label: None

DOT Packaging Exceptions: 173.118a

DOT Packaging Requirements: None

IMO Shipping Name: Kerosene

IMO Hazard Class: 3.3

ID No.: UN1223

IMO Label: Flammable liquid

IMDG Packaging Group: II

**MSDS Collection References:** 26, 73, 100, 101, 103, 124, 127, 132, 133, 136, 143, 153, 159, 163

**Prepared by:** M Gannon, BA; **Industrial Hygiene Review:** PA Roy, MPH, CIH; **Medical Review:** AC Darlington, MPH, MD; **Edited by:** JR Stuart, MS

**Section 1. Material Identification**

39

**Toluene (C<sub>6</sub>H<sub>5</sub>CH<sub>3</sub>) Description:** Derived from petroleum i.e., dehydrogenation of cycloparaffin fractions followed by the aromatization of saturated aromatic hydrocarbons or by fractional distillation of coal-tar light oil and purified by rectification. Used widely as a solvent (replacing benzene in many cases) for oils, resins, adhesives, natural rubber, coal tar, asphalt, pitch, acetyl celluloses, cellulose paints and varnishes; a diluent for photogravure inks, raw material for organic synthesis (benzoyl & benzilidene chlorides, saccharine, TNT, toluene diisocyanate, and many dyestuffs), in aviation and high octane automobile gasoline, as a nonclinical thermometer liquid and suspension solution for navigational instruments.

**Other Designations:** CAS No. 108-88-3, Methacide, methylbenzene, methylbenzol, phenylmethane, toluol, Tolu-sol.  
**Manufacturer:** Contact your supplier or distributor. Consult latest *Chemical Week Buyers' Guide*<sup>(73)</sup> for a suppliers list.

**Cautions:** Toluene is an eye, skin, and respiratory tract irritant becoming narcotic at high concentrations. Liver and kidney damage has occurred. Pregnant women chronically exposed to toluene have shown teratogenic effects. Toluene is highly flammable.

R	1	NFPA
I	3	
S	2*	
K	3	
* Skin absorption		
HMIS		Chronic effects
H	2	
F	3	
R	0	
PPE-Sec. 8		

**Section 2. Ingredients and Occupational Exposure Limits**

Toluene, < 100%; may contain a small amount of benzene (~ 1%), xylene, and nonaromatic hydrocarbons.

1991 OSHA PELs

8-hr TWA: 100 ppm (375 mg/m<sup>3</sup>)

15-min STEL: 150 ppm (560 mg/m<sup>3</sup>)

1990 IDLH Level

2000 ppm

1990 NIOSH RELs

TWA: 100 ppm (375 mg/m<sup>3</sup>)

STEL: 150 ppm (560 mg/m<sup>3</sup>)

1992-93 ACGIH TLV (Skin)

TWA: 50 ppm (188 mg/m<sup>3</sup>)

1990 DFG (Germany) MAK\*

TWA: 100 ppm (380 mg/m<sup>3</sup>)

Half-life: 2 hr to end of shift

Category II: Substances with systemic effects

Peak Exposure Limit: 500 ppm, 30 min

average value, 2/shift

1985-86 Toxicity Data†

Man, inhalation, TC<sub>Lo</sub>: 100 ppm caused hallucinations, and changes in motor activity and changes in psychophysiological tests.

Human, oral, LD<sub>50</sub>: 50 mg/kg; toxic effects not yet reviewed

Human, eye: 300 ppm caused irritation.

Rat, oral, LD<sub>50</sub>: 5000 mg/kg

Rat, liver: 30 μmol/L caused DNA damage.

\* Available information suggests damage to the developing fetus is probable.

† See NIOSH, RTECS (XS5250000), for additional irritation, mutation, reproductive, and toxicity data.

**Section 3. Physical Data**

Boiling Point: 232 °F (110.6 °C)

Melting Point: -139 °F (-95 °C)

Molecular Weight: 92.15

Density: 0.866 at 68 °F (20/4 °C)

Surface Tension: 29 dyne/cm at 68 °F (20 °C)

Viscosity: 0.59 cP at 68 °F (20 °C)

Refraction Index: 1.4967 at 20 °C/D

Water Solubility: Very slightly soluble, 0.6 mg/L at 68 °F (20 °C)

Other Solubilities: Soluble in acetone, alcohol, ether, benzene, chloroform, glacial acetic acid, petroleum ether, and carbon disulfide.

Vapor Pressure: 22 mm Hg at 68 °F (20 °C); 36.7 mm Hg at 86 °F (30 °C)

Saturated Vapor Density (Air = 0.075 lb/ft<sup>3</sup> or 1.2 kg/m<sup>3</sup>): 0.0797 lb/ft<sup>3</sup> or 1.2755 kg/m<sup>3</sup>

Odor Threshold (range of all referenced values): 0.021 to 69 ppm

Appearance and Odor: Colorless liquid with a sickly sweet odor.

**Section 4. Fire and Explosion Data**

Flash Point: 40 °F (4.4 °C) CC

Autoignition Temperature: 896 °F (480 °C)

LEL: 1.27% v/v

UEL: 7.0% v/v

**Extinguishing Media:** Toluene is a Class 1B flammable liquid. To fight fire, use dry chemical carbon dioxide, or 'alcohol-resistant' foam. Water spray may be ineffective as toluene floats on water and may actually spread fire. **Unusual Fire or Explosion Hazards:** Concentrated vapors are heavier than air and may travel to an ignition source and flash back. Container may explode in heat of fire. Toluene's burning rate = 5.7 mm/min and its flame speed = 37 cm/sec. Vapor poses an explosion hazard indoors, outdoors, and in sewers. May accumulate static electricity. **Special Fire-fighting Procedures:** Because fire may produce toxic thermal decomposition products, wear a self-contained breathing apparatus (SCBA) with a full facepiece operated in pressure-demand or positive-pressure mode. Structural firefighter's protective clothing provides only limited protection. Apply cooling water to sides of tanks until well after fire is out. Stay away from ends of tanks. For massive fire in cargo area, use monitor nozzles or unmanned hose holders; if impossible, withdraw from fire and let burn. Withdraw immediately if you hear a rising sound from venting safety device or notice any tank discoloration due to fire because a BLEVE (boiling liquid expanding vapor explosion) may be imminent. Do not release runoff from fire control methods to sewers or waterways.

**Stability/Polymerization:** Toluene is stable at room temperature in closed containers under normal storage and handling conditions. Hazardous polymerization can't occur. **Chemical Incompatibilities:** Strong oxidizers, concentrated nitric acid, nitric acid + sulfuric acid, dinitrogen tetroxide, silver perchlorate, bromine trifluoride, tetranitromethane, and 1,3-dichloro-5,5-dimethyl-2,4-imidazolidione. **Conditions to Avoid:** Contact with heat, ignition sources, or incompatibles. **Hazardous Products of Decomposition:** Thermal oxidative decomposition of toluene can produce carbon dioxide, and acrid, irritating smoke.

**Section 5. Reactivity Data**

**Stability/Polymerization:** Toluene is stable at room temperature in closed containers under normal storage and handling conditions. Hazardous polymerization can't occur. **Chemical Incompatibilities:** Strong oxidizers, concentrated nitric acid, nitric acid + sulfuric acid, dinitrogen tetroxide, silver perchlorate, bromine trifluoride, tetranitromethane, and 1,3-dichloro-5,5-dimethyl-2,4-imidazolidione. **Conditions to Avoid:** Contact with heat, ignition sources, or incompatibles. **Hazardous Products of Decomposition:** Thermal oxidative decomposition of toluene can produce carbon dioxide, and acrid, irritating smoke.

**Section 6. Health Hazard Data**

**Carcinogenicity:** The IARC,<sup>(164)</sup> NTP,<sup>(169)</sup> and OSHA<sup>(164)</sup> do not list toluene as a carcinogen. **Summary of Risks:** Toluene is irritating to the eyes, nose, and respiratory tract. Inhalation of high concentrations produces a narcotic effect sometimes leading to coma as well as liver and kidney damage. 93% of inhaled toluene is retained in the body of which 80% is metabolized to benzoic acid, then to hippuric acid and excreted in urine. The remainder is metabolized to *o*-cresol and excreted or exhaled unchanged. Toluene metabolism is inhibited by alcohol ingestion and is synergistic with benzene, asphalt fumes, or chlorinated hydrocarbons (i.e. perchloroethylene). Toluene is readily absorbed through the skin at 14 to 23 mg/cm<sup>2</sup>/hr. Toluene is absorbed quicker during exercise than at rest and appears to be retained longer in obese versus thin victims; presumably due to its lipid solubility. There is inconsistent data on toluene's ability to damage bone marrow; chronic poisoning has resulted in anemia and leucopenia with biopsy showing bone marrow hypo-plasia. These reports are few and some authorities argue that the effects may have been due to benzene contaminants. Chronic inhalation during pregnancy has been associated with teratogenic effects on the fetus including microcephaly, CNS dysfunction, attentional deficits, developmental delay + language impairment, growth retardation, and physical defects including a small midface, short palpebral fissures, with deep-set eyes, low-set ears, flat nasal bridge with a small nose, micrognathia, and blunt fingertips. There is some evidence that toluene causes an autoimmune illness in which the body produces antibodies that cause inflammation of its own kidney.

**Section 6. Health Hazard Data**

**Medical Conditions Aggravated by Long-Term Exposure:** Alcoholism and CNS, kidney, skin, or liver disease. **Target Organs:** CNS, liver, kidney, skin. **Primary Entry Routes:** Inhalation, skin contact/absorption. **Acute Effects:** Vapor inhalation causes respiratory tract irritation, fatigue, weakness, confusion, dizziness, headache, dilated pupils, watering eyes, nervousness, insomnia, parasthesia, and vertigo progressing to narcotic coma. Death may result from cardiac arrest due to ventricular fibrillation with catecholamines loss. Liquid splashed in the eye causes conjunctival irritation, transient corneal damage and possible burns. Prolonged skin contact leads to drying and fissured dermatitis. Ingestion causes GI tract irritation and symptoms associated with inhalation. **Chronic Effects:** Symptoms include mucous membrane irritation, headache, vertigo, nausea, appetite loss and alcohol intolerance. Repeated heavy exposure may result in encephalopathies (cerebellar ataxia and cognitive dysfunction), liver enlargement, and kidney dystrophy (wasting away). Symptoms usually appear at workdays end, worsen at weeks end and decrease or disappear over the weekend. **FIRST AID** **Eyes:** Do not allow victim to rub or keep eyes tightly shut. Gently lift eyelids and flush immediately and continuously with flooding amounts of water until transported to an emergency medical facility. Consult an ophthalmologist immediately. **Skin:** Quickly remove contaminated clothing. Rinse with flooding amounts of water for at least 15 min. Wash exposed area with soap and water. **Inhalation:** Remove exposed person to fresh air and support breathing as needed. **Ingestion:** Never give anything by mouth to an unconscious or convulsing person. Contact a poison control center and unless otherwise advised, have that conscious and alert person drink 1 to 2 glasses of water to dilute. Do not induce vomiting because of danger of aspiration into the lungs. Gastric lavage may be indicated if large amounts are swallowed; potential toxicity needs to be weighed against aspiration risk when deciding for or against gastric lavage. **Note to Physicians:** Monitor cardiac function. If indicated, use epinephrine and other catecholamines carefully, because of the possibility of a lowered myocardial threshold to the arrhythmogenic effects of such substances. Obtain CBC, electrolytes, and urinalysis. Monitor arterial blood gases. If toluene has > 0.02% (200 ppm) benzene, evaluate for potential benzene toxicity. **BEI:** hippuric acid in urine, sample at shift end (2.5 g/g creatinine); Toluene in venous blood, sample at shift end (1.0 mg/L).

**Section 7. Spill, Leak, and Disposal Procedures**

**Spill/Leak:** Notify safety personnel, isolate and ventilate area, deny entry, and stay upwind. Cleanup personnel protect against inhalation and skin/eye contact. Use water spray to cool and disperse vapors but it may not prevent ignition in closed spaces. Cellosolve, hycar absorbent materials, and fluorocarbon water can also be used for vapor suppression/containment. Take up small spill with earth, sand, vermiculite, or other absorbent, noncombustible material. Dike far ahead of large spills for later reclamation or disposal. For water spills, (10 ppm or greater) apply activated carbon at 10X the spilled amount and remove trapped material with suction hoses or use mechanical dredges/lifts to remove immobilized masses of pollutants and precipitates. Toluene can undergo fluidized bed incineration at 842 to 1796 °F (450 to 980 °C), rotary kiln incineration at 1508 to 2912 °F (820 to 1600 °C), or liquid injection incineration at 1202 to 2912 °F (650 to 1600 °C). Follow applicable OSHA regulations (29 CFR 1910.120). **Ecotoxicity Values:** Blue gill, LC<sub>50</sub> = 17 mg/L/24 hr; shrimp (*Crangonfraxis coron*), LC<sub>50</sub> = 4.3 ppm/96 hr; fathead minnow (*Pimephales promelas*), LC<sub>50</sub> = 36.2 mg/L/96 hr. **Environmental Degradation:** If released to land, toluene evaporates and undergoes microbial degradation. In water, toluene volatilizes and biodegrades with a half-life of days to several weeks. In air, toluene degrades by reaction with photochemically produced hydroxyl radicals. **Disposal:** Treat contaminated water by gravity separation of solids, followed by skimming of surface. Pass through dual media filtration and carbon absorption units (carbon ratio 1 kg to 10 kg soluble material). Return waste water from backwash to gravity separator. Contact your supplier or a licensed contractor for detailed recommendations. Follow applicable Federal, state, and local regulations.

**EPA Designations**

listed as a RCRA Hazardous Waste (40 CFR 261.33): No. U220  
ARA Extremely Hazardous Substance (40 CFR 355), TPQ: Not listed

Listed as a CERCLA Hazardous Substance\* (40 CFR 302.4): Final Reportable Quantity (RQ), 1000 lb (454 kg)

\* per RCRA, Sec. 3001; CWA, Sec. 311 (b)(4); CWA, Sec. 307 (a)

Listed as a SARA Toxic Chemical (40 CFR 372.65): Not listed

**OSHA Designations**

Listed as an Air Contaminant (29 CFR 1910.1000, Table Z-1-A)

**Section 8. Special Protection Data**

**Goggles:** Wear protective eyeglasses with shatter-resistant glass and side-shields or chemical safety goggles, per OSHA eye- and face-protection regulations (29 CFR 1910.133). Because contact lens use in industry is controversial, establish your own policy. **Respirator:** Seek professional advice prior to respirator selection and use. Follow OSHA respirator regulations (29 CFR 1910.134) and, if necessary, wear a MSHA/NIOSH-approved respirator. For < 100 ppm, use any chemical cartridge respirator with appropriate organic vapor cartridges, any supplied-air respirator (SAR), or SCBA. For < 200 ppm, use any SAR operated in continuous-flow mode, any SAR or SCBA with a full facepiece, or any air-purifying respirator with a full facepiece having a chin-style, front or back mounted organic vapor canister. For emergency or nonroutine operations (cleaning spills, reactor vessels, or storage tanks), wear an SCBA. **Warning! Air-purifying respirators do not protect workers in oxygen-deficient atmospheres.** If respirators are used, OSHA requires a written respiratory protection program that includes at least: medical certification, training, fit-testing, periodic environmental monitoring, maintenance, inspection, cleaning, and convenient, sanitary storage areas. **Other:** Wear chemically protective gloves, boots, aprons, and gauntlets to prevent skin contact. Polyvinyl alcohol with a breakthrough time of > 8 hr, Teflon and Viton are recommended as suitable materials for PPE. **Ventilation:** Provide general and local exhaust ventilation systems to maintain airborne concentrations below the OSHA PELs (Sec. 2). Local exhaust ventilation is preferred because it prevents contaminant dispersion into the work area by controlling it at its source.<sup>(103)</sup> **Safety Stations:** Make available in the work area emergency eyewash stations, safety/quick-drench showers, and washing facilities. **Contaminated Equipment:** Separate contaminated work clothes from street clothes and launder before reuse. Remove toluene from your shoes and clean PPE. **Comments:** Never eat, drink, or smoke in work areas. Practice good personal hygiene after using this material, especially before eating, drinking, smoking, using the toilet, or applying cosmetics.

**Section 9. Special Precautions and Comments**

**Storage Requirements:** Prevent physical damage to containers. Store in a cool, dry, well-ventilated area away from ignition sources and incompatibles. Outside or detached storage is preferred. If stored inside, use a standard flammable liquids warehouse, room, or cabinet. To prevent static sparks, electrically ground and bond all equipment used with toluene. Do not use open lights in toluene areas. Install Class 1, Group D electrical equipment. Check that toluene is free of or contains < 1% benzene before use. **Engineering Controls:** To reduce potential health hazards, use sufficient dilution or local exhaust ventilation to control airborne contaminants and to maintain concentrations at the lowest practical level. **Administrative Controls:** Adopt controls for confined spaces (29 CFR 1910.146) if entering areas of unknown toluene levels (holes, wells, storage tanks). Consider preplacement and periodic medical exams of exposed workers that emphasize the CNS, liver, kidney, and skin. Include hemocytometric and thrombocyte count in cases where benzene is a contaminant of toluene. Monitor air at regular intervals to ensure effective ventilation.

**Transportation Data (49 CFR 172.101)**

JT Shipping Name: Toluene  
DOT Hazard Class: 3  
ID No.: UN1294  
DOT Packing Group: II  
DOT Label: Flammable Liquid  
Special Provisions (172.102): T1

Packaging Authorizations  
a) Exceptions: 150  
b) Non-bulk Packaging: 202  
c) Bulk Packaging: 242

Quantity Limitations  
a) Passenger Aircraft or Railcar: 5L  
b) Cargo Aircraft Only: 60L

Vessel Stowage Requirements  
Vessel Stowage: B  
Other: --



Genium Publishing Corporation  
One Genium Plaza  
Schenectady, NY 12304-4690 USA  
(518) 377-8854

**Section 1. Material Identification**

**Trichloroethylene (C<sub>2</sub>HCl<sub>3</sub>) Description:** Derived by treating tetrachloroethane with lime or other alkali in the presence of water, or by thermal decomposition of tetrachloroethane followed by steam distillation. Stabilizers such as epichlorohydrin, isobutanol, carbon tetrachloride, chloroform, benzene, or pentanol-2-triethanolamine are then added. Used as a degreasing solvent in electronics and dry cleaning, a chemical intermediate, a refrigerant and heat-exchange liquid, and a diluent in paint and adhesives; in oil, fat, and wax extraction and in aerospace operations (flushing liquid oxygen). Formerly used as a fumigant (food) and anesthetic (replaced due to its hazardous decomposition in closed-circuit apparatus).  
**Other Designations:** CAS No. 79-01-6; acetylene trichloride; Algylen; Anamenth; Benzinol; Cecolene; Chlorylen; Dow-Tri; ethylene trichloride; Germalgene; Narcoogen; Triasol; trichloroethene; TCE; 1,1,3-trichloroethylene.  
**Manufacturer:** Contact your supplier or distributor. Consult latest *Chemical Week Buyers' Guide*<sup>(7)</sup> for a suppliers list.

R	1		NFPA	
I	2		H	2†
S	2*		F	2
K	3		R	0
* Skin absorption			PPE†	
			† Chronic Effects	
			† Sec. 8	

**Cautions:** TCE is irritating and toxic to the central nervous system (CNS). Inhalation of high concentrations have lead to death due to ventricular fibrillation. Chronic exposure may lead to heart, liver, and kidney damage. The liquid is absorbed through the skin. Although it has a relatively low flash point, TCE burns with difficulty.

**Section 2. Ingredients and Occupational Exposure Limits**

Trichloroethylene, < 100% [contains stabilizers (Sec. 1)].

**1991 OSHA PELs**  
8-hr TWA: 50 ppm (270 mg/m<sup>3</sup>)  
15-min STEL: 200 ppm (1080 mg/m<sup>3</sup>)  
**1990 IDLH Level**  
1000 ppm  
**1990 NIOSH REL**  
10-hr TWA: 25 ppm (~135 mg/m<sup>3</sup>)

**1992-93 ACGIH TLVs**  
TWA: 50 ppm (269 mg/m<sup>3</sup>)  
STEL: 200 ppm (1070 mg/m<sup>3</sup>)  
**1990 DFG (Germany) MAK**  
Ceiling: 50 ppm (270 mg/m<sup>3</sup>)  
Category II: Substances with systemic effects  
Half-life: 2 hr to shift length  
Peak Exposure Limit: 250 ppm, 30 min average value; 2 peaks/shift

**1985-86 Toxicity Data\***  
Human, inhalation, TC<sub>Lo</sub>: 160 ppm/83 min caused hallucinations and distorted perceptions.  
Human, lymphocyte: 5 mL/L caused DNA inhibition.  
Rabbit, skin: 500 mg/24 hr caused severe irritation.  
Rabbit, eye: 20 mg/24 hr caused moderate irritation.  
Mouse, oral, TD<sub>Lo</sub>: 455 mg/kg administered intermittently for 78 weeks produced liver tumors.

\* See NIOSH, RTECS (KX4550000), for additional irritation, mutation, reproductive, tumorigenic and toxicity data.

**Section 3. Physical Data**

**Boiling Point:** 189 °F (87 °C)  
**Freezing Point:** -121 °F (-85 °C)  
**Viscosity:** 0.0055 Poise at 77 °F (25 °C)  
**Molecular Weight:** 131.38  
**Density:** 1.4649 at 20/4 °C  
**Refraction Index:** 1.477 at 68 °F (20 °C/D)  
**Odor Threshold:** 82 to 108 ppm (not an effective warning)

**Vapor Pressure:** 58 mm Hg at 68 °F (20 °C); 100 mm Hg at 32 °F (0 °C)  
**Saturated Vapor Density (Air = 0.075 lbs/ft<sup>3</sup>; 1.2 kg/m<sup>3</sup>):** 0.0956 lbs/ft<sup>3</sup>; 1.53 kg/m<sup>3</sup>  
**Water Solubility:** Very slightly soluble; 0.1% at 77 °F (25 °C)  
**Other Solubilities:** Highly soluble in organic solvents (alcohol, acetone, ether, carbon tetrachloride, & chloroform) and lipids.  
**Surface Tension:** 29.3 dyne/cm

**Appearance and Odor:** Clear, colorless (sometimes dyed blue), mobile liquid with a sweet chloroform odor.

**Section 4. Fire and Explosion Data**

**Flash Point:** 90 °F (32 °C) CC | **Autoignition Temperature:** 788 °F (420 °C) | **LEL:** 8% (25 °C); 12.5% (100 °C) | **UEL:** 10% (25 °C); 90% (100 °C)

**Extinguishing Media:** A Class 1C Flammable Liquid. Although it has a flash point of 90 °F, TCE burns with difficulty. For small fires, use dry chemical, carbon dioxide, water spray, or regular foam. For large fires, use water spray, fog, or regular foam. **Unusual Fire or Explosion Hazards:** Vapor/air mixtures may explode when ignited. Container may explode in heat of fire. **Special Fire-fighting Procedures:** Because fire may produce toxic thermal decomposition products, wear a self-contained breathing apparatus (SCBA) with a full facepiece operated in pressure-demand or positive-pressure mode. Structural firefighters' protective clothing provides only limited protection against TCE. Apply cooling water to sides of container until well after fire is out. Stay away from ends of tanks. Do not release runoff from fire control methods to sewers or waterways.

**Section 5. Reactivity Data**

**Stability/Polymerization:** TCE slowly decomposes in the presence of light and moisture to form corrosive hydrochloric acid. Hazardous polymerization cannot occur. **Chemical Incompatibilities:** Include alkalis (sodium hydroxide), chemically active metals (aluminum, beryllium, lithium, magnesium, sodium, potassium, and titanium), epoxides, and oxidants (nitrogen tetroxide, perchloric acid). Contact with 1-chloro-2,3-epoxy propane or the mono and di 2,3-epoxypropyl ethers of 1,4-butanediol + 2,2-bis-4(2',3'-epoxypropoxy)-phenylpropane can, in the presence of catalytic quantities of halide ions, cause dehydrochlorination of TCE to explosive dichloroacetylene. **Conditions to Avoid:** Exposure to light, moisture, ignition sources, and incompatibles. **Hazardous Products of Decomposition:** Thermal oxidative decomposition of TCE (above 300 °C) or exposure to ultraviolet light can produce carbon dioxide (CO<sub>2</sub>) and toxic dichloro acetylene (explosive), chlorine, hydrogen chloride, and phosgene gas.

**Section 6. Health Hazard Data**

**Carcinogenicity:** The following agencies have rated TCE's carcinogenicity: IARC (Class 3, limited animal evidence & insufficient human data), Germany MAK (Class B, justifiably suspected of having carcinogenic potential), & NIOSH (Class X, carcinogen defined with no further categorization). **Summary of Risks:** TCE vapor is irritating to the eyes, nose, and respiratory tract and inhalation of high concentrations can lead to severe CNS effects such as unconsciousness, ventricular arrhythmias, and death due to cardiac arrest. Mild liver dysfunction was also seen at levels high enough to produce CNS effects. Contact with the liquid is irritating to the skin and can lead to dermatitis by defatting the skin. Chronic toxicity is observed in the victims increasing intolerance to alcohol characterized by 'degreasers flush', a transient redness of the face, trunk, and arms. The euphoric effect of TCE has led to craving, and habitual sniffing of its vapors.

**Section 6. Health Hazard Data, Continued**

TCE crosses the placental barrier and thus exposes the fetus (any effects are yet unknown). There are increased reports of menstrual disorders in women workers and decreased libido in males at exposures high enough to cause CNS effects. TCE is eliminated unchanged in expired air and as metabolites (trichloroacetic acid & trichloroethanol) in blood and urine. **Medical Conditions Aggravated by Long-Term Exposure:** Disorders of the nervous system, skin, heart, liver, and kidney. **Target Organs:** Respiratory, central & peripheral nervous, and cardiovascular (heart) systems, liver, kidney, and skin. **Primary Entry Routes:** Inhalation, skin and eye contact, and ingestion (rarely). **Acute Effects:** Vapor inhalation can cause eye, nose, and throat irritation, nausea, blurred vision, overexcitement, headache, drunkenness, memory loss, irregular heartbeat (resulting in sudden death), unconsciousness, and death due to cardiac failure. Skin contact with the liquid can cause dryness and cracking and prolonged exposure (generally if the victim is unconscious) can cause blistering. Eye contact can cause irritation and watering, with corneal epithelium injury in some cases. Ingestion of the liquid can cause lip, mouth, and gastrointestinal irritation, irregular heartbeat, nausea and vomiting, diarrhea (possibly blood-stained), drowsiness, and risk of pulmonary edema (fluid in lungs). **Chronic Effects:** Effects may persist for several weeks or months after repeated exposure. Symptoms include giddiness, irritability, headache, digestive disturbances, mental confusion, intolerance to alcohol (degreasers flush), altered color perception, loss or impairment of sense of smell, double vision, and peripheral nervous system function impairment including persistent neuritis, temporary loss of sense of touch, and paralysis of the fingers from direct contact with TCE liquid.

**FIRST AID** **Eyes:** Do not allow victim to rub or keep eyes tightly shut. Gently lift eyelids and flush immediately and continuously with flooding amounts of water until transported to an emergency medical facility. Consult a physician immediately. **Skin:** Quickly remove contaminated clothing. Rinse with flooding amounts of water for at least 15 min. Wash exposed area with soap and water. **Inhalation:** Remove exposed person to fresh air and support breathing as needed. **Ingestion:** Never give anything by mouth to an unconscious or convulsing person. Contact a poison control center and unless otherwise advised, have that conscious and alert person drink 1 to 2 glasses of water, then induce vomiting. Do not give milk, as its fat content (TCE is lipid soluble) may enhance gastrointestinal absorption of TCE. **Note to Physicians:** TCE elimination seems to be triphasic with half lives at 20 min, 3 hr, and 30 hr. Some success is seen in treating patients with propranolol, atropine, and disulfiram. Monitor urine and blood (lethal level = 3 to 110 µg/mL) metabolites. BEI = 100 mg/g creatinine (trichloroacetic acid) in urine, *sample at end of workweek*. BEI = 4 mg/L (trichloroethanol) in blood, *sample at end of shift at end of the workweek*. These tests are not 100% accurate indicators of exposure; monitor TCE in expired air as a confirmatory test.

**Section 7. Spill, Leak, and Disposal Procedures**

**Spill/Leak:** Immediately notify safety personnel, isolate and ventilate area, deny entry, and stay upwind. Shut off all ignition sources. For small spills, take up with earth, sand, vermiculite, or other absorbent, noncombustible material and place in suitable container for later disposal. For large spills, flush to containment area where density stratification will form a bottom TCE layer which can be pumped and containerized. Report any release in excess of 1000 lbs. Follow applicable OSHA regulations (29 CFR 1910.120). **Ecotoxicity Values:** Bluegill sunfish, LC<sub>50</sub> = 44,700 µg/L/96 hr; fathead minnow (*Pimephales promelas*), LC<sub>50</sub> = 40.7 mg/L/96 hr. **Environmental Degradation:** In air, TCE is photooxidized with a half-life of 5 days and reported to form phosgene, dichloroacetyl chloride, and formyl chloride. In water it evaporates rapidly in minutes to hours. TCE rapidly evaporates and may leach since it does not absorb to sediment. **Soil Absorption/Mobility:** TCE has a Log K<sub>oc</sub> of 2, indicating high soil mobility. **Disposal:** Waste TCE can be poured on dry sand and allowed to vaporize in isolated location, purified by distillation, or returned to supplier. A potential candidate for rotary kiln incineration at 1508 to 2912 °F (820 to 1600 °C) with an acid scrubber to remove halo acids. Contact your supplier or a licensed contractor for detailed recommendations. Follow applicable Federal, state, and local regulations.

**EPA Designations**

SARA Extremely Hazardous Substance (40 CFR 355): Not listed  
Listed as a SARA Toxic Chemical (40 CFR 372.65)

Listed as a RCRA Hazardous Waste (40 CFR 261.33 & 261.31): No. U228 & F002 (*spent solvent*)

Listed as a CERCLA Hazardous Substance\* (40 CFR 302.4): Final Reportable Quantity (RQ), 100 lb (45.4 kg) [\* per RCRA, Sec. 3001, CWA Sec. 311 (b)(4), & CWA Sec. 307 (a)]

**OSHA Designations**

Listed as an Air Contaminant (29 CFR 1910.1000, Table Z-1-A)

**Section 8. Special Protection Data**

**Goggles:** Wear chemical safety goggles (cup-type or rubber framed, equipped with impact-resistant glass), per OSHA eye- and face-protection regulations (29 CFR 1910.133). Because contact lens use in industry is controversial, establish your own policy. **Respirator:** Seek professional advice prior to respirator selection and use. Follow OSHA respirator regulations (29 CFR 1910.134) and, if necessary, wear a MSHA/NIOSH-approved respirator. At any detectable concentration, wear a SCBA with a full facepiece operated in pressure demand or other positive pressure mode. For emergency or nonroutine operations (cleaning spills, reactor vessels, or storage tanks), wear an SCBA. **Warning!** Air-purifying respirators do not protect workers in oxygen-deficient atmospheres. If respirators are used, OSHA requires a respiratory protection program that includes at least: medical certification, training, fit-testing, periodic environmental monitoring, maintenance, inspection, cleaning, and convenient, sanitary storage areas. **Other:** Wear chemically protective gloves, boots, aprons, and gauntlets made from Viton or Neoprene to prevent skin contact. Do not use natural rubber or polyvinyl chloride (PVC). **Ventilation:** Provide general and local exhaust ventilation systems to maintain airborne concentrations below OSHA PELs (Sec. 2). Local exhaust ventilation is preferred because it prevents contaminant dispersion into the work area by controlling it at its source.<sup>(103)</sup> **Safety Stations:** Make available in the work area emergency eyewash stations, safety/quick-drench showers, and washing facilities. **Contaminated Equipment:** Separate contaminated work clothes from street clothes and launder before reuse. Remove this material from your shoes and clean personal protective equipment. **Comments:** Never eat, drink, or smoke in work areas. Practice good personal hygiene especially before eating, drinking, smoking, using the toilet, or applying cosmetics.

**Section 9. Special Precautions and Comments**

**Storage Requirements:** Prevent physical damage to containers. Store in steel drums, in a cool, dry, well-ventilated area away from sunlight, heat, ignition sources, and incompatibles (Sec. 5). Store large quantities in galvanized iron, black iron, or steel containers; small amounts in dark (amber) colored glass bottles. **Engineering Controls:** To reduce potential health hazards, use sufficient dilution or local exhaust ventilation to control airborne contaminants and to maintain concentrations at the lowest practical level. Design processes so that the operator is not directly exposed to the solvent or its vapor. Do not use open electric heaters, high-temperature processes, arc-welding or open flames in TCE atmospheres. **Administrative Controls:** Consider preplacement and periodic medical exams of exposed workers with emphasis on skin, respiratory, cardiac, central and peripheral nervous systems, and liver and kidney function. Employ air and biological monitoring (BELs). Instruct employees on safe handling of TCE.

**Transportation Data (49 CFR 172.101)**

OT Shipping Name: Trichloroethylene  
DOT Hazard Class: 6.1  
ID No.: UN1710  
DOT Packing Group: III  
DOT Label: Keep Away From Food  
DOT Special Provisions (172.102): N36, T1

**Packaging Authorizations**  
a) Exceptions: 173.153  
b) Non-bulk Packaging: 173.203  
c) Bulk Packaging: 173.241

**Quantity Limitations**  
a) Passenger Aircraft or Railcar: 60L  
b) Cargo Aircraft Only: 220L  
**Vessel Storage Requirements**  
a) Vessel Stowage: A  
b) Other: 40

MSDS Collection References: 26, 73, 100, 101, 103, 124, 126, 127, 132, 133, 136, 139, 140, 148, 149, 153, 159, 163, 164, 167, 168, 171, 174, 175, 176, 180.  
Prepared by: M Gannon, BA; Industrial Hygiene Review: D Wilson, CIH; Medical Review: AC Darlington, MD



# Genium Publishing Corporation

One Genium Plaza  
Schenectady, NY 12304-4690 USA  
(518) 377-8854

## Material Safety Data Sheets Collection:

Sheet No. 318  
Xylene (Mixed Isomers)

Issued: 11/80 Revision: E, 9/92

### Section 1. Material Identification

39

**Xylene (Mixed Isomers) (C<sub>8</sub>H<sub>10</sub>)** Description: The commercial product is a blend of the three isomers [*ortho*-(*o*-), *meta*-(*m*-), *para*-(*p*-)] with the largest proportion being *m*-xylene. Xylene is obtained from coal tar, toluene by transalkylation, and pseudocumene. Used in the manufacture of dyes, resins, paints, varnishes, and other organics; as a general solvent for adhesives, a cleaning agent in microscope technique; as a solvent for Canada balsam microscopy; as a fuel component; in aviation gasoline, protective coatings, sterilizing catgut, hydrogen peroxide, perfumes, insect repellants, pharmaceuticals, and the leather industry; in the production of phthalic anhydride, isophthalic, and terephthalic acids and their dimethyl esters which are used in the manufacture of polyester fibers; and as an indirect food additive as a component of adhesives. Around the home, xylene is found as vehicles in paints, paint removers, degreasing cleaners, lacquers, glues and cements and as solvent/vehicles for pesticides.

R 1  
I 2  
S 2  
K 3



HMS  
H 2+  
F 3  
R 0  
PPE ‡  
† Chronic Effects  
‡ Sec. 8

Other Designations: CAS No. 1330-20-7 [95-47-6; 108-38-3; 106-42-3 (*o*-, *m*-, *p*-isomers)], dimethylbenzene, methyltoluene, NCI-C55232, Violet 3, xylool.

Manufacturers: Contact your supplier or distributor. Consult latest *Chemical Week Buyers' Guide*<sup>(73)</sup> for a suppliers list.

**Cautions:** Xylene is an eye, skin, and mucous membrane irritant and may be narcotic in high concentrations. It is a dangerous fire hazard.

### Section 2. Ingredients and Occupational Exposure Limits

Xylene (mixed isomers): the commercial product generally contains ~ 40% *m*-xylene; 20% each of *o*-xylene, *p*-xylene, and ethylbenzene; and small quantities of toluene. Unpurified xylene may contain pseudocumene.

#### 1991 OSHA PELs

8-hr TWA: 100 ppm (435 mg/m<sup>3</sup>)  
15-min STEL: 150 ppm (655 mg/m<sup>3</sup>)

#### 1992-93 ACGIH TLVs

TWA: 100 ppm (434 mg/m<sup>3</sup>)  
STEL: 150 ppm (651 mg/m<sup>3</sup>)  
BEI (Biological Exposure Index): Methylhippuric acids in urine at end of shift: 1.5 g/g creatinine

#### 1985-86 Toxicity Data\*

Human, inhalation, TC<sub>Lo</sub>: 200 ppm produced olfaction effects, conjunctiva irritation, and other changes involving the lungs, thorax, or respiration. Man, inhalation, LC<sub>Lo</sub>: 10000 ppm/6 hr; toxic effects not yet reviewed.  
Human, oral, LD<sub>Lo</sub>: 50 mg/kg; no toxic effect noted. Rat, oral, LD<sub>50</sub>: 4300 mg/kg; toxic effect not yet reviewed.  
Rat, inhalation, LC<sub>50</sub>: 5000 ppm/4 hr; toxic effects not yet reviewed.

#### 1990 IDLH Level

1000 ppm

#### 1990 NIOSH RELs

TWA: 100 ppm (435 mg/m<sup>3</sup>)  
STEL: 150 ppm (655 mg/m<sup>3</sup>)

#### 1990 DFG (Germany) MAK

TWA: 100 ppm (440 mg/m<sup>3</sup>)  
Category II: Substances with systemic effects  
Half-life: < 2 hr  
Peak Exposure: 200 ppm, 30 min, average value, 4 peaks per shift

\* See NIOSH, RTECS (XE2100000), for additional toxicity data.

### Section 3. Physical Data

**Boiling Point Range:** 279 to 284 °F (137 to 140 °C)\*  
**Boiling Point:** *ortho*: 291 °F (144 °C); *meta*: 281.8 °F (138.8 °C); *para*: 281.3 °F (138.5 °C)  
**Freezing Point/Melting Point:** *ortho*: -13 °F (-25 °C); *meta*: -53.3 °F (-47.4 °C); *para*: 55 to 57 °F (13 to 14 °C)  
**Vapor Pressure:** 6.72 mm Hg at 70 °F (21 °C)  
**Saturated Vapor Density (Air = 1.2 kg/m<sup>3</sup>):** 1.23 kg/m<sup>3</sup>, 0.077 lbs/ft<sup>3</sup>

**Molecular Weight:** 106.16  
**Specific Gravity:** 0.864 at 20 °C/4 °C  
**Water Solubility:** Practically insoluble  
**Other Solubilities:** Miscible with absolute alcohol, ether, and many other organic liquids.  
**Octanol/Water Partition Coefficient:** logKow = 3.12-3.20  
**Odor Threshold:** 1 ppm  
**Viscosity:** <32.6 SUS

**Appearance and Odor:** Clear, sweet-smelling liquid.

\* Materials with wider and narrower boiling ranges are commercially available.

### Section 4. Fire and Explosion Data

**Flash Point:** 63 to 77 °F (17 to 25 °C) CC | **Autoignition Temperature:** 982 °F (527 °C) (*m*-) | **LEL:** 1.1 (*m*-, *p*-); 0.9 (*o*-) | **UEL:** 7.0 (*m*-, *p*-); 6.7 (*o*-)

**Extinguishing Media:** For small fires, use dry chemical, carbon dioxide (CO<sub>2</sub>), water spray or regular foam. For large fires, use water spray, fog or regular foam. Water may be ineffective. Use water spray to cool fire-exposed containers. Unusual Fire or Explosion Hazards: Xylene vapors or liquid (which floats on water) may travel to an ignition source and flash back. The heat of fire may cause containers to explode and/or produce irritating or poisonous decomposition products. Xylene may present a vapor explosion hazard indoors, outdoors, or in sewers. Accumulated static electricity may occur from vapor or liquid flow sufficient to cause ignition. **Special Fire-fighting Procedures:** Because fire may produce toxic thermal decomposition products, wear a self-contained breathing apparatus (SCBA) with a full facepiece operated in pressure-demand or positive-pressure mode. Structural firefighter's protective clothing will provide limited protection. If feasible and without risk, move containers from fire area. Otherwise, cool fire-exposed containers until well after fire is extinguished. Stay clear of tank ends. Use unmanned hose holder or monitor nozzles for massive cargo fires. If impossible, withdraw from area and let fire burn. Withdraw immediately in case of any tank discoloration or rising sound from venting safety device. Do not release runoff from fire control methods to sewers or waterways.

### Section 5. Reactivity Data

**Stability/Polymerization:** Xylene is stable at room temperature in closed containers under normal storage and handling conditions. Hazardous polymerization cannot occur. Xylene is easily chlorinated, sulfonated, or nitrated. **Chemical Incompatibilities:** Incompatibilities include strong acids and oxidizers and 1,3-dichloro-5,5-dimethyl-2,4-imidazolidindione (dichlorohydrantoin). Xylene attacks some forms of plastics, rubber, and coatings. **Conditions to Avoid:** Avoid heat and ignition sources and incompatibles. **Hazardous Products of Decomposition:** Thermal oxidative decomposition of xylene can produce carbon dioxide, carbon monoxide, and various hydrocarbon products.

### Section 6. Health Hazard Data

**Carcinogenicity:** The IARC,<sup>(164)</sup> NTP,<sup>(169)</sup> and OSHA<sup>(164)</sup> do not list xylene as a carcinogen. **Summary of Risks:** Xylene is an eye, mucous membrane, and respiratory tract irritant. Irritation starts at 200 ppm; severe breathing difficulties which may be delayed in onset can occur at high concentrations. It is a central nervous system (CNS) depressant and at high concentrations can cause coma. Kidney and liver damage can occur with xylene exposure. With prolonged or repeated cutaneous exposure, xylene produces a defatting dermatitis. Chronic toxicity is not well defined, but it is less toxic than benzene. Prior to the 1950s, benzene was often found as a contaminant of xylene and the effects attributed to xylene such as blood dyscrasias are questionable. Since the late 1950s, xylenes have been virtually benzene-free and blood dyscrasias have not been associated with xylenes. Chronic exposure to high concentrations of xylene in animal studies have demonstrated milk reversible decrease in red and white cell counts as well as increases in platelet counts.

Continue on next page

**Section 6. Health Hazard Data, continued**

irregularity was reported in association with workplace exposure to xylene perhaps due to effects on liver metabolism. Xylene crosses the human placenta, but does not appear to be teratogenic under conditions tested to date. **Medical Conditions Aggravated by Long-Term Exposure:** CNS, respiratory, eye, skin, gastrointestinal (GI), liver and kidney disorders. **Target Organs:** CNS, eyes, GI tract, liver, kidneys, and skin. **Primary Entry Routes:** Inhalation, skin absorption (slight), eye contact, ingestion. **Acute Effects:** Inhalation of high xylene concentrations may cause dizziness; nausea, vomiting, and abdominal pain; eye, nose, and throat irritation; respiratory tract irritation leading to pulmonary edema (fluid in lung); drowsiness; and unconsciousness. Direct eye contact can result in conjunctivitis and corneal burns. Ingestion may cause a burning sensation in the oropharynx and stomach and transient CNS depression. **Chronic Effects:** Repeated or prolonged skin contact may cause drying and defatting of the skin leading to dermatitis. Repeated eye exposure to high vapor concentrations may cause reversible eye damage, peripheral and central neuropathy, and liver damage. Other symptoms of chronic exposure include headache, fatigue, irritability, chronic bronchitis, and GI disturbances such as nausea, loss of appetite, and gas.

**FIRST AID** *Emergency personnel should protect against exposure.* **Eyes:** Do not allow victim to rub or keep eyes tightly shut. Gently lift eyelids and flush immediately and continuously with flooding amounts of water until transported to an emergency medical facility. Consult a physician immediately. **Skin:** Quickly remove contaminated clothing. Rinse with flooding amounts of water for at least 15 min. Wash exposed area with soap and water. For reddened or blistered skin, consult a physician. Carefully dispose of contaminated clothing as it may pose a fire hazard. **Inhalation:** Remove exposed person to fresh air and support breathing as needed. Monitor exposed person for respiratory distress. **Ingestion:** Never give anything by mouth to an unconscious or convulsing person. Contact a poison control center and unless otherwise advised, *do not induce vomiting!* If spontaneous vomiting should occur, keep exposed person's head below the hips to prevent aspiration (breathing liquid xylene into the lungs). *Aspiration of a few millimeters of xylene can cause chemical pneumonitis, pulmonary edema, and hemorrhage.* Note to Physicians: Hippuric acid or the ether glucuronide of ortho-toluic acid may be useful in diagnosis of meta-, para- and ortho-xylene exposure, respectively. Consider gastric lavage if a large quantity of xylene was ingested. Proceed gastric lavage with protection of the airway from aspiration; consider endotracheal intubation with inflated cuff.

**Section 7. Spill, Leak, and Disposal Procedures**

**Spill/Leak:** Notify safety personnel, evacuate all unnecessary personnel, remove all heat and ignition sources, and ventilate spill area. Cleanup personnel should protect against vapor inhalation and skin or eye contact. If feasible and without undue risk, stop leak. Use appropriate foam to blanket release and suppress vapors. Water spray may reduce vapor, but does not prevent ignition in closed spaces. For small spills, absorb on paper and evaporate in appropriate exhaust hood or absorb with sand or some non-combustible absorbent and place in containers for later disposal. For large spills dike far ahead of liquid to contain. Do not allow xylene to enter a confined space such as sewers or drains. On land, dike to contain or divert to impermeable holding area. Apply water spray to control flammable vapor and remove material with pumps or vacuum equipment. On water, contain material with natural barriers, booms, or weirs; apply universal gelling agent; and use suction hoses to remove spilled material. Report any release in excess of 1000 lb. Follow applicable OSHA regulations (29 CFR 1910.120). **Environmental Transport:** Little bioconcentration is expected. Biological oxygen demand 5 (after 5 days at 20 °C): 0.64 (no stated isomer). Ecotoxicity values: LD<sub>50</sub> Goldfish, 13 mg/L/24 hr, conditions of bioassay not specified, no specific isomer. **Environmental Degradation:** In the atmosphere, xylenes degrade by reacting with photochemically produced hydroxyl radicals with a half-life ranging from 1-1.7 hr. in the summer to 10-18 hr in winter or a typical loss of 67-86% per day. Xylenes are resistant to hydrolysis. **Soil Absorption/Mobility:** Xylenes have low to moderate adsorption to soil and when spilled on land, will volatilize and leach into groundwater. **Disposal:** As a hydrocarbon, xylene is a good candidate for controlled incineration. Contact your supplier or a licensed contractor for detailed recommendations. Follow applicable Federal, state, and local regulations.

**EPA Designations**

SARA Extremely Hazardous Substance (40 CFR 355): Not listed

Listed as a SARA Toxic Chemical (40 CFR 372.65)

Listed as a RCRA Hazardous Waste (40 CFR 261.33): No. U239, F003 (spent solvent)

Listed as a CERCLA Hazardous Substance\* (40 CFR 302.4): Final Reportable Quantity (RQ), 1000 lb (454 kg) [\* per Clean Water Act, Sec. 311(b)(4); per RCRA, Sec. 3001]

**OSHA Designations**

Listed as an Air Contaminant (29 CFR 1910.1000, Table Z-1-A)

**Section 8. Special Protection Data**

**Goggles:** Wear protective eyeglasses or chemical safety goggles, per OSHA eye- and face-protection regulations (29 CFR 1910.133). Because contact lens use in industry is controversial, establish your own policy. **Respirator:** Seek professional advice prior to respirator selection and use. Follow OSHA respirator regulations (29 CFR 1910.134) and, if necessary, wear a MSHA/NIOSH-approved respirator. For concentrations >1000 ppm, use any chemical cartridge respirator with organic vapor cartridges; any powered, air-purifying respirator with organic vapor cartridges; any supplied-air respirator; or any self-contained breathing apparatus. For emergency or nonroutine operations (cleaning spills, reactor vessels, or storage tanks), wear an SCBA. **Warning!** *Air-purifying respirators do not protect workers in oxygen-deficient atmospheres.* If respirators are used, Other: Wear chemically protective gloves, boots, aprons, and gauntlets to prevent all skin contact. With breakthrough times > 8 hr, consider polyvinyl alcohol and fluorocarbon rubber (Viton) as materials for PPE. **Ventilation:** Provide general and local exhaust ventilation systems to maintain airborne concentrations below the OSHA PELs (Sec. 2). Local exhaust ventilation is preferred because it prevents contaminant dispersion into the work area by controlling it at its source.<sup>(103)</sup> **Safety Stations:** Make available in the work area emergency eyewash stations, safety/quick-drench showers, and washing facilities. **Contaminated Equipment:** Separate contaminated work clothes from street clothes. Launder contaminated work clothing before wearing. Remove this material from your shoes and clean PPE. **Comments:** Never eat, drink, or smoke in work areas. Practice good personal hygiene after using this material, especially before eating, drinking, smoking, using the toilet, or applying cosmetics.

**Section 9. Special Precautions and Comments**

**Storage Requirements:** Store in clearly labelled, tightly closed, containers in a cool, well-ventilated place, away from strong oxidizing materials and heat and ignition sources. During transferring operations, electrically ground and bond metal containers. **Engineering Controls:** To reduce potential health hazards, use sufficient dilution or local exhaust ventilation to control airborne contaminants and to maintain concentrations at the lowest practical level. Use hermetically sealed equipment, transfer xylene in enclosed systems, avoid processes associated with open evaporating surfaces, and provide sources of gas release with enclosures and local exhaust ventilation. Use Class I, Group D electrical equipment. **Administrative Controls:** Establish air and biological monitoring programs and evaluate regularly. Consider preplacement and periodic medical examinations including a complete blood count, a routine urinalysis, and liver function tests. Consider hematologic studies if there is any significant contamination of the solvent with benzene. If feasible, consider the replacement of xylene by less toxic solvents such as petrol (motor fuel) or white spirit. Before carrying out maintenance and repair work, steam and flush all equipment to remove any xylene residues.

**Transportation Data (49 CFR 172.101)**

DOT Shipping Name: Xylenes

DOT Hazard Class: 3

ID No.: UN1307

DOT Packing Group: II

DOT Label: Flammable Liquid

Special Provisions (172.102): T1

Packaging Authorizations

a) Exceptions: 173.150

b) Nonbulk Packaging: 173.202

c) Bulk Packaging: 173.242

Quantity Limitations

a) Passenger, Aircraft, or Railcar: 5L

b) Cargo Aircraft Only: 60L

Vessel Stowage Requirements

a) Vessel Stowage: B

b) Other: -

**MSDS Collection References:** 26, 73, 89, 100, 101, 103, 124, 126, 127, 132, 133, 136, 139, 140, 148, 149, 153, 159, 163, 164, 167, 171, 174, 176, 180.

Prepared by: MJ Wurth, BS; Industrial Hygiene Review: PA Roy, MPH, CIH; Medical Review: W Silverman, MD

**Appendix C**  
**Emergency Procedures for Exposure to**  
**Hazardous Materials/Waste**

---

## APPENDIX C

### EMERGENCY PROCEDURES FOR EXPOSURE TO HAZARDOUS MATERIALS/WASTE

1. Call ambulance or transport individual to hospital/clinic immediately. Don't forget to take the HASP with you; it contains information on the contaminants expected to be found on site and will assist the physician in his/her assessment of the exposure.
2. Fill in Potential Exposure Report, answering each of the questions to the best of your ability.
3. Contact our physician(s) at EMR as soon as possible. The procedure is as follows:

- a. Call EMR at 1-800-229-3674!
- b. Ask to speak with:

Dr. David L. Barnes;  
Dr. Elaine Theriault; or  
Ms. T.J. Wolff, R.N.

Note: During nonbusiness hours (after 6 p.m.) call 1-800-229-3674 and follow directions for paging the aforementioned individuals.

4. Once in contact with any of these individuals, explain what has happen (they will review the information on the form with you and may ask you to fax the form to them, if possible), and allow either of them to speak with the attending physician.
5. When asked about payment (and they will ask), inform the Hospital/Clinic/Physician that this is a "work related injury" and have them contact the Benefits Coordinator at (412) 269-2744. Have invoices sent to:

Michael Baker Jr. Inc.  
Attn: Benefits Coordinator  
Airport Office Park, Bldg. 3  
Coraopolis, PA 15108

6. Contact the Project Manager and the Project Health and Safety Officer as soon as it is feasible, but wait no longer than 24 hours.

Name: \_\_\_\_\_ Date of Exposure: \_\_\_\_\_

Social Security No.: \_\_\_\_\_ Age: \_\_\_\_\_ Sex: \_\_\_\_\_

**I. Exposing Agent**Name of Product or Chemicals (if known) \_\_\_\_\_  
\_\_\_\_\_

Characteristics (if the name is not known)

Solid      Liquid      Gas      Fume      Mist      Vapor

**II. Dose Determinants**

What was individual doing? \_\_\_\_\_

How long did individual work in area before signs/symptoms developed?  
\_\_\_\_\_Was protective gear being used? If yes, what was the PPE?  
\_\_\_\_\_

Was there skin contact? \_\_\_\_\_

Was the exposing agent inhaled? \_\_\_\_\_

Were other persons exposed? If yes, did they experience symptoms?  
\_\_\_\_\_**III. Signs and Symptoms (check off appropriate symptoms)**Immediately with Exposure:

- |   |   |
|---|---|
| <input type="checkbox"/> Burning of eyes, nose, or throat | <input type="checkbox"/> Chest tightness/pressure |
| <input type="checkbox"/> Tearing                          | <input type="checkbox"/> Nausea/vomiting          |
| <input type="checkbox"/> Headache                         | <input type="checkbox"/> Dizziness                |
| <input type="checkbox"/> Cough                            | <input type="checkbox"/> Weakness                 |
| <input type="checkbox"/> Shortness of breath              | <input type="checkbox"/> Heat flashes             |
| <input type="checkbox"/> Delirium                         | <input type="checkbox"/> Other _____              |

Delayed Symptoms:

- |  |  |
|--|--|
| <input type="checkbox"/> Weakness            | <input type="checkbox"/> Loss of appetite  |
| <input type="checkbox"/> Nausea/vomiting     | <input type="checkbox"/> Abdominal pain    |
| <input type="checkbox"/> Shortness of breath | <input type="checkbox"/> Headache          |
| <input type="checkbox"/> Cough               | <input type="checkbox"/> Numbness/tingling |
|  | <input type="checkbox"/> Other _____       |

**POTENTIAL EXPOSURE REPORT****IV. Present Status of Symptoms (check off appropriate symptoms)**

- |   |  |
|---|--|
| <input type="checkbox"/> Burning of eyes, nose, or throat | <input type="checkbox"/> Nausea/vomiting   |
| <input type="checkbox"/> Tearing                          | <input type="checkbox"/> Dizziness         |
| <input type="checkbox"/> Headache                         | <input type="checkbox"/> Weakness          |
| <input type="checkbox"/> Cough                            | <input type="checkbox"/> Loss of appetite  |
| <input type="checkbox"/> Shortness of breath              | <input type="checkbox"/> Abdominal pain    |
| <input type="checkbox"/> Chest tightness/pressure         | <input type="checkbox"/> Numbness/tingling |
| <input type="checkbox"/> Cyanosis (bluish skin color)     | <input type="checkbox"/> Other _____       |

Have symptoms (please check off appropriate response and give duration of symptoms):

Improved \_\_\_\_\_ Worsened \_\_\_\_\_ Remain Unchanged \_\_\_\_\_

**V. Treatment of Symptoms (check off appropriate response)**

None \_\_\_\_\_ Self-medicated \_\_\_\_\_ Physician treated \_\_\_\_\_

**VI. Name** \_\_\_\_\_  
(Attending physician)

**VII. Hospital/Clinic** \_\_\_\_\_